

**ADDENDUM
NO. 2**

January 26, 2026

**Carmel High School 2026 Improvements Projects
520 E. Main Street
Carmel, IN 46032**

TO: ALL BIDDERS OF RECORD

This Addendum forms a part of and modifies the Bidding Requirements, Contract Forms, Contract Conditions, the Specifications and the Drawings dated December 17, 2025, by Fanning/Howey Associates. Acknowledge receipt of the Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of Pages ADD 2-1 through ADD 2-1, and attached Fanning Howey Addendum 2 dated January 23, 2026, 1 page, 2 items, 1 page and revised Addendum Drawings: A-104, A-106, A-701, A-702, ED101, EL101, and EP101.

B. SPECIFICATION SECTION 01 12 00 Multiple Contract Summary

A. Bid Category No 1 General Trades

Clarifications

Revise the following Clarification:

11. Responsible for all site clearing demo within 31 10 00 with the exception of the asphalt removal where asphalt is being replaced. *This contractor is responsible for demo of asphalt where concrete is going back.*

ADDENDUM NO. 2

2026 Carmel High School – Improvement Projects

Carmel Clay Schools
Carmel, Indiana

Project No. 225098.00

Index of Contents

Addendum No. 2, 2 items, 1 page
Revised Drawing Sheets: A-104, A-106, A-701, A-702, ED101, EL101, and EP101

January 23, 2026

I hereby certify that this Addendum was prepared by me or under my direct supervision and that I am a duly registered Architect/Engineer under the Laws of the State of Indiana.

FANNING/HOWEY ASSOCIATES, INC.
ARCHITECTS/ENGINEERS/CONSULTANTS



Paul A. Miller, License No. AR10800161
Expiration Date: 12/31/2027

TO: ALL BIDDERS OF RECORD

ADDENDUM NO. 2 to Drawings and Project Manual, dated December 17, 2026, for the 2026 Carmel High School Improvement Projects for Carmel Clay Schools, 5201 E. Main St., Carmel, Indiana 46033; as prepared by Fanning/Howey Associates, Inc., Indianapolis, Indiana.

This Addendum shall hereby be and become a part of the Contract Documents the same as if originally bound thereto.

The following clarifications, amendments, additions, revisions, changes, and modifications change the original Contract Documents only in the amount and to the extent hereinafter specified in this Addendum.

Each bidder shall acknowledge receipt of this Addendum in his proposal or bid.

NOTE: Bidders are responsible for becoming familiar with every item of this Addendum. (This includes miscellaneous items at the very end of this Addendum.)

RE: ALL BIDDERS

ITEM NO. 1. PROJECT MANUAL, SECTION 09 67 23 – DECORATIVE RESINOUS FLOORING

A. Replace 2.1, A., 1., as follows:

“1. Basis of Design: Tnemec, quartz as listed in the “List of Finishes”.

B. Article 2.1, A: Delete subparagraphs 2, 3, 4, 5, 6, 7, and 8., in their entirety.

ITEM NO. 2. REVISED DRAWING SHEETS

A. Drawing Sheets: A-104, A-106, A-701, A-702, ED101, EL101, and EP101 have been revised, dated 1/23/26, and is included with and hereby made a part of this Addendum. These Drawings supersede the original documents.

END OF ADDENDUM

2026 CARMEL HIGH SCHOOL IMPROVEMENT PROJECTS


520 EAST MAIN STREET
CARMEL, IN 46032

CARMEL CLAY SCHOOLS
5201 EAST MAIN STREET
CARMEL, IN 46033
317-844-9961



ARCHITECT
FANNING HOWEY

317-848-0966
WWW.FHAI.COM
350 E. NEW YORK ST. SUITE 300, INDIANAPOLIS, IN 46204

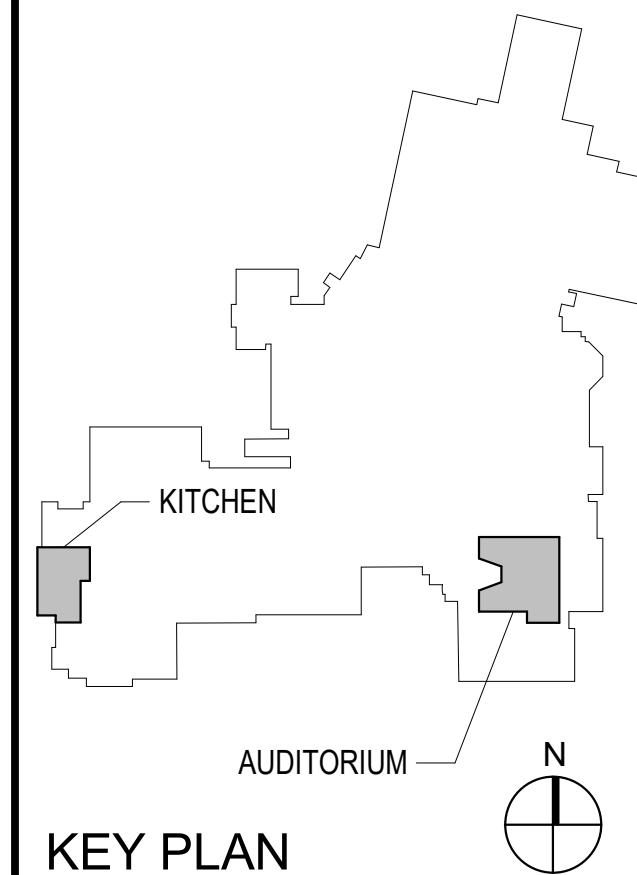

KEY PLAN

100% CONSTRUCTION DOCUMENTS



DRAWN BY: DSR
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025

REV. NO. DESCRIPTION DATE
1 ADDENDUM #2 01/23/2026

ROOF PLAN GENERAL NOTES

A. ALL DETAILS SHOWN ARE FOR GENERAL INFORMATION.
ALL FINAL FLASHING CONDITIONS SHALL BE THE RESPONSIBILITY OF THE ROOF INSTALLER, AND SHALL MEET APPROVAL OF ROOF MANUFACTURER.
B. ALL ROOF CONTRACTORS SHALL SUBMIT DRAWINGS APPROVAL. CONTRACTOR SHALL INSPECT AND VERIFY ALL EXISTING FIELD CONDITIONS, CLEARANCES AND DIMENSIONS BEFORE STARTING CONSTRUCTION.
COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE OF EXISTING CONDITIONS. SHOULD DIFFERENT CONDITIONS BE ENCOUNTERED, CONTACT ARCHITECT BEFORE PROCEEDING WITH FURTHER WORK.
C. CONTRACTOR SHALL BE CULLED BY THE ARCHITECT, MECHANICAL CONTRACTOR TO COORDINATE LOCATION OF OPENING IN ROOF WITH ROOF CONTRACTOR. CURB TO BE PROVIDED BY MECHANICAL CONTRACTOR AND INSTALLED BY ROOF CONTRACTOR.
D. PROVIDE FLASHING AND SADDLES FOR ALL EQUIPMENT PROVIDED UNDER MECHANICAL.
E. SADDLES AND TAPERED INSULATION SPONGES INDICATE DIRECTION OF SLOPE. ROOF CONTRACTOR SHALL PROVIDE SUBMIT DRAWINGS FOR TAPERED INSULATION AND SADDLES TO INSURE POSITIVE SLOPE.
F. THE ROOF CONTRACTOR SHALL PROTECT ALL ROOF DRAINS AND DOWNSPOUTS FROM DEBRIS AND DUST DEBRIS CREATED DURING DEMOLITION AND CONSTRUCTION. THE ROOF CONTRACTOR SHALL INSPECT AND CLEAR ALL DRAINS, SCUPPLERS, AND DOWNSPOUTS PRIOR TO COMMENCEMENT OF WORK AND MAKE SURE THEY ARE FREE OF DEBRIS AND ARE FUNCTIONING PROPERLY.
G. MECHANICAL, ELECTRICAL AND PLUMBING INFORMATION SHOWN ON THIS PLAN IS GENERAL IN NATURE. REFER TO P.M. AND E.D. DRAWINGS FOR FURTHER INFORMATION AND COORDINATE ALL REQUIRED ROOF OPENINGS OR ROOF MOUNTED EQUIPMENT.

ROOF PLAN NOTES


(ALL NOTES MAY NOT BE INDICATED ON THIS SHEET)

NO.	DESCRIPTION
1	PRE-FINISHED METAL COPING SYSTEM: FASCIA
2	ROOF DRAIN OVERFLOW ROOF DRAIN. SEE 1/A-502.
3	ROOF EXPANSION JOINT ASSEMBLY.
5	METAL GUTTER SYSTEM.
6	METAL DOWNSPOUT WITH WIRE STRAINER. CONNECT TO UNDERGROUND STORM PIPE (WHERE APPLICABLE).
7	RIDGE VENT.
8	KITCHEN EQUIPMENT: SEE FOODSERVICE DRAWINGS FOR ADDITIONAL INFORMATION. FLASH AND TERMINATE NEW ROOFING.
9	EXISTING MECHANICAL EQUIPMENT. TEMPORARILY DISCONNECT AND REMOVE TO FLASH AND TERMINATE NEW ROOFING TO EXISTING CURB. SEE 4/A-502.
10	SEE ADDENDUM SHEET FOR UNDERLAYMENT MEMBRANE (3'0" WIDE BY 12'0" LONG).
11	MODIFY EXISTING METAL SCREEN VALVE TO ACCEPT NEW LOUVER AND TRUE LOUVER. DUCTWORK SHALL FIT BETWEEN EXISTING STEEL MEMBERS. PRE-FINISHED LOUVER SHALL BE PROVIDED BY THE CONTRACTOR. SEE FOODSERVICE DRAWINGS FOR ADDITIONAL INFORMATION.

ROOF TYPE LEGEND

A	MEMBRANE ROOFING SYSTEM (ADHERED) ON 1/4" COVER BOARD OVER FLAT AND TAPERED ROOF INSULATION (1/4" PER FT.) OVER VAPOR BARRIER ON EXISTING CONCRETE DECK.
B	MEMBRANE ROOFING SYSTEM (ADHERED) ON 1/4" COVER BOARD OVER FLAT AND TAPERED ROOF INSULATION (1/4" PER FT.) OVER VAPOR BARRIER ON EXISTING METAL DECK.
C	ASPHALT SHINGLES OVER SYNTHETIC ROOF UNDERLAYMENT ON EXISTING PLYWOOD SHEATHING.

ARCHITECT

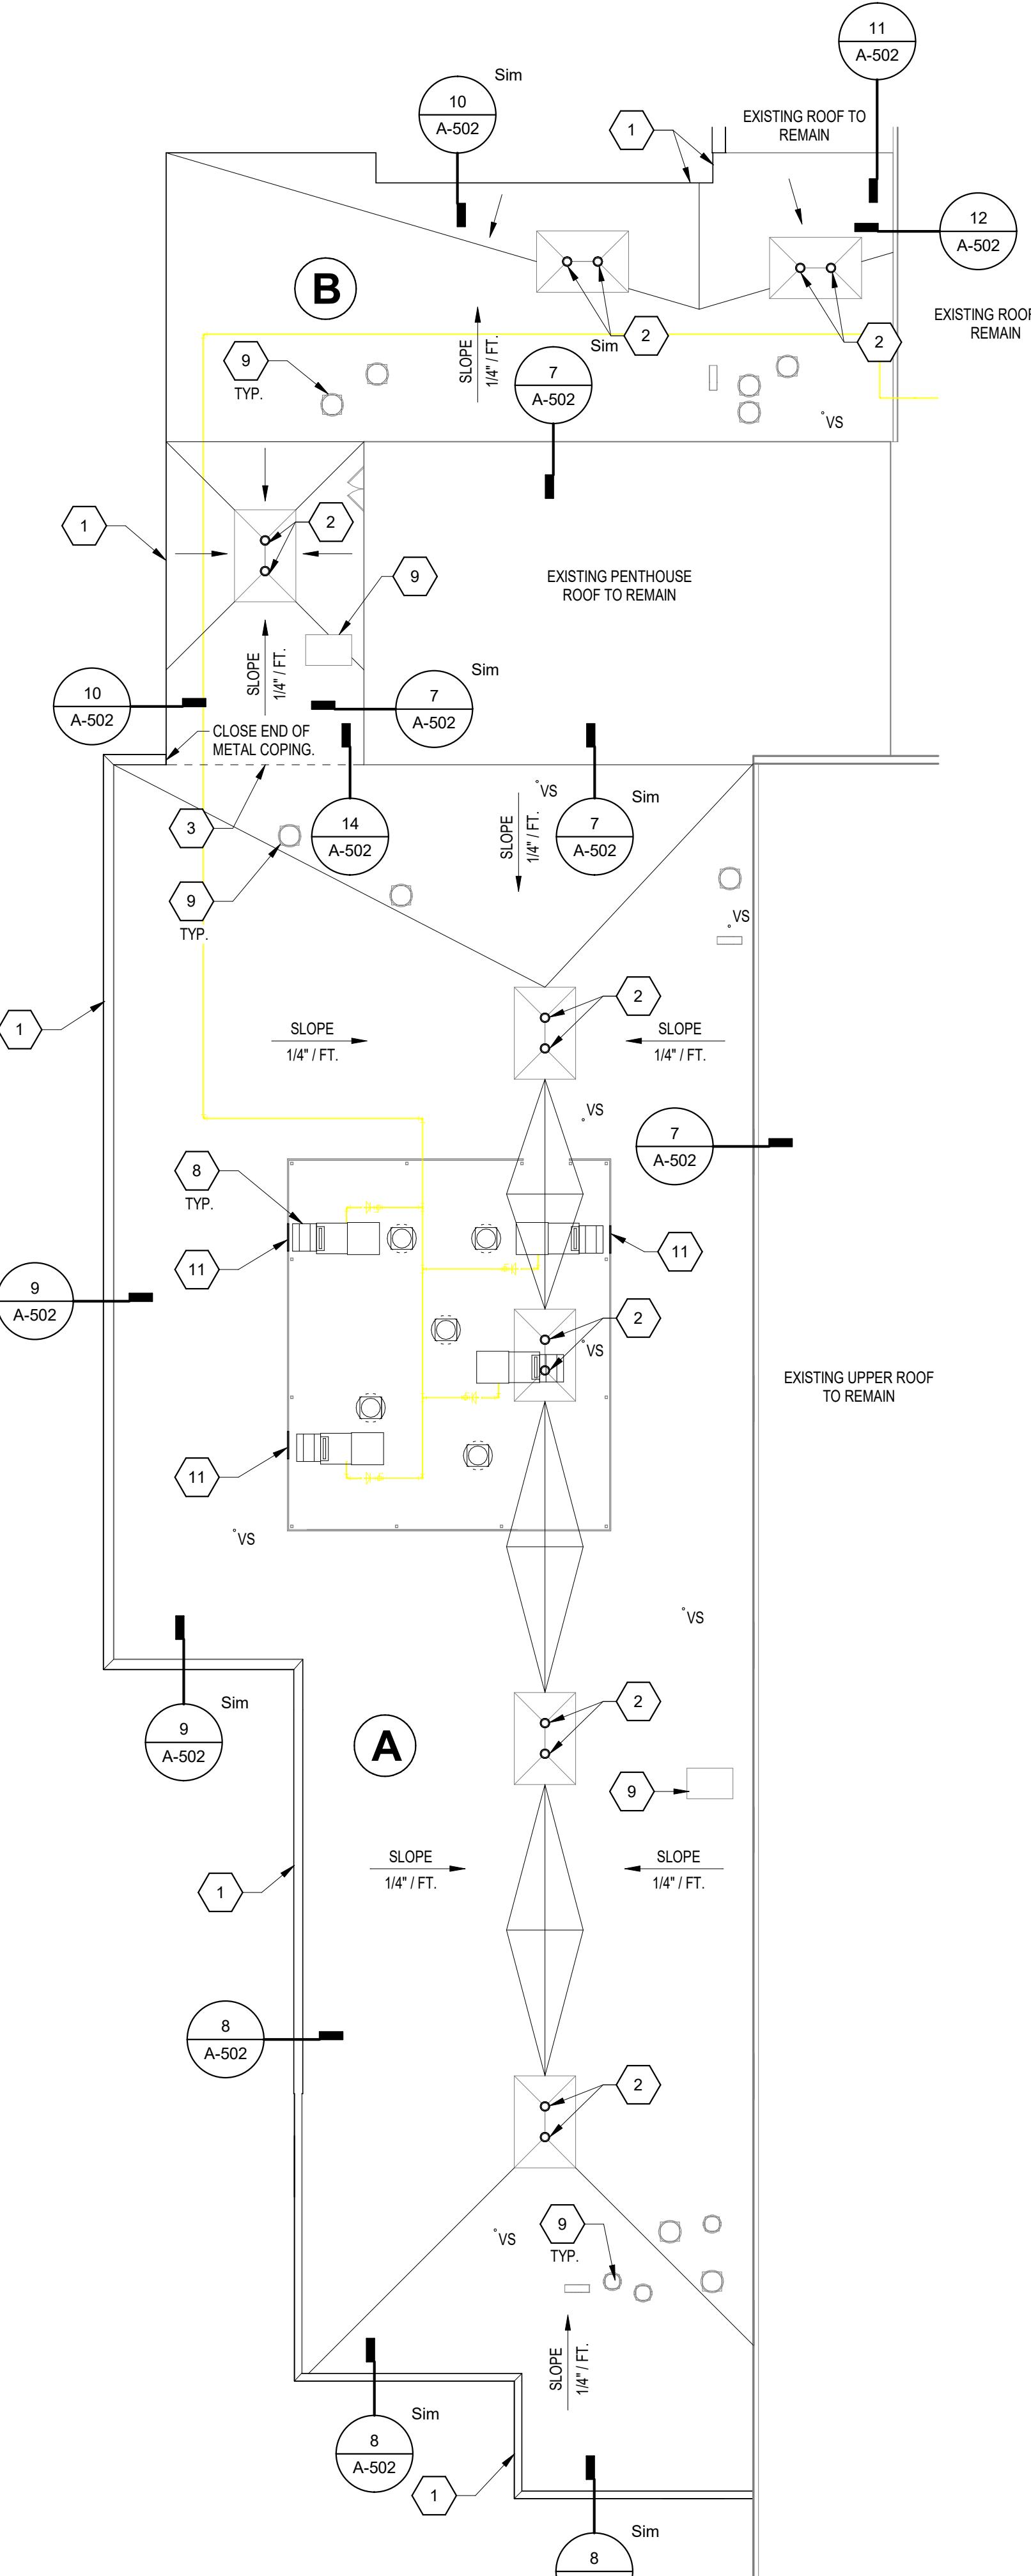

1 ROOF PLAN - KITCHEN

SCALE: 1/16" = 1'-0"

VERIFICATION NOTE
CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CLEARANCES AND FIELD CONDITIONS BEFORE STARTING CONSTRUCTION. COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE OF CONDITIONS.
SHOULD DIFFERENT CONDITIONS BE ENCOUNTERED, CONTACT THE ARCHITECT BEFORE PROCEEDING WITH WORK.

ROOF PLAN - KITCHEN
A-104

2026 CARMEL HIGH SCHOOL IMPROVEMENT PROJECTS

520 EAST MAIN STREET
CARMEL, IN 46032


CARMEL CLAY SCHOOLS

5201 EAST MAIN STREET
CARMEL, IN 46033
317-844-9961




FANNING HOWEY

317-848-0966 WWW.FHAI.COM
350 E. NEW YORK ST. SUITE 300, INDIANAPOLIS, IN 46204

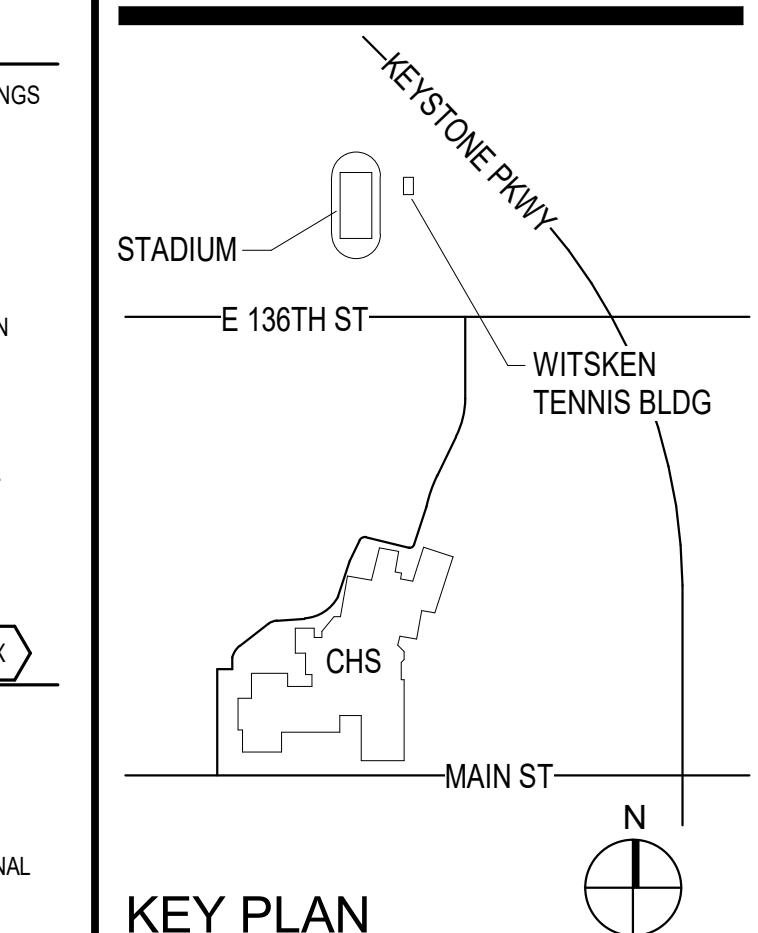

100% CONSTRUCTION DOCUMENTS

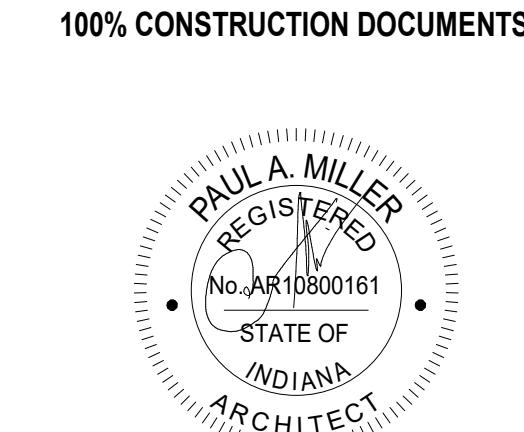

DRAWN BY: DSR
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025

REV. NO.	DESCRIPTION	DATE
1	ADDENDUM #2	01/23/2026

FIRST FLOOR ARCHITECTURAL PLAN - TENNIS BUILDING

A-106

ARCHITECTURAL PLAN GENERAL NOTES

- A. ALL CMU WALLS THAT DO NOT LAY OUT IN FULL OR HALF LENGTHS SHOULD BE BALANCED SO AS NOT TO HAVE ANY PIECES LESS THAN 4" IN SIZE EXPOSED TO VIEW.
- B. WHERE DISSIMILAR FLOOR MATERIALS MEET, THEY SHALL BE FINISHED TO THE CENTERLINE OF THE DOOR, UNLESS NOTED OTHERWISE.
- C. THERE SHALL BE PERIMETER INSULATION CONTINUOUS AROUND THE ENTIRE PERIMETER OF THE BUILDING EXCLUDING DOORS, WINDOWS, AND ROOF JOISTS.
- D. THE BASE FLOOR ELEVATION INDICATED FOR THE PROJECT IS 100'-0". REFER TO SITE PLAN FOR CORRELATION TO USGS DATUM.
- E. ALL EXPOSED CONCRETE JOINTS THAT RUN TO UNDERSIDE OF DECK ABOVE SHALL HAVE A 2" JOINT (UNGROUTED) AT THE DECK TO BE FILLED WITH FIRE STOPPING AT RATED WALLS PER PROJECT MANUAL, AND MINERAL WOOL AT THE NON-RATED WALLS. REFER TO SITE PLAN FOR CONSTRUCTION JOINT DETAILS.
- F. PROVIDE METAL CONCRETE JOINTS FOR EXPANSION AND CONSTRUCTION MOVEMENT JOINTS. DETAILS REFER TO DETAILS ON SHEET F-1.
- G. ALL DIMENSIONS ON FLOOR PLANS ARE TO FINISH FACE OF CONCRETE, EXCEPT FOR FINISH FACE OF CMU AT METAL STUD WALLS, UNLESS NOTED OTHERWISE. EXCEPTION: EXTERIOR METAL STUD WALLS ARE TO FACE OF METAL STUD.
- H. METAL STUD CORNERS AT WALLS WILL TYPICALLY BE LOCATED 4' MINIMUM FROM ADJACENT WALL, UNLESS NOTED OTHERWISE.
- I. ALL EXPOSED CONCRETE MASONRY UNITS (CMU) ARE REQUIRED TO BE BULLNOSE, EXCEPT AT WINDOW JAMPS, BULKHEADS, WINDOW AND DOOR HEADS. SEE REFLECTED CEILING PLANS FOR BULKHEAD LOCATIONS AND DETAIL REFERENCES.
- K. PROVIDE FINISH SCHEDULES OR PLAN AND EQUIPMENT PLANS FOR LOCATION AND EXTENT OF FINISH FLOOR MATERIALS.
- L. PROVIDE WOOD BLOCKS AS REQUIRED WITHIN METAL STUD WALLS FOR ALLOWED MOISTURE ITEMS. REFER TO MASTERCODE PLANS FOR CODE INFORMATION AND FIRE RATED WALL LOCATIONS.
- M. PROVIDE SPRAY FOAM INSULATION AND THERMAL BARRIER CONTINUOUS AT INTERSECTION OF EXTERIOR WALLS AND DECK.

ARCHITECTURAL PLAN NOTES
(ALL NOTES MAY NOT BE INDICATED ON THIS SHEET)

NO.	DESCRIPTION
1	REMOVE AND REPLACE GYP. BOARD, FINISH FLUSH WITH EXISTING TO SHOW NO EVIDENCE OF CONSTRUCTION.
2	METAL SOFFIT SYSTEM.
3	NAPKIN HANGER MOUNT WITH CONTROLS AT 40° A.F.F. SEE SPECIFICATIONS.
4	EXISTING EXHAUST GRILLE TO BE REMOVED AND DISPOSED OF OFF SITE. INSTALL NEW EXHAUST GRILLE SIMILAR TO TITUS 355-FL 12"x6" SIZE. CONNECT TO EXISTING DUCT.
5	PREPARE AND PAINT EXISTING OVERHEAD COILING DOOR AND STEEL FRAME.
6	PROVIDE FLAT ALUMINUM BRAKE METAL TRIM WITH HEMMED EDGE AROUND EXISTING PACKAGED TERMINAL AIR CONDITIONING (PTAC) UNIT APPROX. 2"V. MIN. 0.040" THICK. TRIM TO EXISTING PTAC UNIT. ADHERE TO EXISTING SUBSTRATE. PAINT TO MATCH WALL FINISH.

ELEVATIONS GENERAL NOTES

- A. REFER TO THE ELECTRICAL AND TECHNOLOGY DRAWINGS FOR CAMERA LOCATIONS, SECURITY DEVICES, RECEPTACLES, LIGHT FIXTURES, ETC. COORDINATE LOCATIONS WITH VENEER COURSING TO PROVIDE COORDINATE PENETRATION.
- B. REFER TO PLUMBING DRAWINGS FOR EXTERIOR WALL HYDRANTS, SECONDARY ROOM OUTLETS, ETC. COORDINATE PENETRATION THROUGH EXTERIOR ENVELOPES. REFER TO ROOFING DRAWINGS FOR EXTERIOR MEMBRANE TO MAINTAIN AIR BARRIER SYSTEM.
- C. REFER TO MECHANICAL DRAWINGS FOR EXTERIOR LOUVER LOCATIONS LOCATED IN EXTERIOR WALL AND EXTERIOR ENVELOPES. REFER TO ROOFING DRAWINGS THROUGH EXTERIOR ENVELOPES WITH OTHER TRADES. PROVIDE TRANSITION MEMBRANE TO MAINTAIN AIR BARRIER SYSTEM.

BUILDING ELEVATION NOTES
(ALL NOTES MAY NOT BE INDICATED ON THIS SHEET)

NO.	DESCRIPTION
1	ASPHALT SHINGLE ROOF. SEE ROOF PLAN FOR ADDITIONAL INFORMATION.
2	METAL GUTTER SYSTEM.
3	METAL DOWNSPOUT WITH WIRE STRAINER. RE-CONNECT TO UNDERGROUND STORM PIPING (WHERE APPLICABLE). PRE-FINISHED METAL FASCIA.
5	CLEAR CASTING BRICK VENEER. SEE SPECIFICATIONS. REMOVE AND SALVAGE EXISTING LETTERING AS REQUIRED FOR BRICK CLEANING. RE-INSTALL IN SAME LOCATION.
6	CLEAR CASTING BRICK VENEER. SEE SPECIFICATIONS. REMOVE AND SALVAGE EXISTING LETTERING AS REQUIRED FOR BRICK CLEANING. RE-INSTALL IN SAME LOCATION.

DRAWN BY: DSR
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025



REV. NO.	DESCRIPTION	DATE
1	ADDENDUM #2	01/23/2026

VERIFICATION NOTE

CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CLEARANCES AND ALL EXISTING FIELD CONDITIONS BEFORE STARTING CONSTRUCTION. COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE OF CONDITIONS.

SHOULD DIFFERENT CONDITIONS BE ENCOUNTERED, CONTACT THE ARCHITECT BEFORE PROCEEDING WITH WORK.

FIRST FLOOR ARCHITECTURAL PLAN - TENNIS BUILDING
A-106

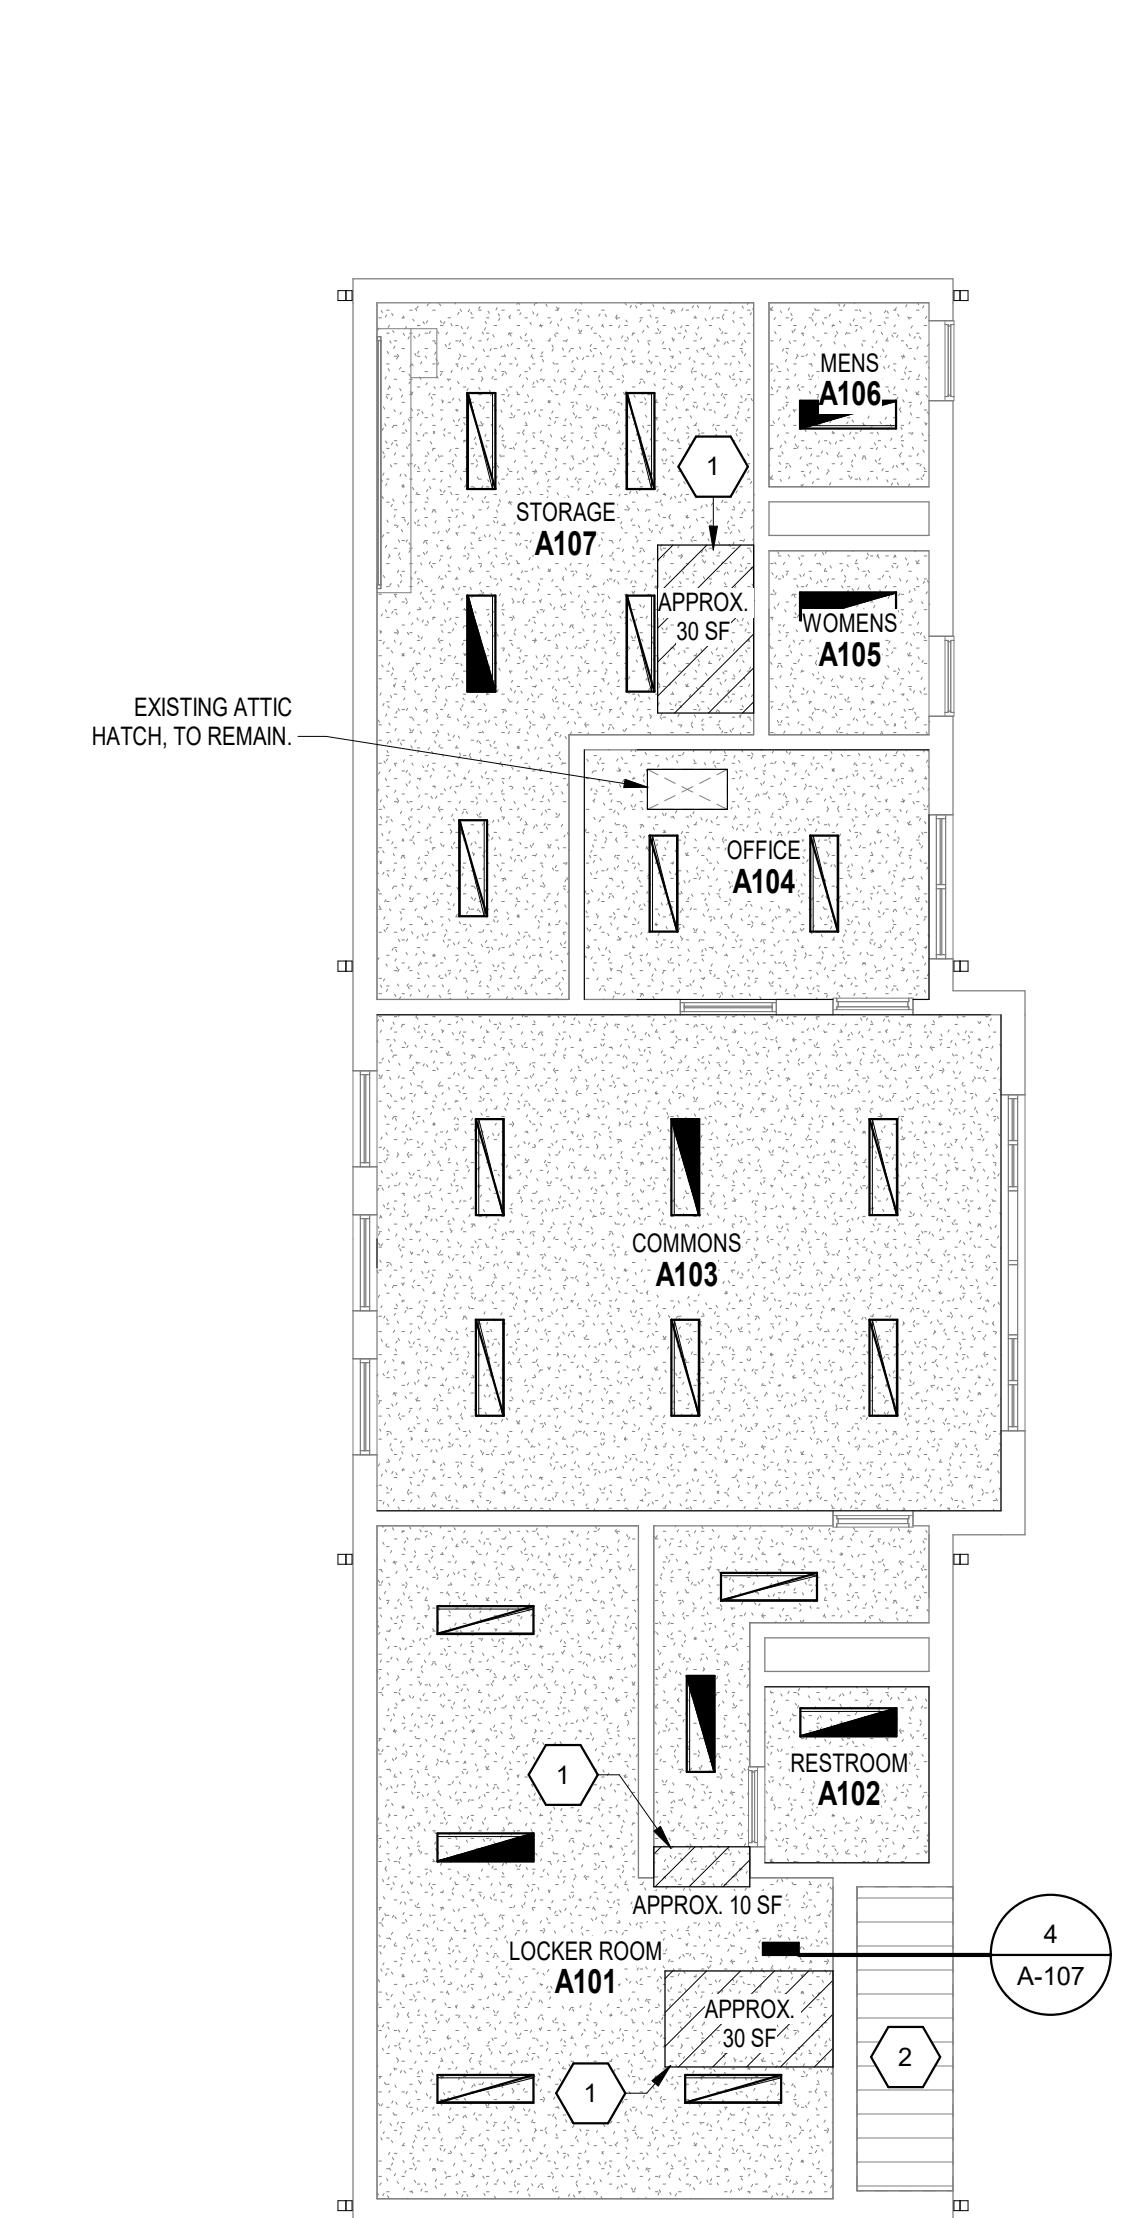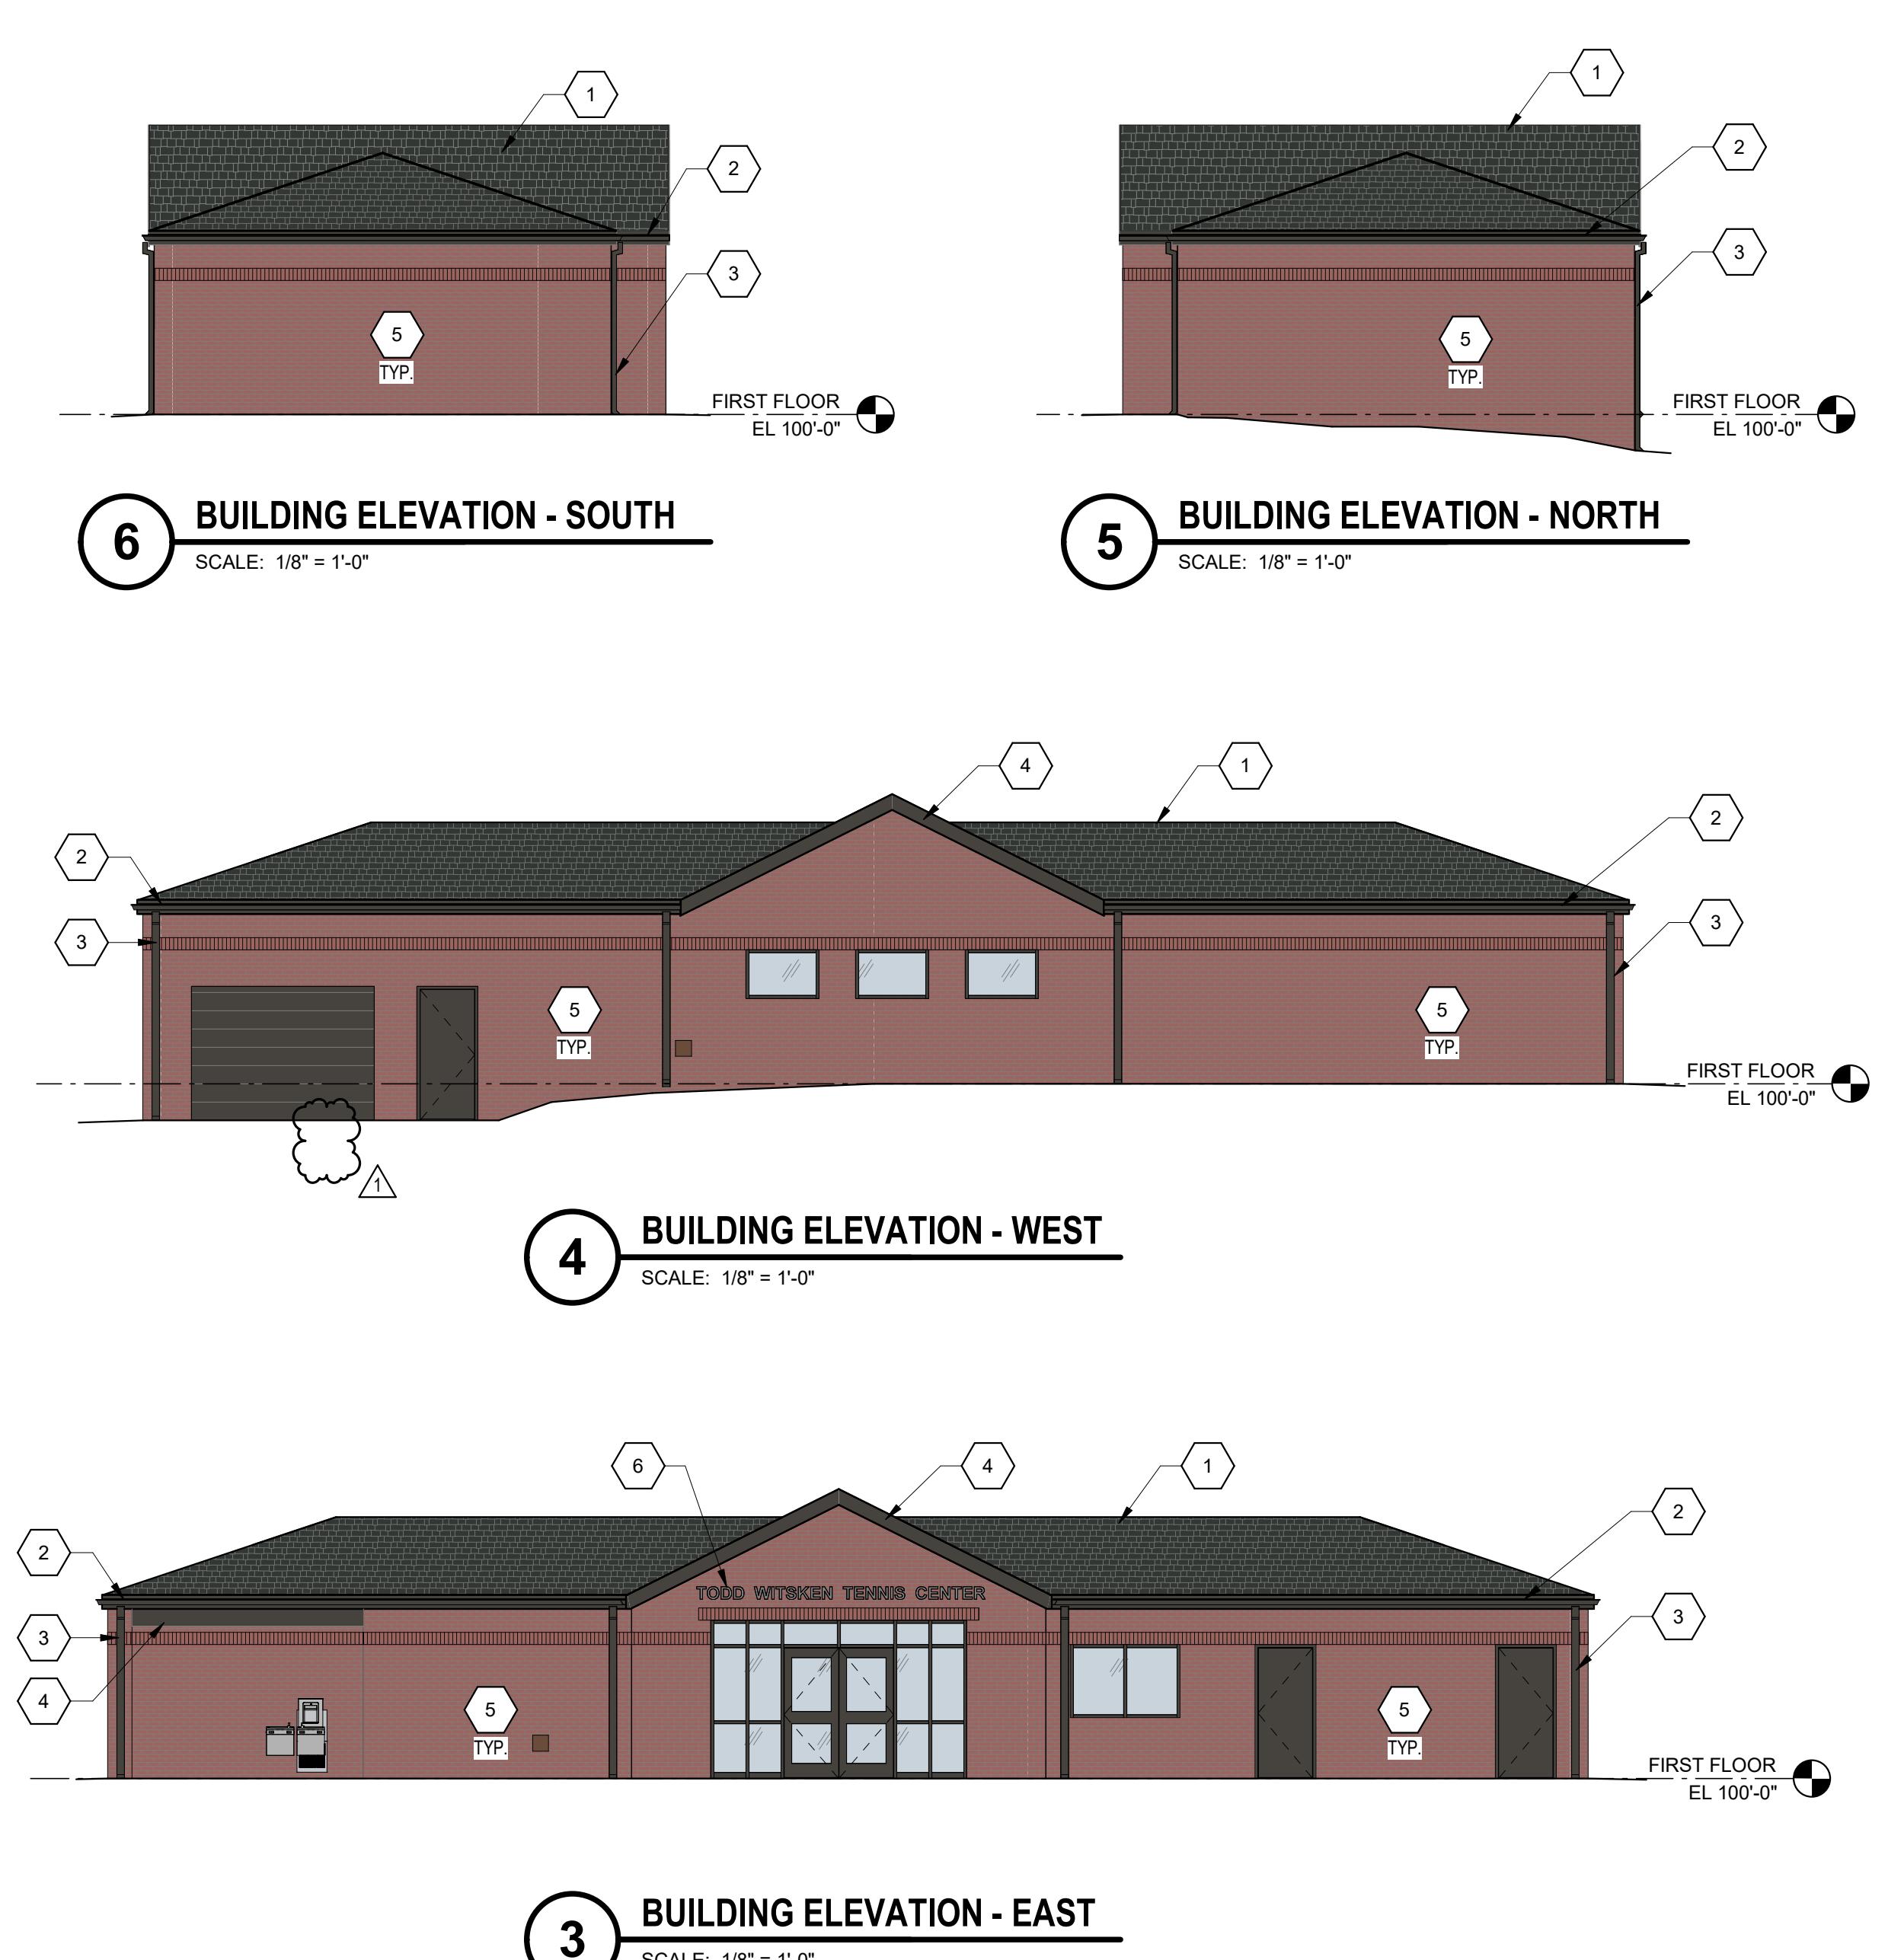

FIRST FLOOR ARCHITECTURAL PLAN - TENNIS BUILDING
A-106

2026 CARMEL HIGH SCHOOL IMPROVEMENT PROJECTS

520 EAST MAIN STREET
CARMEL, IN 46032


CARMEL CLAY SCHOOLS
5201 EAST MAIN STREET
CARMEL, IN 46033
317-844-9961



FANNING
HOWEY

317-848-0966 WWW.FHAI.COM

350 E. NEW YORK ST. SUITE 300, INDIANAPOLIS, IN 46204

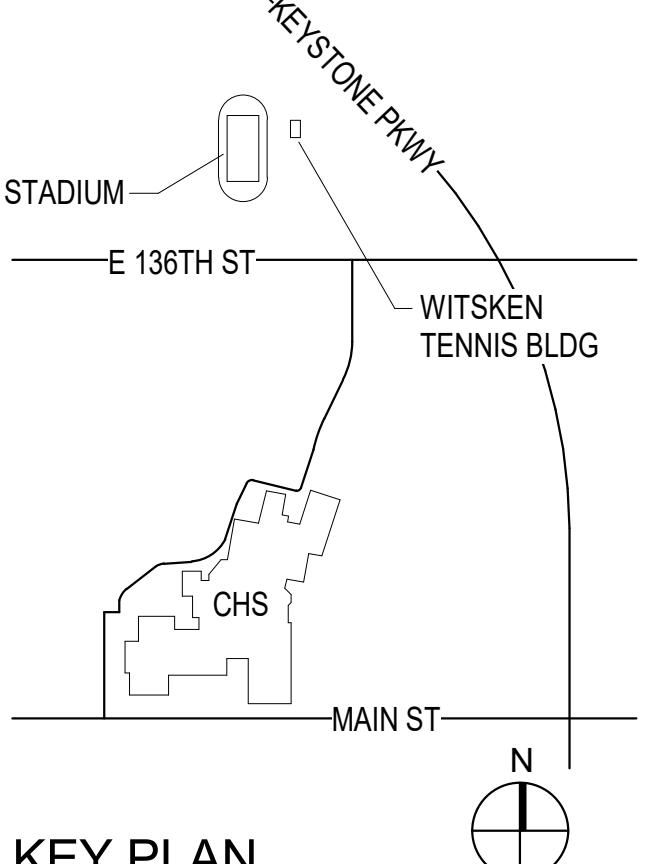

KEY PLAN

100% CONSTRUCTION DOCUMENTS



DRAWN BY: HRS
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025

REV. NO. DESCRIPTION DATE

1 ADDENDUM #2 01/23/2026

GENERAL FINISH NOTES

- A. FIXED CASEWORK AND TACKBOARDS SHALL REMAIN IN PLACE UNLESS NEW WALL FINISHES SHALL BE INSTALLED AROUND THESE ITEMS.
- B. SEALANT SHALL BE APPLIED AT ALL MATERIAL TRANSITION BACKSPASHES, AND DOOR FRAME ALL LOCATIONS WHERE NEW FINISH ABUTS A DISIMILAR MATERIAL.
- C. REMOVE AND REINSTALL EXISTING DEVICE FACADES, SWITCH FACEPLATES, TECHNOLOGY FACEPLATES, AND OUTLET COVERS.
- D. EXISTING ITEMS TO REMAIN AND NEW FINISHES APPLIED AROUND INCLUDE BUT NOT LIMITED TO THERMOSTATS, AND FIRE EXTINGUISHER CABINETS UNLESS OTHERWISE SPECIFIED.
- E. REMOVE AND REINSTALL EXISTING FLOOR FINISHES BETWEEN NEW FLOOR FINISH AND EXISTING FLOOR FINISH.
- F. PROVIDE NEW RESILIENT STRIPS AT EXPOSED EDGE OF NEW FLOOR FINISH TO EXISTING FLOOR FINISH.
- G. PAINT ALL FLOOR SURFACES (VERT. AND HORIZ.) OF BULKHEADS/OFFICE COLOR MATCHING EXISTING.
- H. EXISTING INTERIOR DOOR FRAMES ARE TO REMAIN.
- I. PAINT ALL INTERIOR HOLLOW METAL DOOR FRAMES AND INTRALITES (VERT. AND HORIZ.) AS NOTED ON LIST OF FINISHES.
- J. PATCH AND REPAIR ALL HOLES AND IMPERFECTIONS, TO RECEIVE NEW FINISHES.

FLOOR PATTERN/FINISH KEY NOTES

(ALL NOTES MAY NOT BE INDICATED ON THIS SHEET)

NO. DESCRIPTION


- 1 PROVIDE NEW SOLID SURFACE WINDOW SILL ON EXISTING WINDOW, SS-2. REFER TO LIST OF FINISHES AND 2A-702 FOR MORE INFORMATION.
- 2 BASE FILLER PANEL TO EXTEND TO BACK WALL TO CONCEAL CHASE, PL-1.
- 3 PROVIDE PLASTIC RIBBED PLASTIC ACCENT BANDS AROUND LOCKERS AROUND PERIMETER OF ROOM IN EXISTING LOCATION AFTER CONSTRUCTION.
- 4 EXISTING EQUIPMENT TO REMAIN, REINSTALL ALL EXISTING EQUIPMENT IN EXISTING LOCATION.
- 5 EXISTING WALL MOUNTED SHELVES TO REINSTALL AFTER CONSTRUCTION IN EXISTING LOCATION.
- 6 PAINT INTERIOR WINDOW FRAME P-2 ON BOTH SIDES TO MATCH DOOR FRAMES. REFER TO LIST OF FINISHES FOR MORE INFORMATION.
- 7 PAINT FLOOR SURFACES AND/OR WALL SURFACES IN THIS ROOM TO MATCH METAL TRANSITION TO REMAIN IF APPLICABLE. PROVIDE TILE RESTORATION, PER SPECIFICATIONS, CLEAN WALLS AND FLOOR, RESEAL ALL TILE, RESEAL ALL WALL AND FLOOR TILE GROUT WHEREVER SMALL AREAS OF GROUT ARE MISSING ON WALLS AND FLOOR. PROVIDE NEW GROUT TO MATCH EXISTING. RESEAL ALL EXISTING FLOOR OR BASE TILE WITH NEW TO MATCH EXISTING. REFER TO LIST OF FINISHES FOR TILE SELECTIONS.
- 8 OWNER PROVIDED 160 METAL SHELF, EXISTING SHELF IS TO REMAIN.
- 9 OWNER PROVIDED METAL SHELVING UNIT, 24'D x 36'W x 84'H.
- 10 NO INTERIORS WORK IN THIS ROOM.
- 11 PROVIDE IFS CEILING TO SHOWER ENCLOSURE.
- 12 PROVIDE TILE RESTORATION, PER SPECIFICATIONS, CLEAN ALL TILE, RESEAL ALL TILE AND GROUT. RESEAL ALL TILE GROUT WHERE SMALL AREAS OF GROUT ARE MISSING ON LOCKER BENCHES, PROVIDE NEW GROUT TO MATCH EXISTING. REPLACE DAMAGED TILE WITH NEW TO MATCH EXISTING. REFER TO LIST OF FINISHES FOR TILE SELECTIONS.
- 13 PAINT EXPOSED CONCRETE COLUMN P-1 AS INDICATED ON PLAN.
- 14 EXPOSED CONCRETE COLUMNS AND UNDERSIDE OF CONCRETE BLEACHERS TO BE PAINTED WITH INTERIOR PAINT TYPE #3.110 UP TO 10'-0" WITH PAINT TYPE #3.111 ABOVE.

INTERIOR ELEVATION KEY NOTES

(ALL NOTES MAY NOT BE INDICATED ON THIS SHEET)

NO. DESCRIPTION


- 1 PROVIDE NEW SOLID SURFACE WINDOW SILL ON EXISTING WINDOW, SS-2. REFER TO LIST OF FINISHES AND 2A-702 FOR MORE INFORMATION.

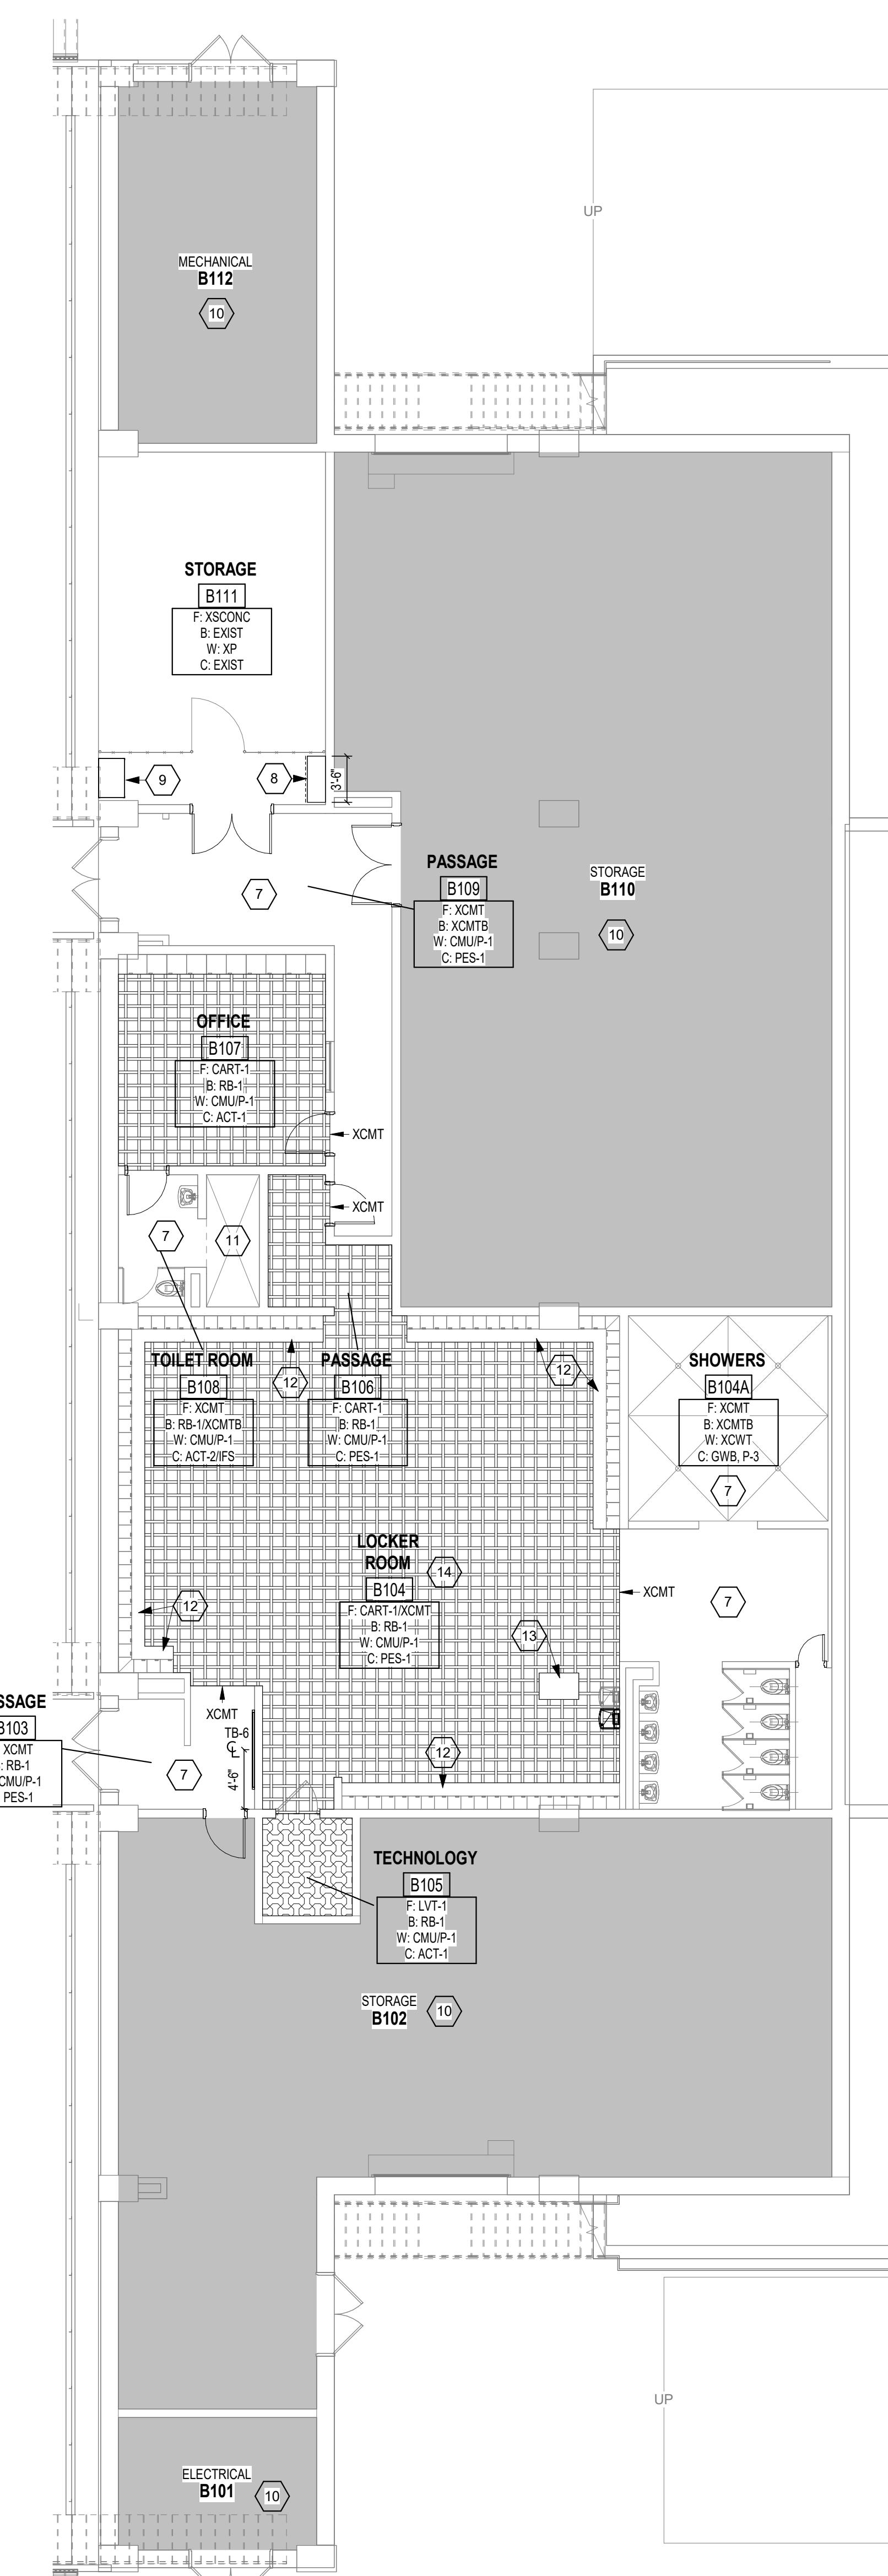


3 FIRST FLOOR INTERIORS PLAN - VISITOR BLDG
SCALE: 1/8" = 1'-0"

ROOM NO.	OWNER ROOM NO.	ROOM NAME	AREA (SF)
A101		LOCKER ROOM	503 SF
A102		RESTROOM	50 SF
A103		COMMONS	537 SF
A104		OFFICE	149 SF
A105		WOMENS	91 SF
A106		MENS	51 SF
A107		STORAGE	371 SF
B101		ELECTRICAL	149 SF
B102		STORAGE	1,654 SF
B103		PASSAGE	89 SF
B104		LOCKER ROOM	1,577 SF
B105		TECHNOLOGY	50 SF
B106		PASSAGE	70 SF
B107		OFFICE	250 SF
B108		TOILET ROOM	69 SF
B109		PASSAGE	208 SF
B110		STORAGE	2,224 SF
B111		STORAGE	456 SF
B112		MECHANICAL	408 SF
B201		WOMENS RESTROOM	440 SF
B202		MENS RESTROOM	362 SF


CASEWORK SCHEDULE						
TYPE	MARK	SIZE	D	W	H	DESCRIPTION
B	141	2'-0"	3'-0"	2'-10"	2'-10"	BASE UNIT WITH ONE DRAWER, ONE ADJUSTABLE SHELF AND TWO HINGED DOORS.
BS	73	2'-0"	3'-0"	2'-10"	2'-10"	SINK BASE UNIT WITH TWO HINGED DOORS AND ONE BLANK DRAWER PANEL

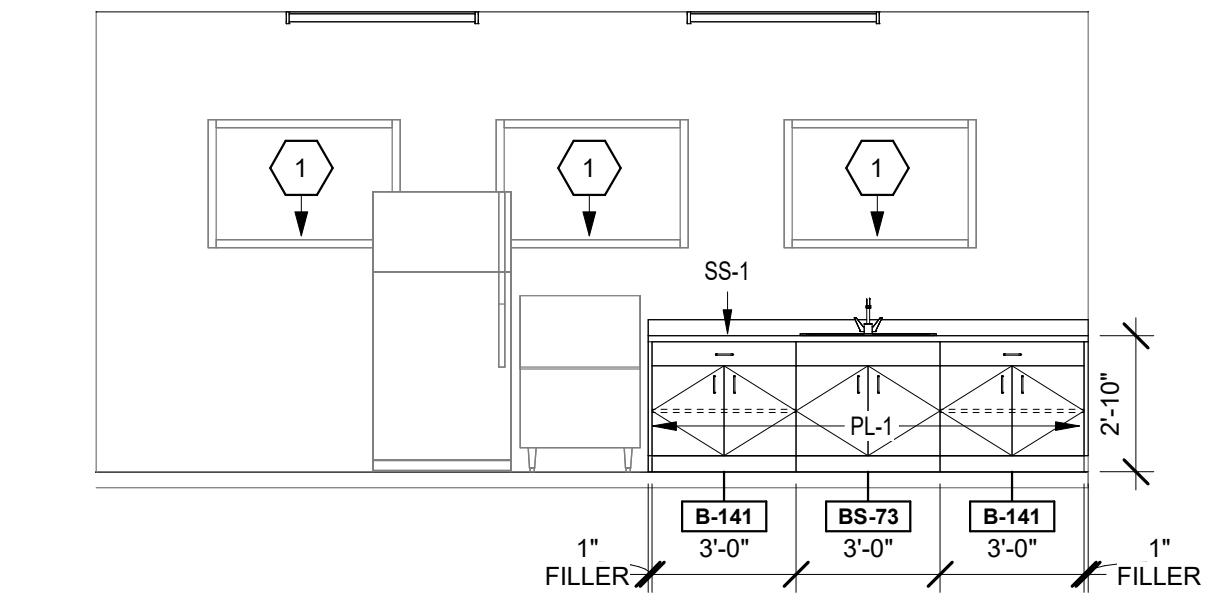

2 A103 CASEWORK ELEVATION - WEST
SCALE: 1/4" = 1'-0"

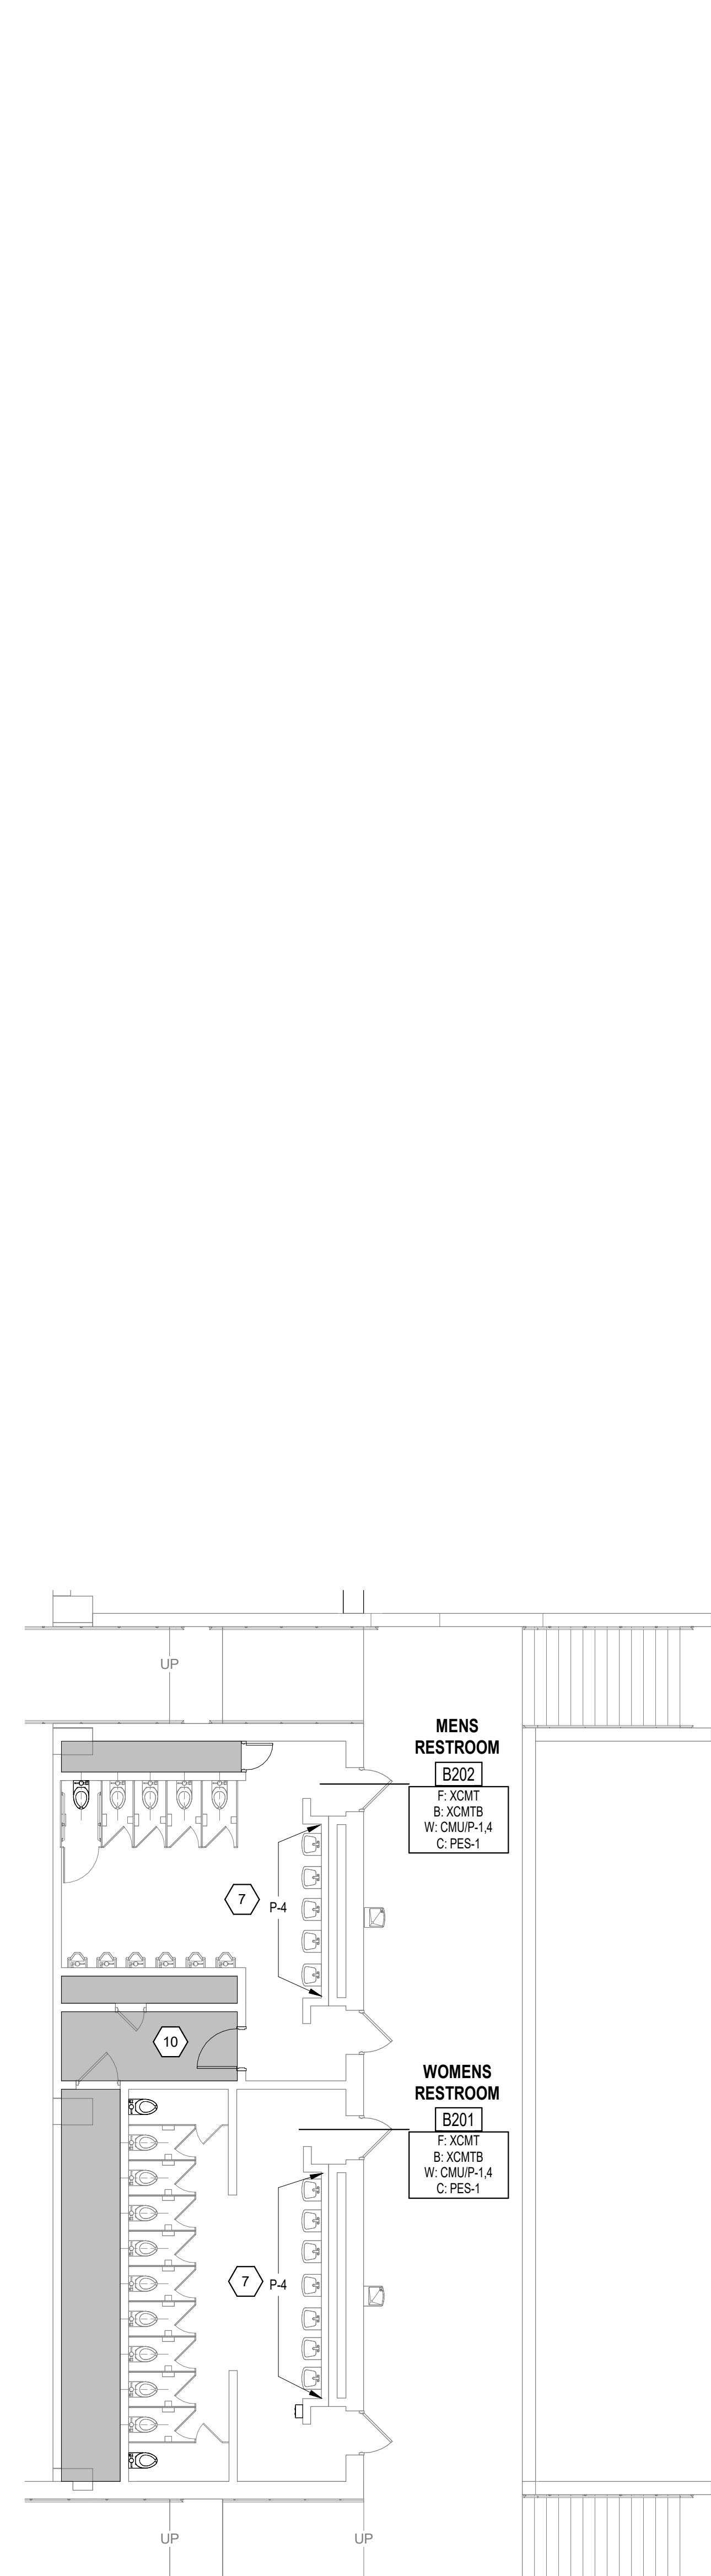

4 SECOND FLOOR INTERIORS PLAN - VISITOR BLDG
SCALE: 1/8" = 1'-0"

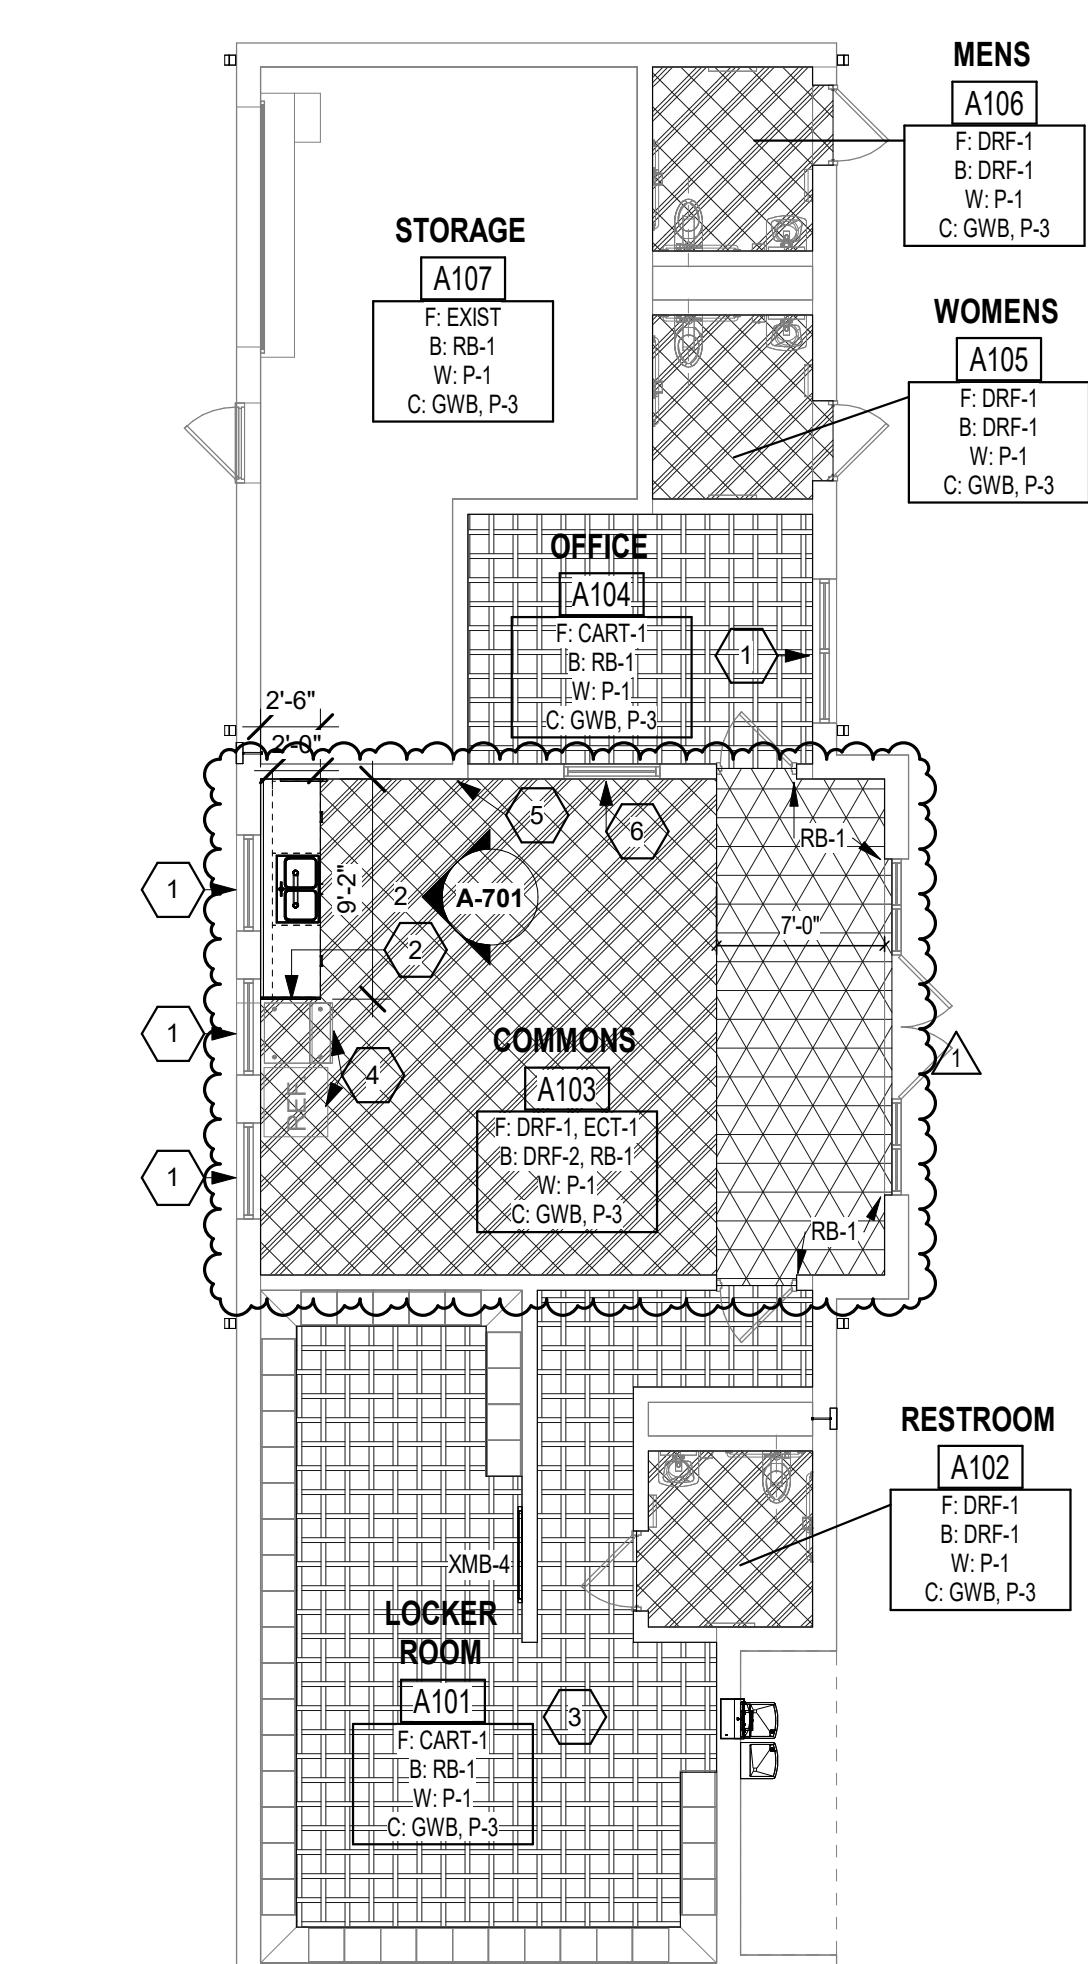

1 FIRST FLOOR INTERIORS PLAN - TENNIS BUILDING
SCALE: 1/8" = 1'-0"

CONTRACTOR'S NOTES
CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CLEARANCES AND ALL EXISTING FIELD CONDITIONS BEFORE STARTING CONSTRUCTION. COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE OF CONDITIONS.
SHOULD DIFFERENT CONDITIONS BE ENCOUNTERED, CONTACT THE ARCHITECT BEFORE PROCEEDING WITH WORK.

INTERIOR PLAN & DETAILS


A-701

2026 CARMEL HIGH SCHOOL IMPROVEMENT PROJECTS

520 EAST MAIN STREET
CARMEL, IN 46032CARMEL CLAY SCHOOLS
5201 EAST MAIN STREET
CARMEL, IN 46033
317-844-9961

ARCHITECT

FANNING HOWEY

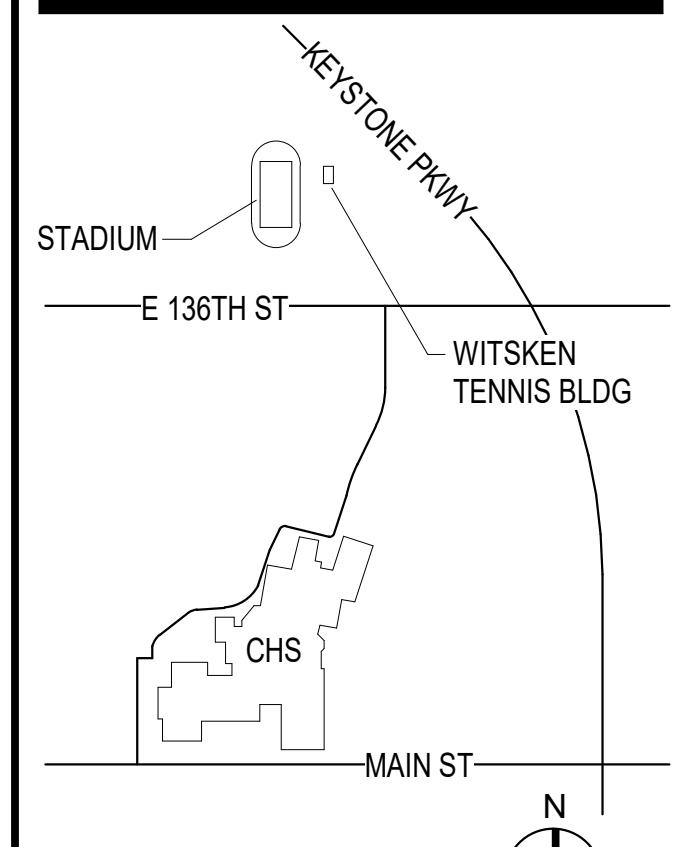317-848-0966 WWW.FHAI.COM
350 E. NEW YORK ST. SUITE 300, INDIANAPOLIS, IN 46204KEY PLAN
100% CONSTRUCTION DOCUMENTSDRAWN BY: HRS
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025REV. NO. DESCRIPTION DATE
1 ADDENDUM #2 01/23/2026

LIST OF FINISHES, TRANSITIONS & DETAILS

A-702

LIST OF FINISHES

FLOOR MATERIALS

CARPET TILE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
CART-1 (KINETEX)	J+J / KINETEX / CATALYST	MOLECULE 1841-2844 (24"X24")
<ul style="list-style-type: none"> ALL CARPET BACKING TO HAVE A MOISTURE RESISTANT BARRIER. INSTALLATION METHOD TO BE MONOLITHIC/UNIDIRECTIONAL, UNLESS NOTED OTHERWISE. SUBMIT INSTALLATION DRAWINGS INDICATING LAYOUT OF CARPET TILE PRIOR TO INSTALLATION FOR APPROVAL. 		

CERAMIC MOSAIC TILE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
CMT-1 (FIELD)	DALTILE / KEYSTONES	DESERT GRAY (2X2)
<ul style="list-style-type: none"> REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION. COORDINATE COLOR SELECTION/VERIFICATION WITH ARCHITECT. MANUFACTURER TO SUBMIT ACTUAL PRODUCT SAMPLES AFTER SELECTION OF ALL CMT COLORS FOR VERIFICATION AND APPROVAL. 		

DECORATIVE RESINOUS FLOORING

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
DRF-1	TNEMEC	N222021040SCN284-0000
<ul style="list-style-type: none"> REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION. COORDINATE COLOR SELECTION/VERIFICATION WITH ARCHITECT. MANUFACTURER TO SUBMIT ACTUAL PRODUCT SAMPLES AFTER SELECTION OF ALL DRF COLORS FOR VERIFICATION AND APPROVAL. 		

ENTRANCE CARPET TILE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
ECT-1	INTERFACE / SR899	104931 GRANITE

LUXURY VINYL TILE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
LVT-1	MANNINGTON / AMTICO SIGNATURE	STRIA ROCK AR05MS33 (18"X18")
<ul style="list-style-type: none"> INSTALLATION METHOD TO BE MONOLITHIC. 		

BASE MATERIALS

CERAMIC MOSAIC TILE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
CMTB-1	DALTILE KEYSTONES	DESERT GRAY (2X2)
<ul style="list-style-type: none"> REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION. COORDINATE COLOR SELECTION/VERIFICATION WITH ARCHITECT. MANUFACTURER TO SUBMIT ACTUAL PRODUCT SAMPLES AFTER SELECTION OF ALL DRF COLORS FOR VERIFICATION AND APPROVAL. 		

DECORATIVE RESINOUS FLOORING

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
DRF-1 (6")	TNEMEC	N222021040SCN284-0000
DRF-2 (4")	TNEMEC	N222021040SCN284-0000
<ul style="list-style-type: none"> REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION. COORDINATE COLOR SELECTION/VERIFICATION WITH ARCHITECT. MANUFACTURER TO SUBMIT ACTUAL PRODUCT SAMPLES AFTER SELECTION OF ALL DRF COLORS FOR VERIFICATION AND APPROVAL. 		

RESILIENT BASE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
RB-1	JOHNSONITE / ROPPE	63 BURNT UMBER

WALL FINISHES

CERAMIC WALL TILE

MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
CWT-1	DALTILE / COLOR WHEEL CLASSICS	ARCTIC WHITE (4X4 GLOSSY)

PAINT







MATERIAL ABBREVIATION	MATERIAL/MANUFACTURER	COLOR SELECTION
P-1 (FIELD)	SHERWIN WILLIAMS	DRIFT OF MIST SW9166
P-2 (DOORFRAMES)	SHERWIN WILLIAMS	IRON ORE SW7059
P-3 (CEILINGS)	SHERWIN WILLIAMS	PURE WHITE SW7005
P-4 (RESTROOMS)	PPG PAINTS	TBD

2 WINDOW SILL DETAIL

SCALE: 1 1/2" = 1'-0"

1 CASEWORK DETAIL

SCALE: 1/2" = 1'-0"

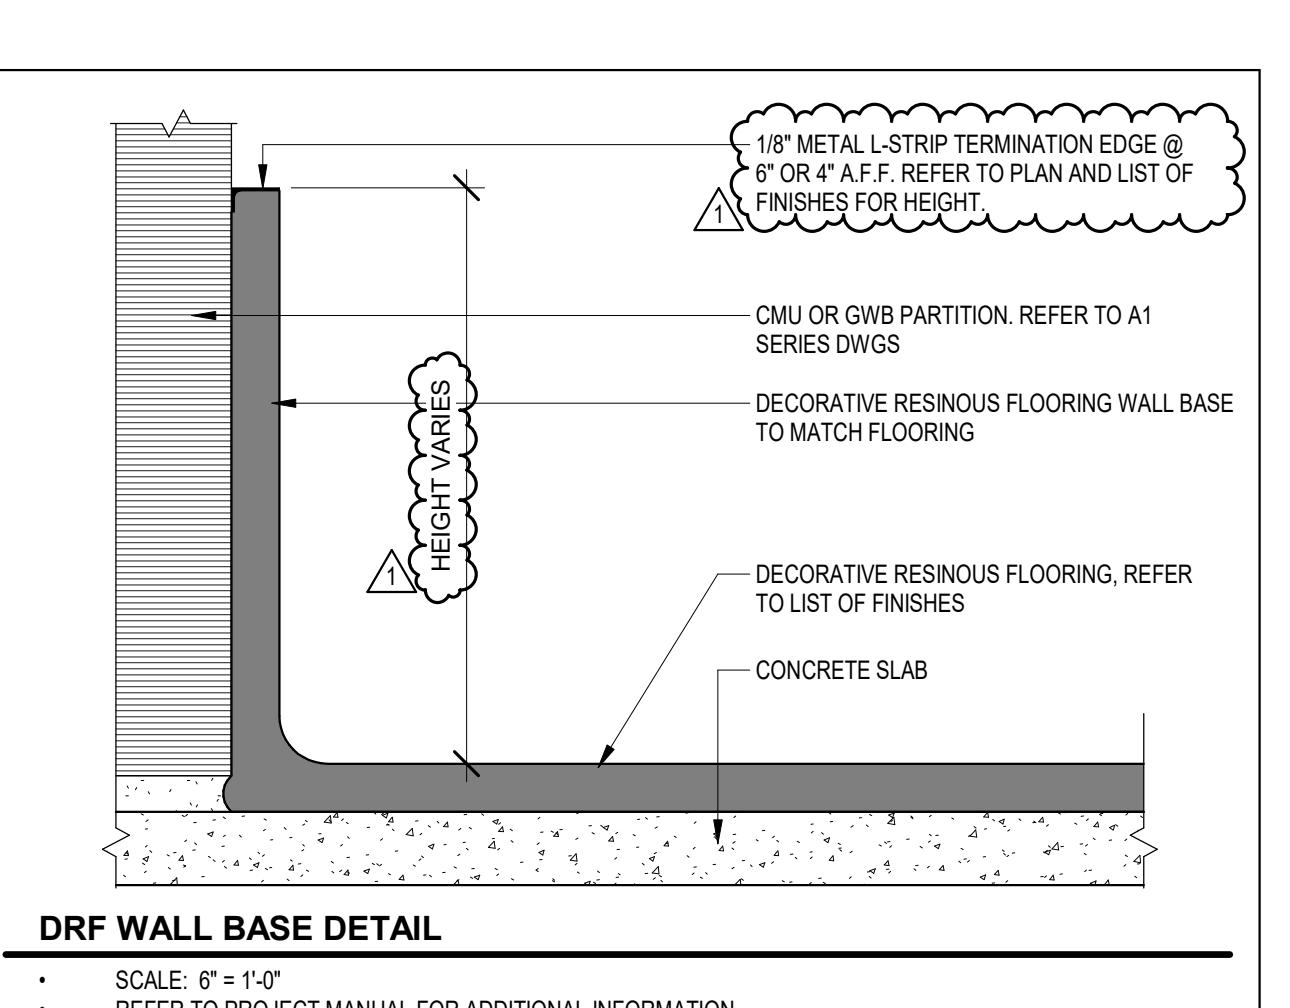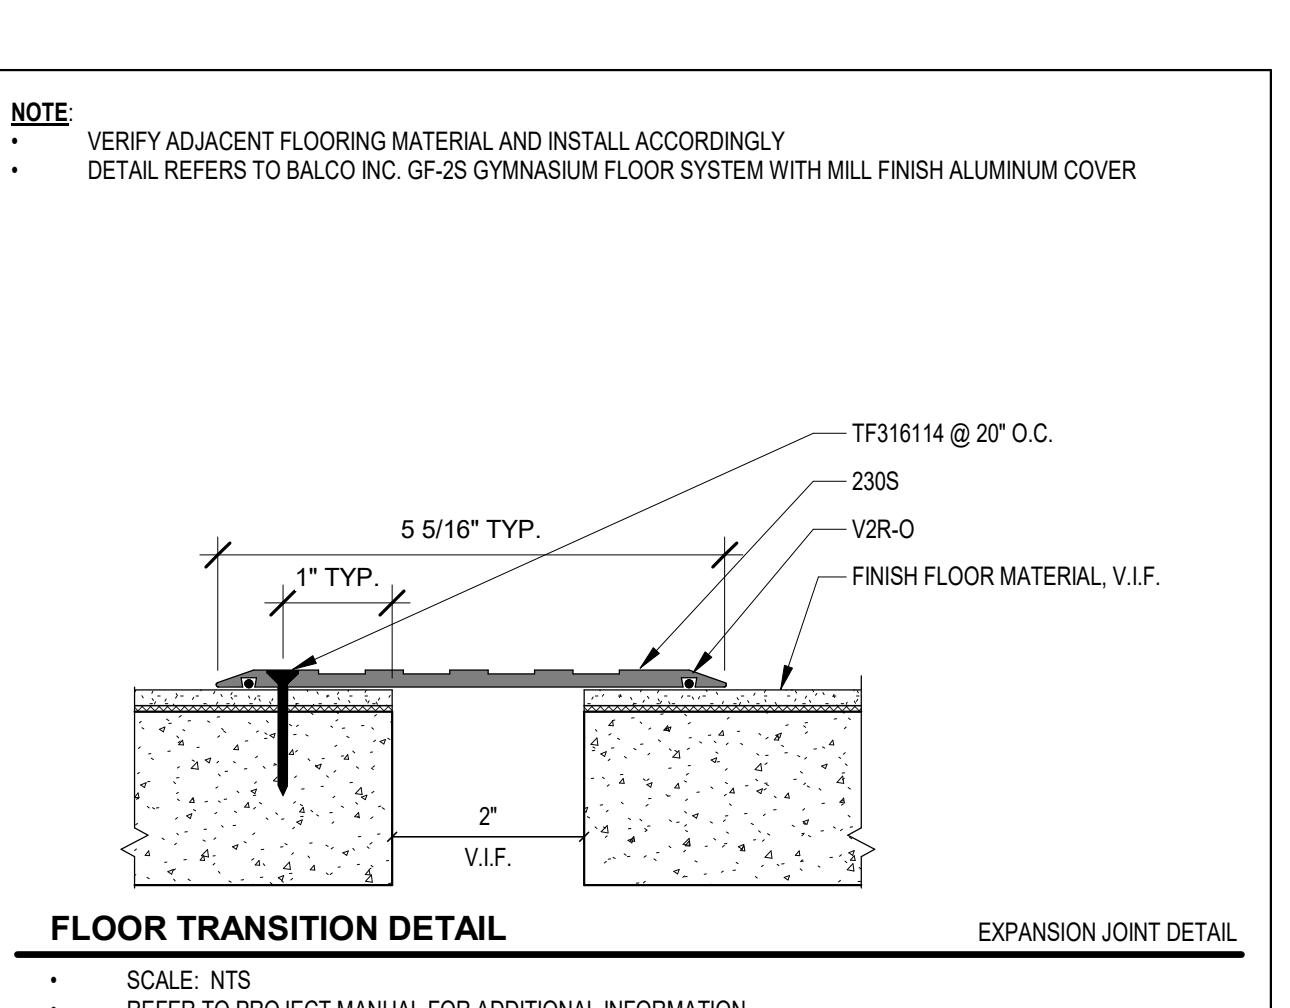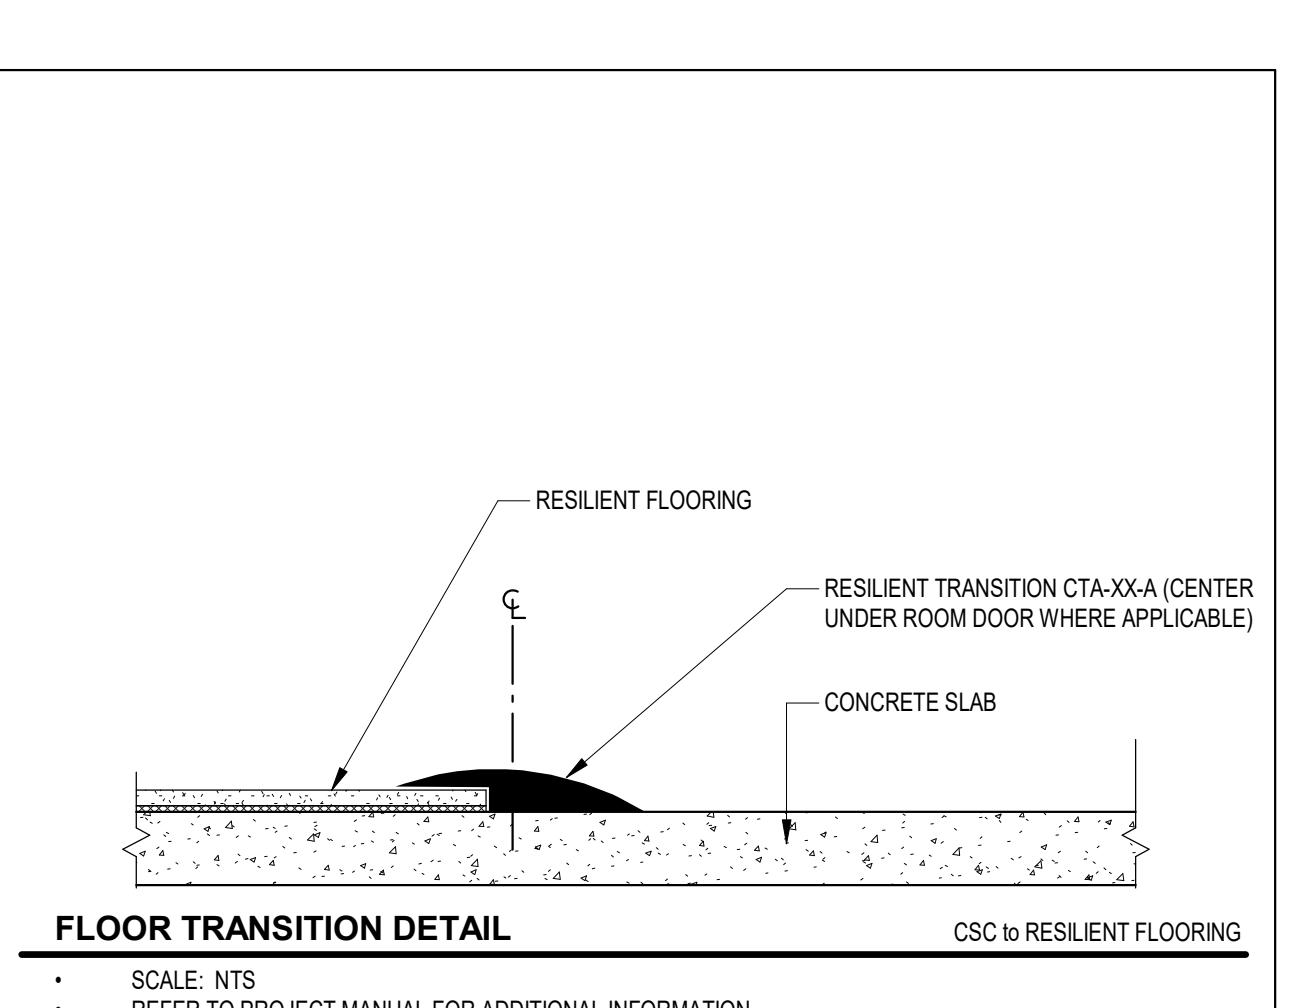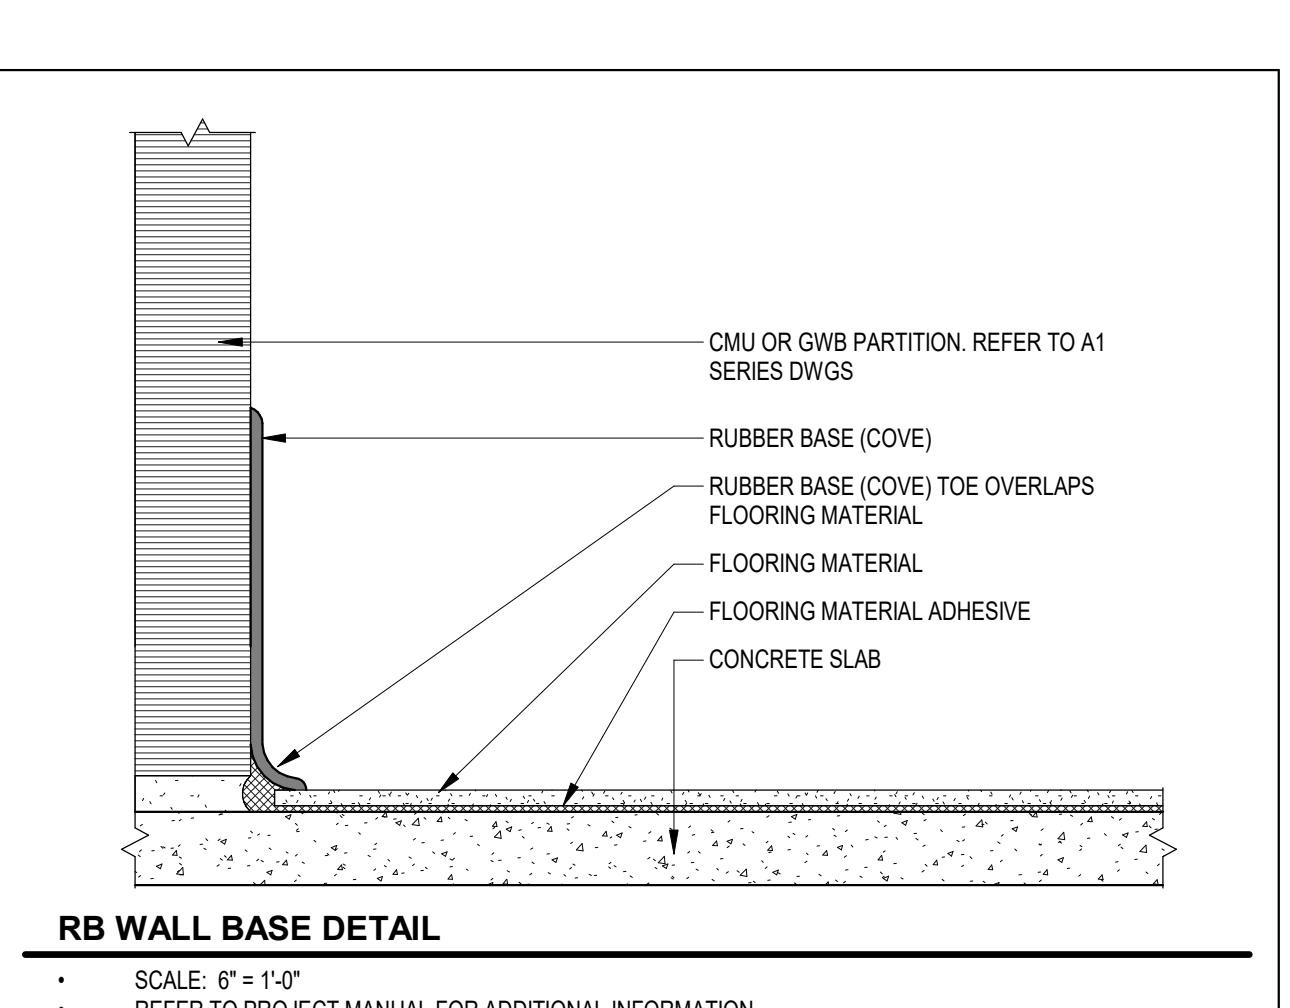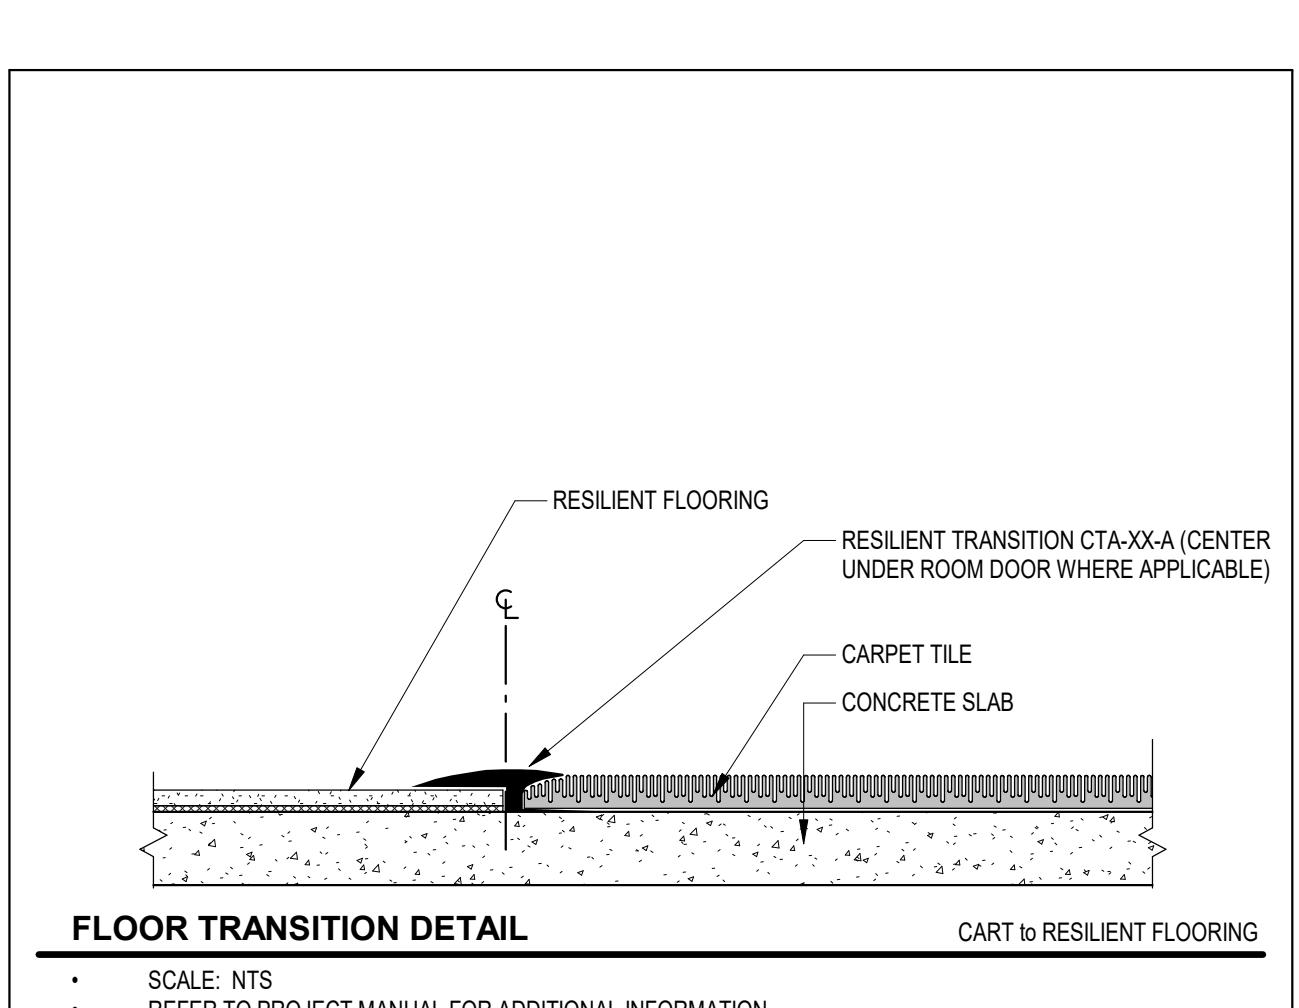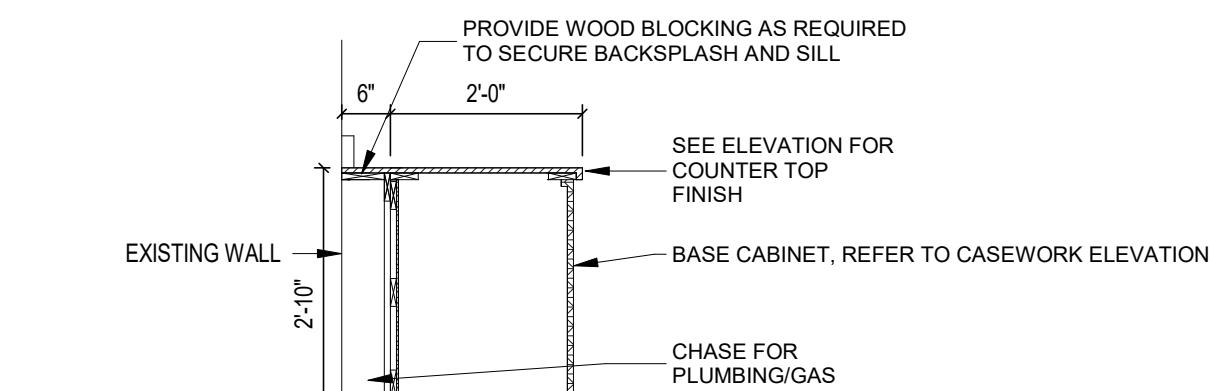

MATERIAL & FINISH GENERAL NOTES

GENERAL

A. REFER TO FINISH PLAN DRAWINGS AND DETAILS FOR MATERIALS, PATTERNS AND COLORS.

FLOORING

A. CENTER FLOORING TILE AND PATTERN IN ROOM UNLESS OTHERWISE INDICATED ON FINISH PLANS.

B. ALIGN EDGE OF FINISHED FLOOR MATERIAL WITH EDGE OF WALL OR CASEWORK.

C. FLOOR FINISH MATERIAL TRANSITIONS SHALL OCCUR UNDER THE CENTER OF THE DOOR UNLESS OTHERWISE INDICATED, WHERE

D. THE FLOORING MATERIAL CHANGES FROM ROOM TO ROOM.

E. COORDINATE CONTROL JOINTS IN CONCRETE SLAB WITH STRUCTURAL DRAWINGS AND FINISH FLOORING INSTALLER.

F. REFER TO FLOOR PLANS, RESTROOM ENLARGED PLANS, PLUMBING DRAWINGS, ETC. FOR FLOOR PLAN LOCATIONS.

G. AT BUILDING ELEVATIONS, PROVIDE PRE-FABRICATED MOVEMENT PROFILE SYSTEM IN MORTAR BED. PROVIDE SCHLUTER DILEX-EUF OR APPROVED EQUAL. TYPICAL AT ALL LOCATIONS.

WALL BASE

A. RUBBER BASE (RB-1) TO BE INSTALLED AT ALL RESILIENT TILE, CART, AND ECT LOCATIONS UNLESS OTHERWISE INDICATED. ALL RB

B. BASE TO BE COATED.

C. PROVIDE PREFORMED BASE TO MATCH #1 RADIUS AT ALL LOCATIONS WHERE BASE COVERS MASONRY BULLNOSE. REFER TO FINISH

SCHEDULE FOR BASE MATERIAL TYPE, TYPICAL AT ALL LOCATIONS. AT RB LOCATIONS PROVIDE PREFORMED OUTSIDE CORNERS,

AND USE MANUFACTURER'S RECOMMENDED ADHESIVE (CONTACT CEMENT) FOR PROPER ADHESION WITH NO GAPS.

PAINT & STAIN

A. PAINT ALL WALLS UNLESS OTHERWISE INDICATED ON FINISH PLANS.

PAINT TYPE GENERAL NOTES

A. UNDER SECTION 099123 - INTERIOR PAINTING, PAINT EXPOSED PIPES, DUCTWORK, BRACINGS, CONDUIT, INSULATED PIPES, CONDU

IT, DUCTS, SUPPORTS, BRACINGS, ETC., WHICH OCCURS IN SPACES DESIGNATED TO BE PAINTED IN PART OR WHOLE.

B. PAINTING AND PAINTING OF EXTERIOR SURFACES AS DESIGNATED, DETAILS SHALL BE UNDER THE WORK SECTION 099113 - EXTERIOR PAINTING.

C. ALL GYPSUM BOARD WALLS SHALL BE PAINTED WITH INTERIOR PAINT TYPE #9.25 (SEMI-GLOSS) UNLESS OTHERWISE INDICATED.

D. ALL EXPOSED CONCRETE BULLNOSE EDGES AND CORNERS SHALL BE PAINTED WITH PAINT TYPE #9.21 (FLAT) UNLESS OTHERWISE INDICATED.

E. IN THE FOLLOWING ROOMS PAINT WITH PAINT CODE #4.224 (EPOXY-SEMI-GLOSS). REFER TO SECTION 09900 - HIGH PERFORMANCE

COATINGS. (A101, A102, A104, A109, A109, B201, B202)

F. IN THE FOLLOWING ROOMS PAINT WITH PAINT CODE #4.222 (EPOXY-WET ENVIRONMENTS). REFER TO SECTION 09900 - HIGH PERFORMANCE

COATINGS. (B101, B102, B103, B104, B109, B111)

H. ALL FERROUS METAL (EXCLUDING STRUCTURE) SHALL BE PAINTED INTERIOR PAINT TYPE #5.12.

I. ALL GALVANIZED METAL (EXCLUDING STRUCTURE) SHALL BE PAINTED INTERIOR PAINT TYPE #5.32.

J. ALL EXPOSED METAL (EXCLUDING STRUCTURE) SHALL BE PAINTED INTERIOR PAINT TYPE #5.31.

K. ALL EXPOSED GALVANIZED METAL STRUCTURE SHALL BE PAINTED INTERIOR PAINT TYPE #5.31.

L. ALL WALLS ARE TO RECEIVE AN EGGSHELL FINISH AND ALL CEILINGS/BULKHEADS ARE TO RECEIVE A FLAT FINISH.

M. EXPOSED CONCRETE COLUMNS AND UNDERSIDE OF CONCRETE BLEACHERS TO BE PAINTED WITH INTERIOR PAINT TYPE #3.113 UP

TO 10'-0" WITH PAINT TYPE #3.11 above.

PAINT COLOR GENERAL NOTES

A. ALL INTERIOR WALLS SHALL BE PAINTED P-1, UNLESS OTHERWISE INDICATED ON FINISH PLANS OR INTERIOR ELEVATIONS.

B. PAINT ALL GYPSUM BOARD WALLS UNLESS OTHERWISE NOTED ON FINISH PLANS OR INTERIOR ELEVATIONS.

C. PAINT ALL EXPOSED METAL (EXCLUDING STRUCTURE) UNLESS OTHERWISE NOTED.

D. PAINT ALL EXPOSED CEILINGS AND GYPSUM BOARD CEILINGS P-4 UNLESS OTHERWISE NOTED ON FINISH PLANS, CEILING

2026 CARMEL HIGH SCHOOL IMPROVEMENT PROJECTS

520 EAST MAIN STREET
CARMEL, IN 46032

CARMEL CLAY SCHOOLS


5201 EAST MAIN STREET
CARMEL, IN 46033
317-844-9961



ARCHITEC

FANNING HOWEY

317-848-0966 **WWW.FHAI.COM**
350 E. NEW YORK ST. SUITE 300, INDIANAPOLIS, IN 46204

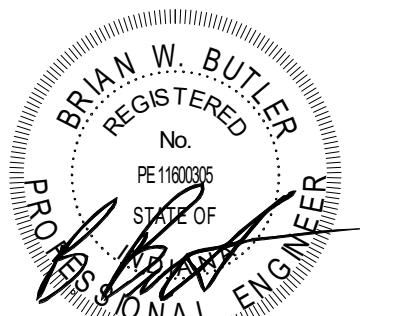


DRAWN BY: BWB
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025

REV. NO. 	DESCRIPTION	DATE
1	ADDENDUM 2	1-23-2026


DEMOLITION PLANS - FIRE PUMP, VISITOR AND TENNIS BUILDINGS

ED101

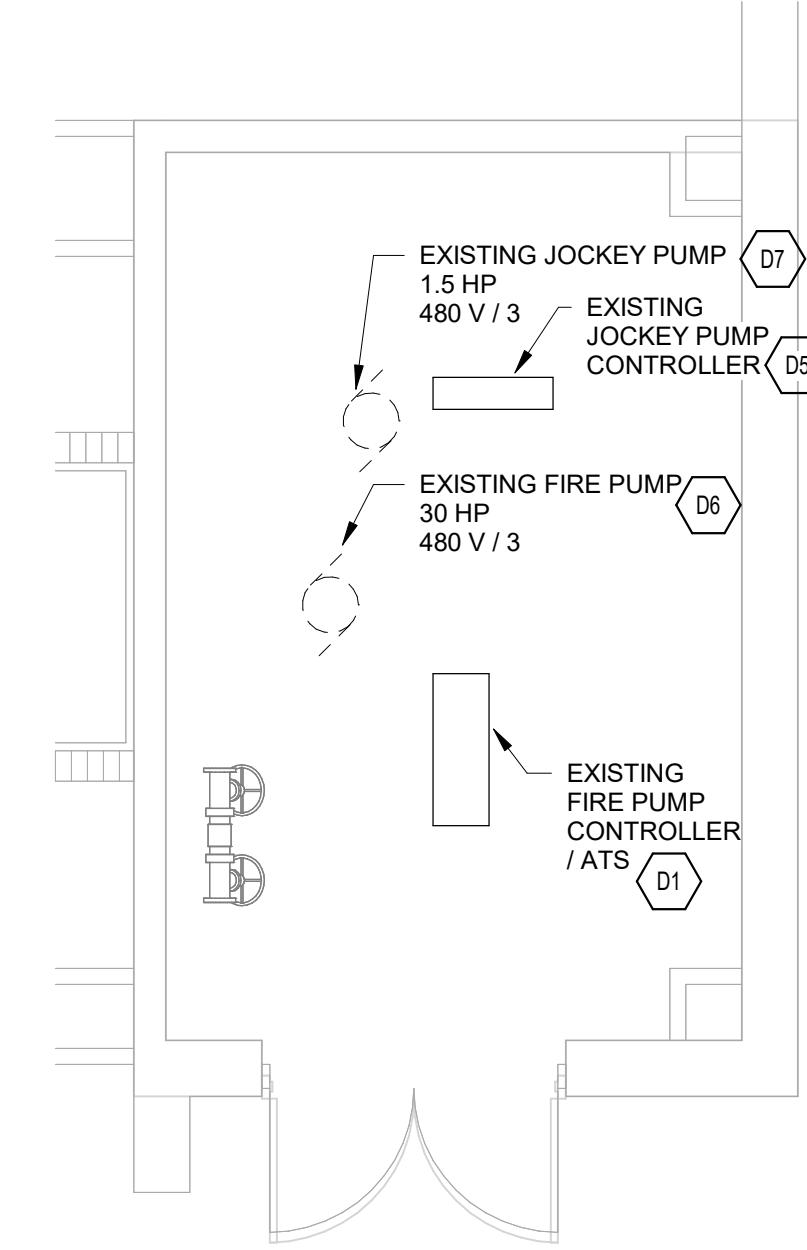


1 FIRST FLOOR DEMOLITION PLAN - FIRE PUMP

SCALE: 1/4" =

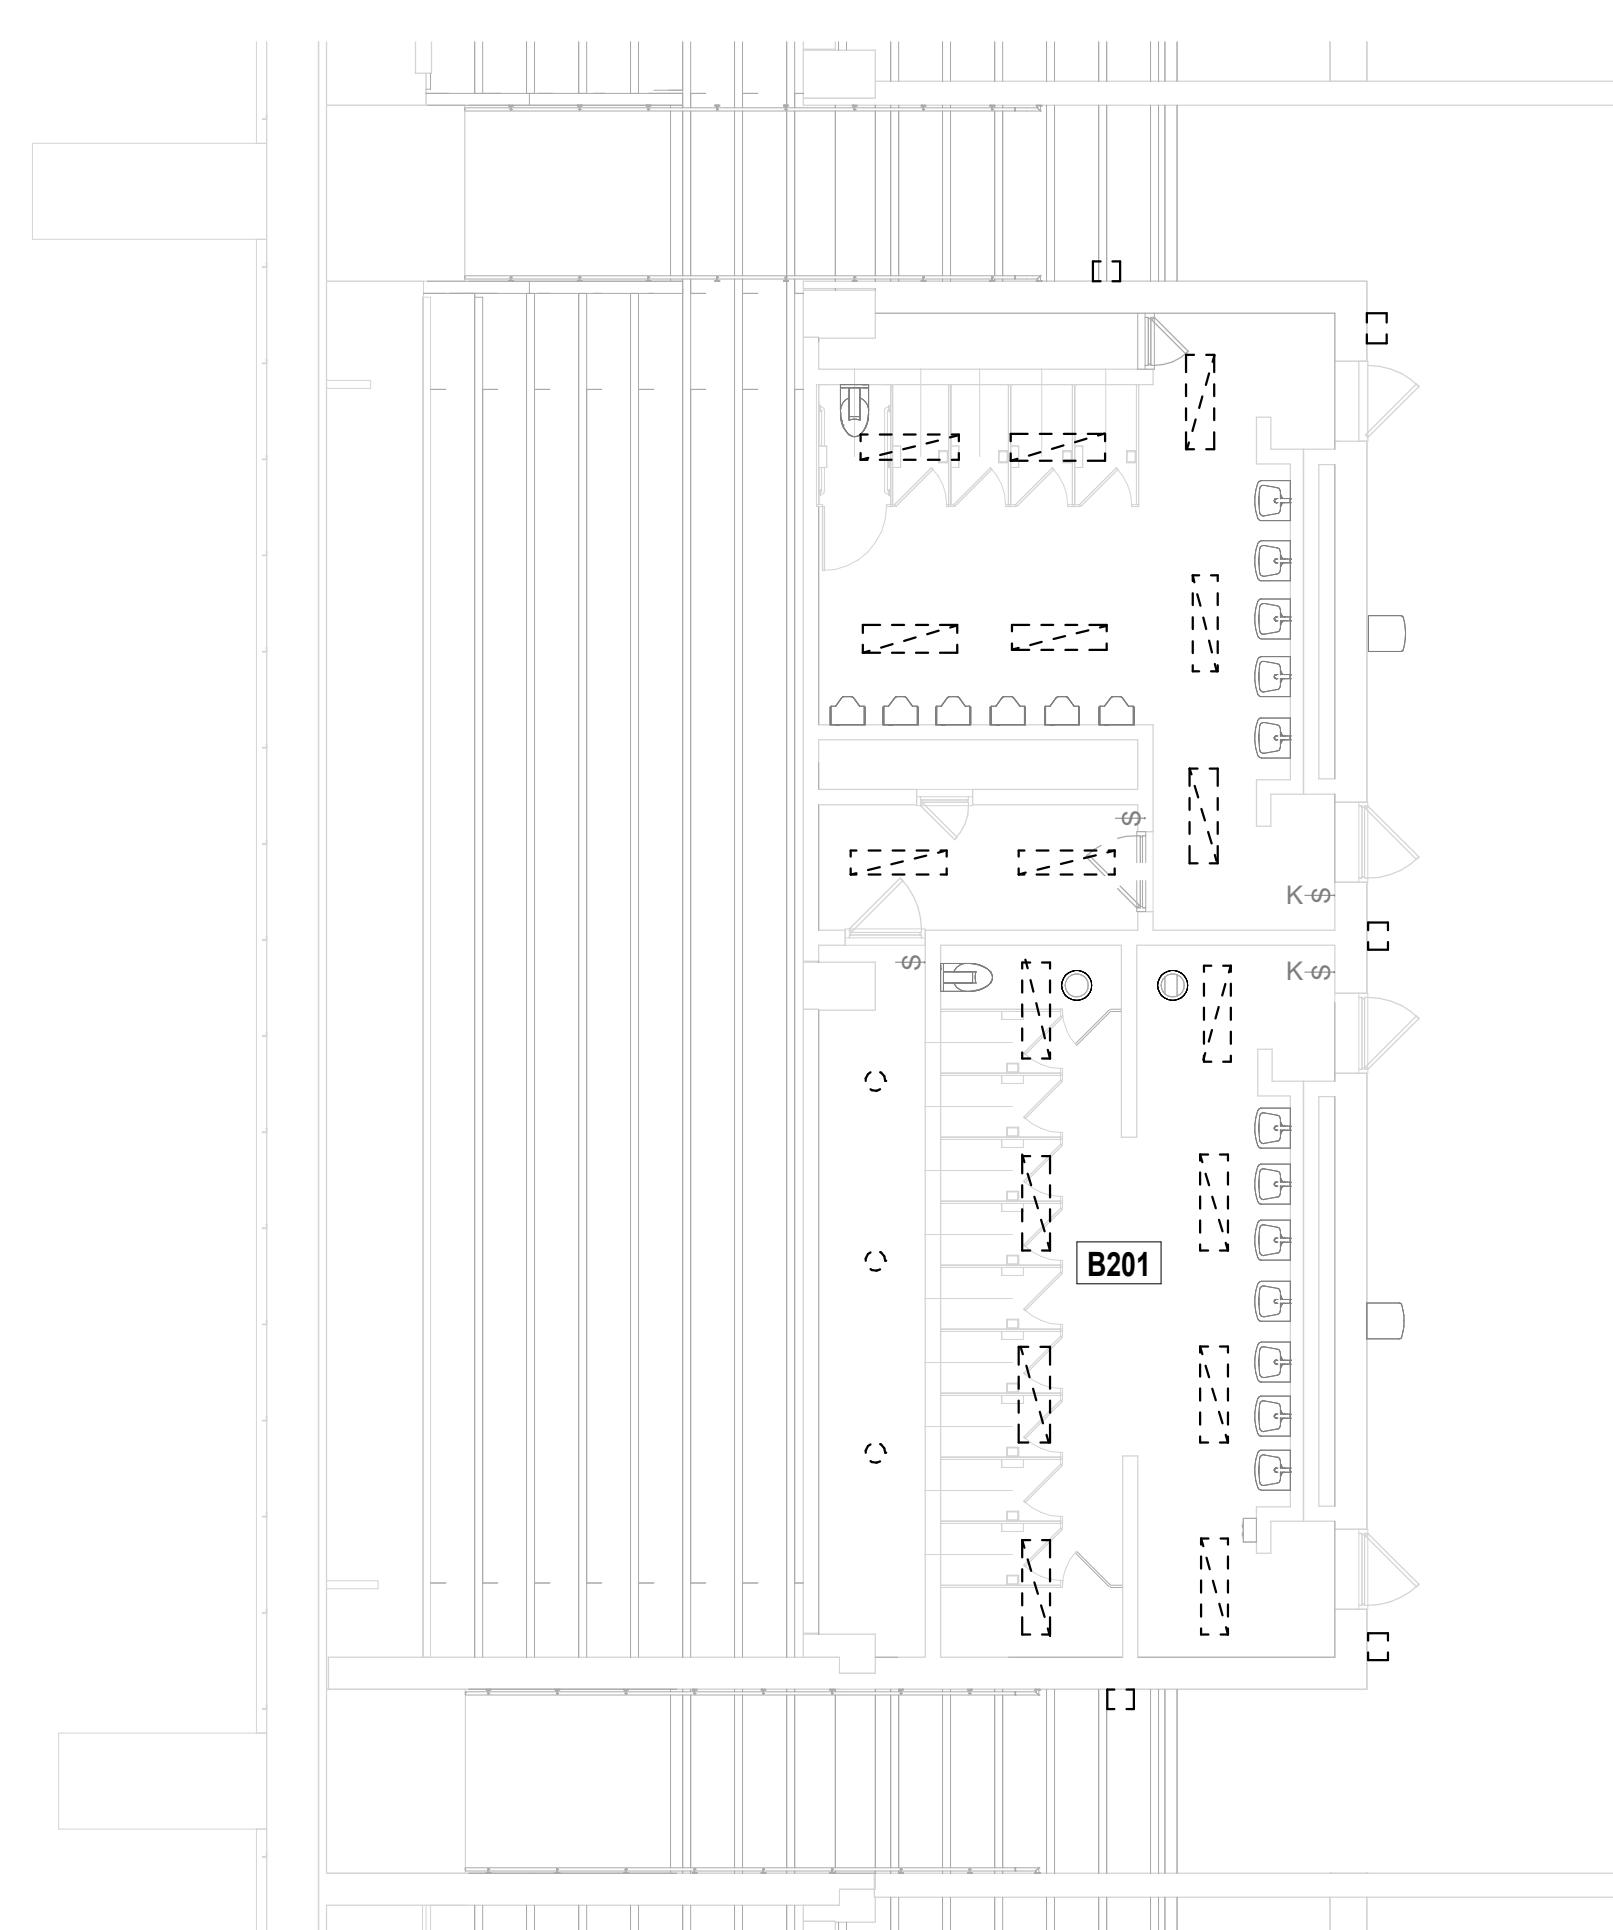


4 SECOND FLOOR DEMOLITION PLAN - VISITOR BLDG.

4 SCALE:

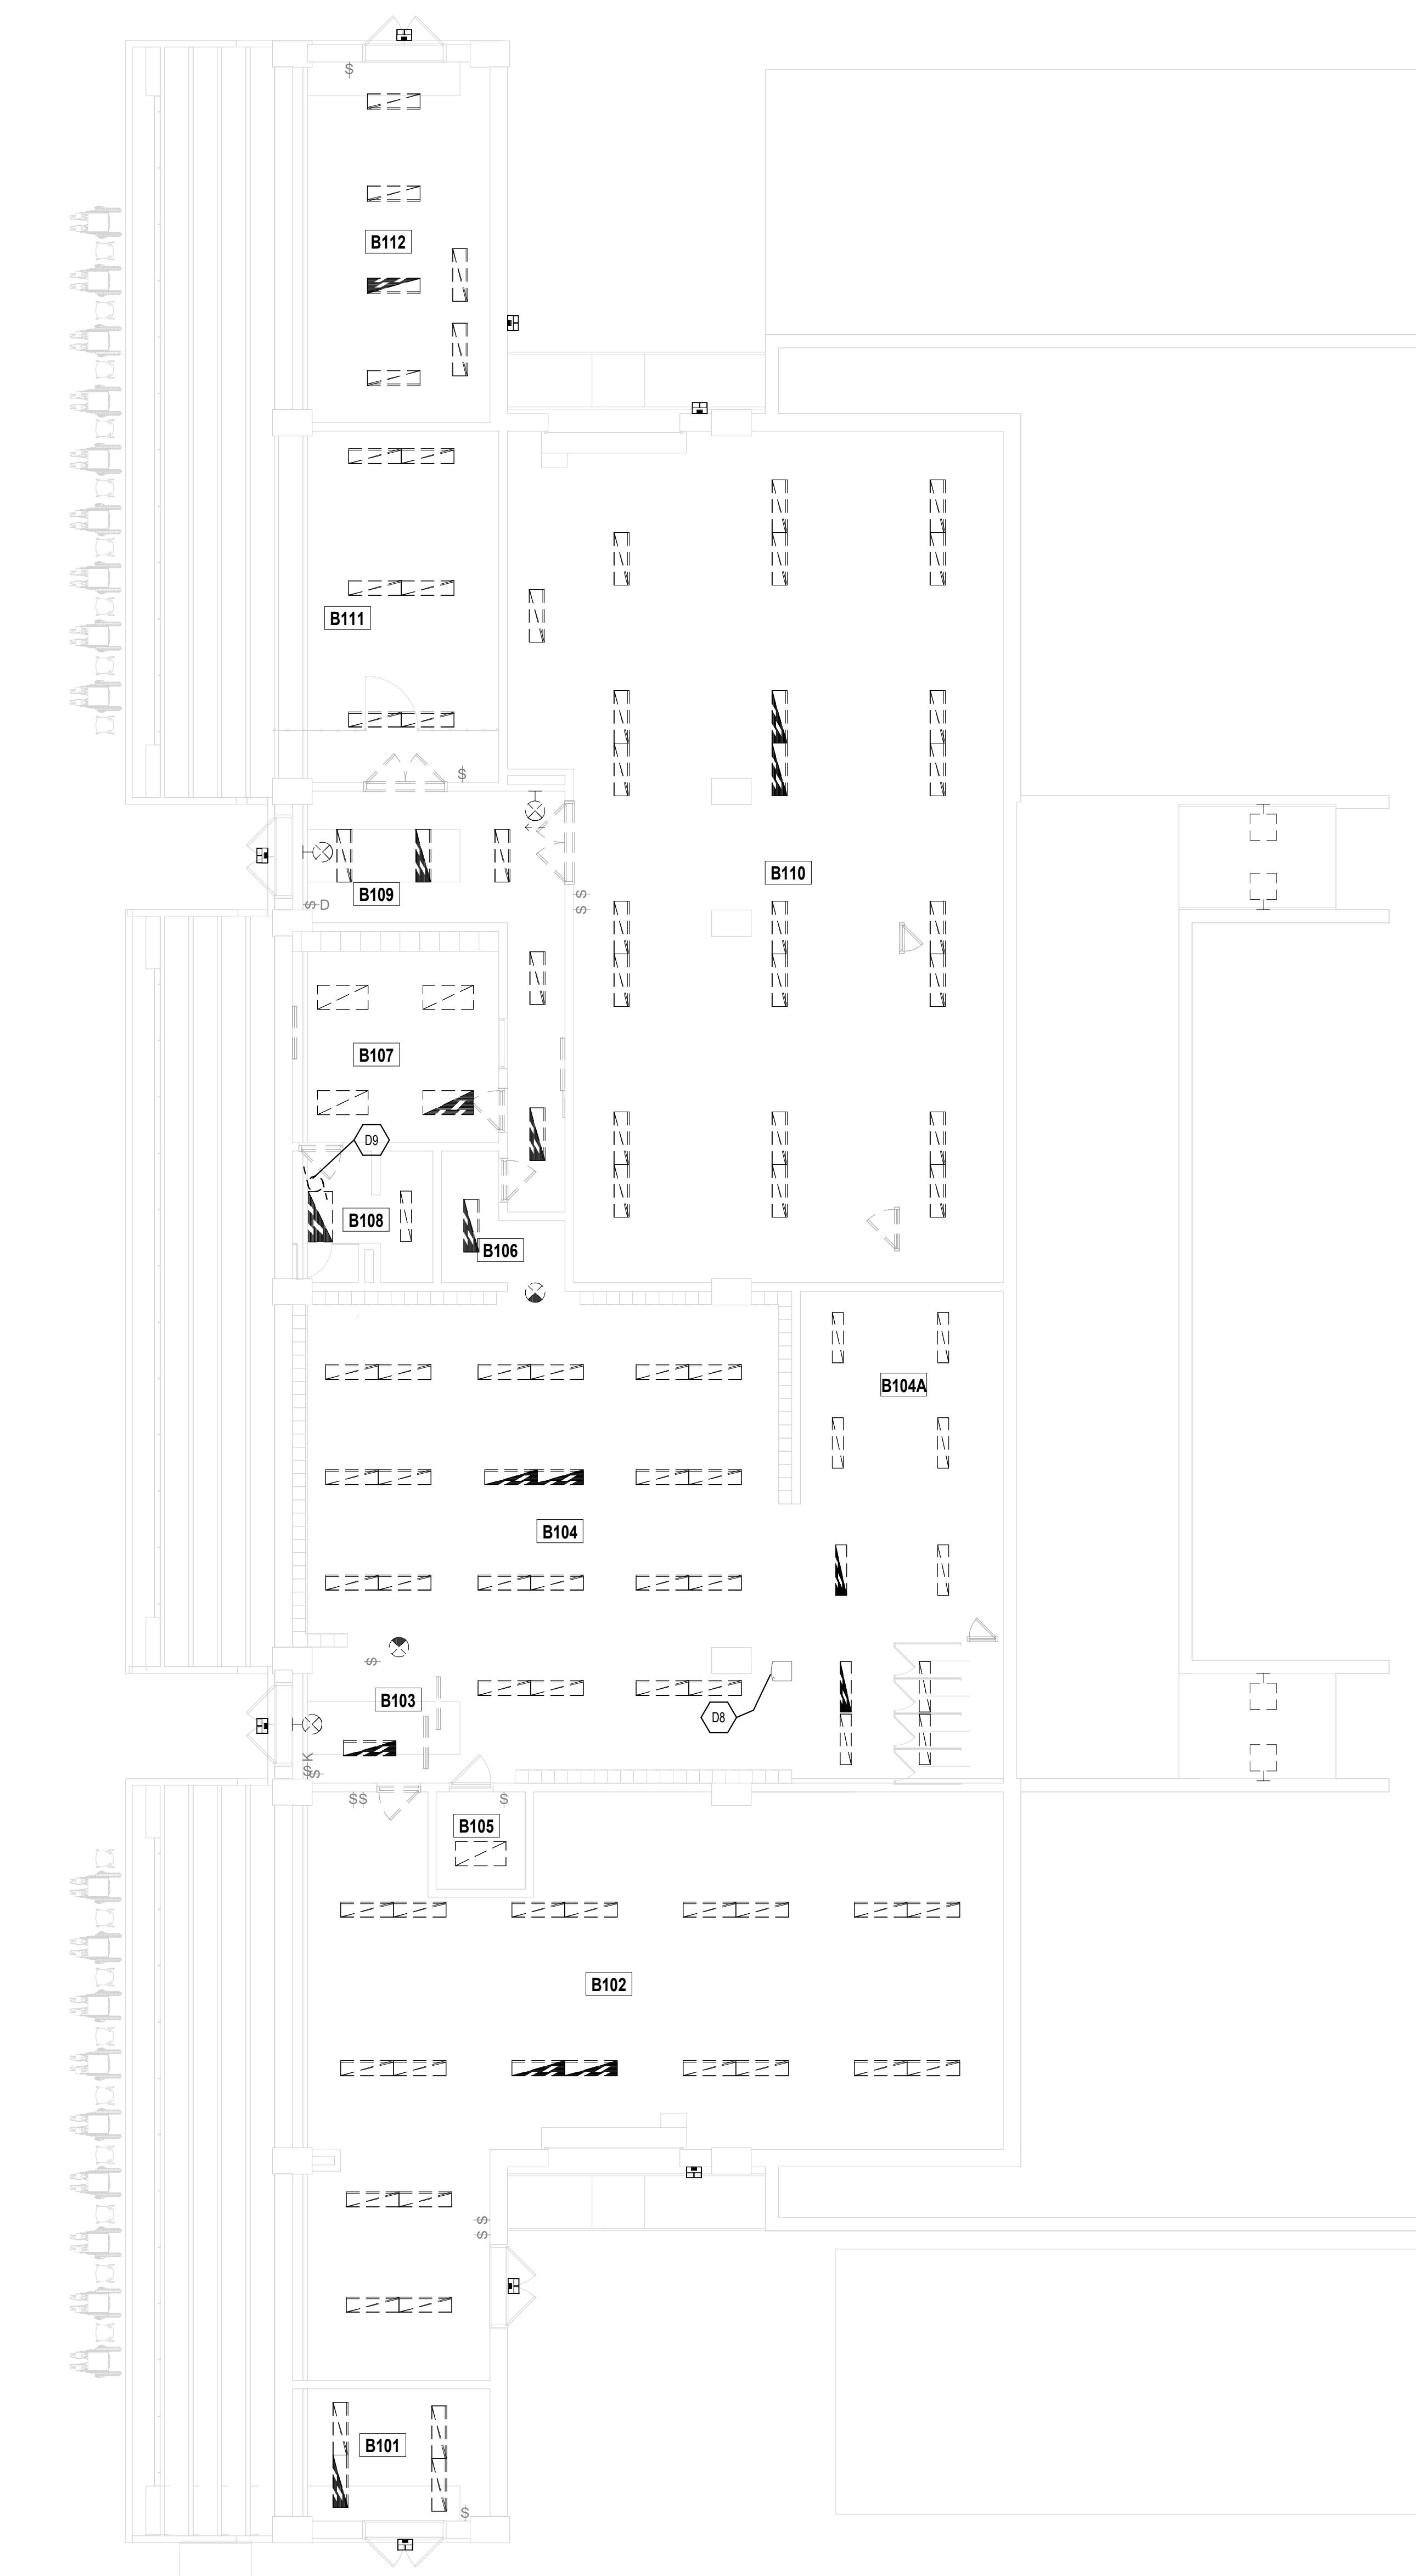

2 FIRST FLOOR DEMOLITION PLAN - VISITOR BUILDING

3

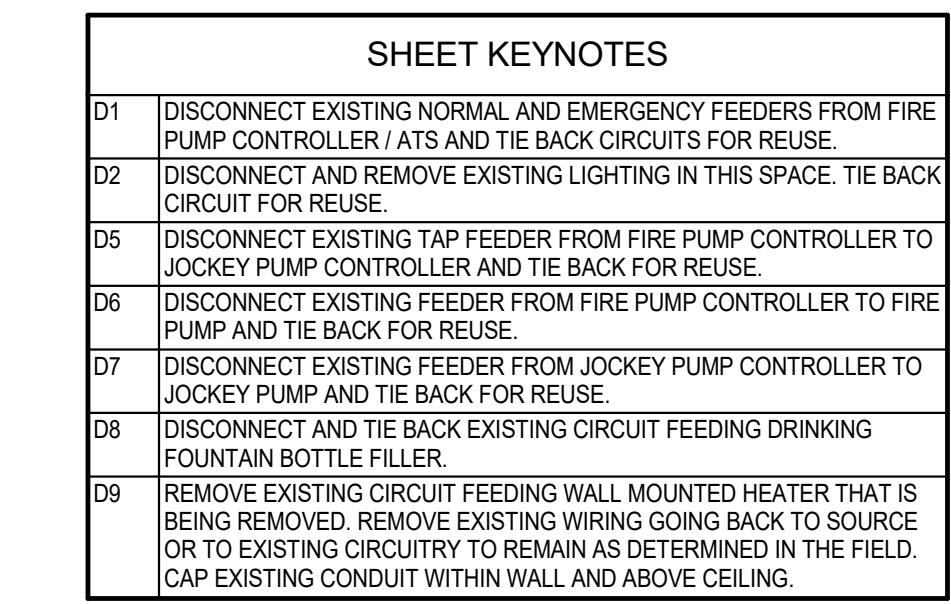

8 FIRST FLOOR DEMOLITION PLAN - TENNIS

(2) NOT TO SCALE

2026 CARMEL HIGH SCHOOL IMPROVEMENT PROJECTS

520 EAST MAIN STREET
CARMEL, IN 46032

CARMEL CLAY SCHOOLS


5201 EAST MAIN STREET
CARMEL, IN 46033
317-844-9961




ARCHITECT

FANNING HOWEY

317-848-0966 WWW.FHAI.COM
350 E. NEW YORK ST. SUITE 300, INDIANAPOLIS, IN 46204

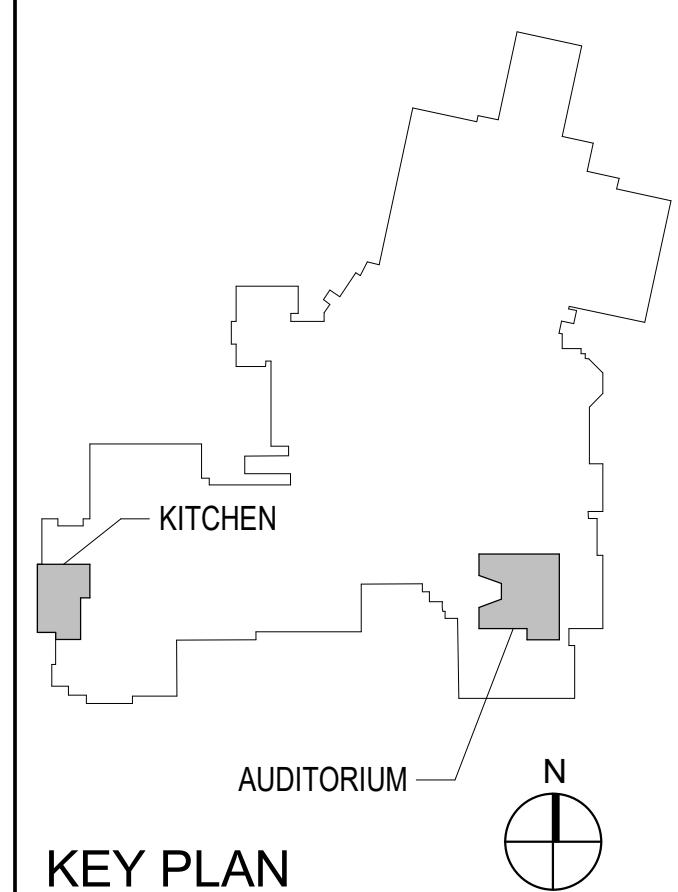

100% CONSTRUCTION DOCUMENTS

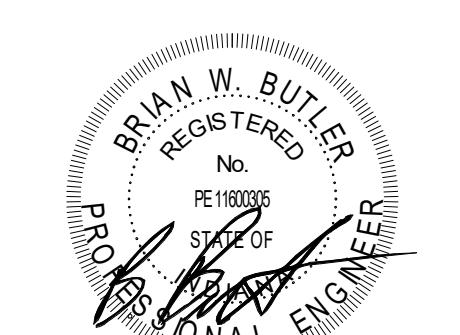

DRAWN BY: ISD
PROJECT NUMBER: 225098.00
PROJECT ISSUE DATE: 12-17-2025

REV.	NO.	DESCRIPTION	DATE
1	ADDENDUM 2		1-23-2026

ENLARGED POWER PLANS - FIRE PUMP AND VISITORS BUILDING

EP101

POWER PLAN GENERAL NOTES

1. PROVIDE REVISED TYPED PANELBOARD DIRECTORIES FOR EACH PANELBOARD ADDED OR MODIFIED DURING CONSTRUCTION. FIELD VERIFY EXISTING CIRCUIT INFORMATION WITH OWNER'S ASSISTANCE TO ENSURE PROPER CONNECTIONS. ALL SPARE BREAKERS SHALL BE IN THE OFF POSITION.
2. CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CLEARANCES AND ALL EXISTING FIELD CONDITIONS BEFORE STARTING CONSTRUCTION. COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE OF CONDITIONS. SHOULD DIFFERENT CONDITIONS BE ENCOUNTERED, CONTACT THE ARCHITECT BEFORE PROCEEDING WITH WORK.
3. LABEL EACH RECEPTACLE WITH THE PANEL NAME AND CIRCUIT NUMBER ON THE FACE OF EACH COVER PLATE WITH A TYPED LAMINATED LABEL.
4. PROVIDE A PROTECTED LABEL ON COVER PLATE FOR ANY GFCI PROTECTED DEVICE.
5. CONTRACTOR SHALL INCREASE CIRCUIT CONDUCTOR SIZE TO COMPENSATE FOR VOLTAGE DROP DUE TO EXCESSIVE CIRCUIT LENGTH. FIELD VERIFY VOLTAGE DROP EXCEEDED IN E.O.C. REQUIREMENTS.
6. ALL DEVICES, EQUIPMENT, FIXTURES, AND THE LIKE, SHALL BE BONDED WITH A PROPERLY SIZED EQUIPMENT GROUNDING CONDUCTOR. MAINTAIN MECHANICAL/ELECTRICAL BONDS OF METALLIC RACEWAY SYSTEM.

POWER PLAN NOTES
(ALL NOTES MAY NOT BE INDICATED ON THIS SHEET)

SHEET KEYNOTES

P1 PROVIDE CONNECTION TO FLOW AND TAMPER VALVES OF NEW RISER SERVING AUDITORIUM TO EXISTING INDICATING LOOP SERVING AREA. UPDATE EXISTING PROGRAM IN FIRE ALARM PANEL AS REQUIRED.

P1 RECONNECT NEW FIRE PUMP TO EXISTING FEEDER TIED BACK FOR REUSE.

P11 RECONNECT NEW FIRE PUMP CONTROLLER / ATS TO EXISTING NORMAL AND EMERGENCY FEEDERS TIED BACK FOR REUSE.


P12 RECONNECT NEW JOCKEY PUMP CONTROLLER TO EXISTING TOWER FEEDER AT FIRE PUMP CONTROLLER / ATS TIED BACK FOR REUSE.

P13 RECONNECT NEW JOCKEY PUMP FEEDER FROM JOCKEY PUMP CONTROLLER TIED BACK FOR REUSE.

P14 PROVIDE CONTROL WIRING AS REQUIRED SO THAT WHEN JOCKEY POWER IS UNAVAILABLE AND THE FIRE PUMP STATION IS ACTIVE, ANY SERVING STANDBY LOADS WILL NOT TRANSFER (TRANSFER INHIBIT) FOR GENERATOR LOAD MANAGEMENT.


P15 PROVIDE NEW FEEDERS IF REQUIRED DUE TO DISTANCE LIMITATIONS. FEEDERS ARE 3 FT. #6 G.C. 2 CIR. PIPING FOR JOCKEY PUMP IS 1" ID. LIGHTWEIGHT FLEXIBLE METALLIC CONDUIT AT MOTOR CONNECTIONS.

P16 CONNECT NEW DRINKING FOUNTAIN / BOTTLE FILLER TO EXISTING CIRCUIT TIED BACK DURING DEMOLITION.

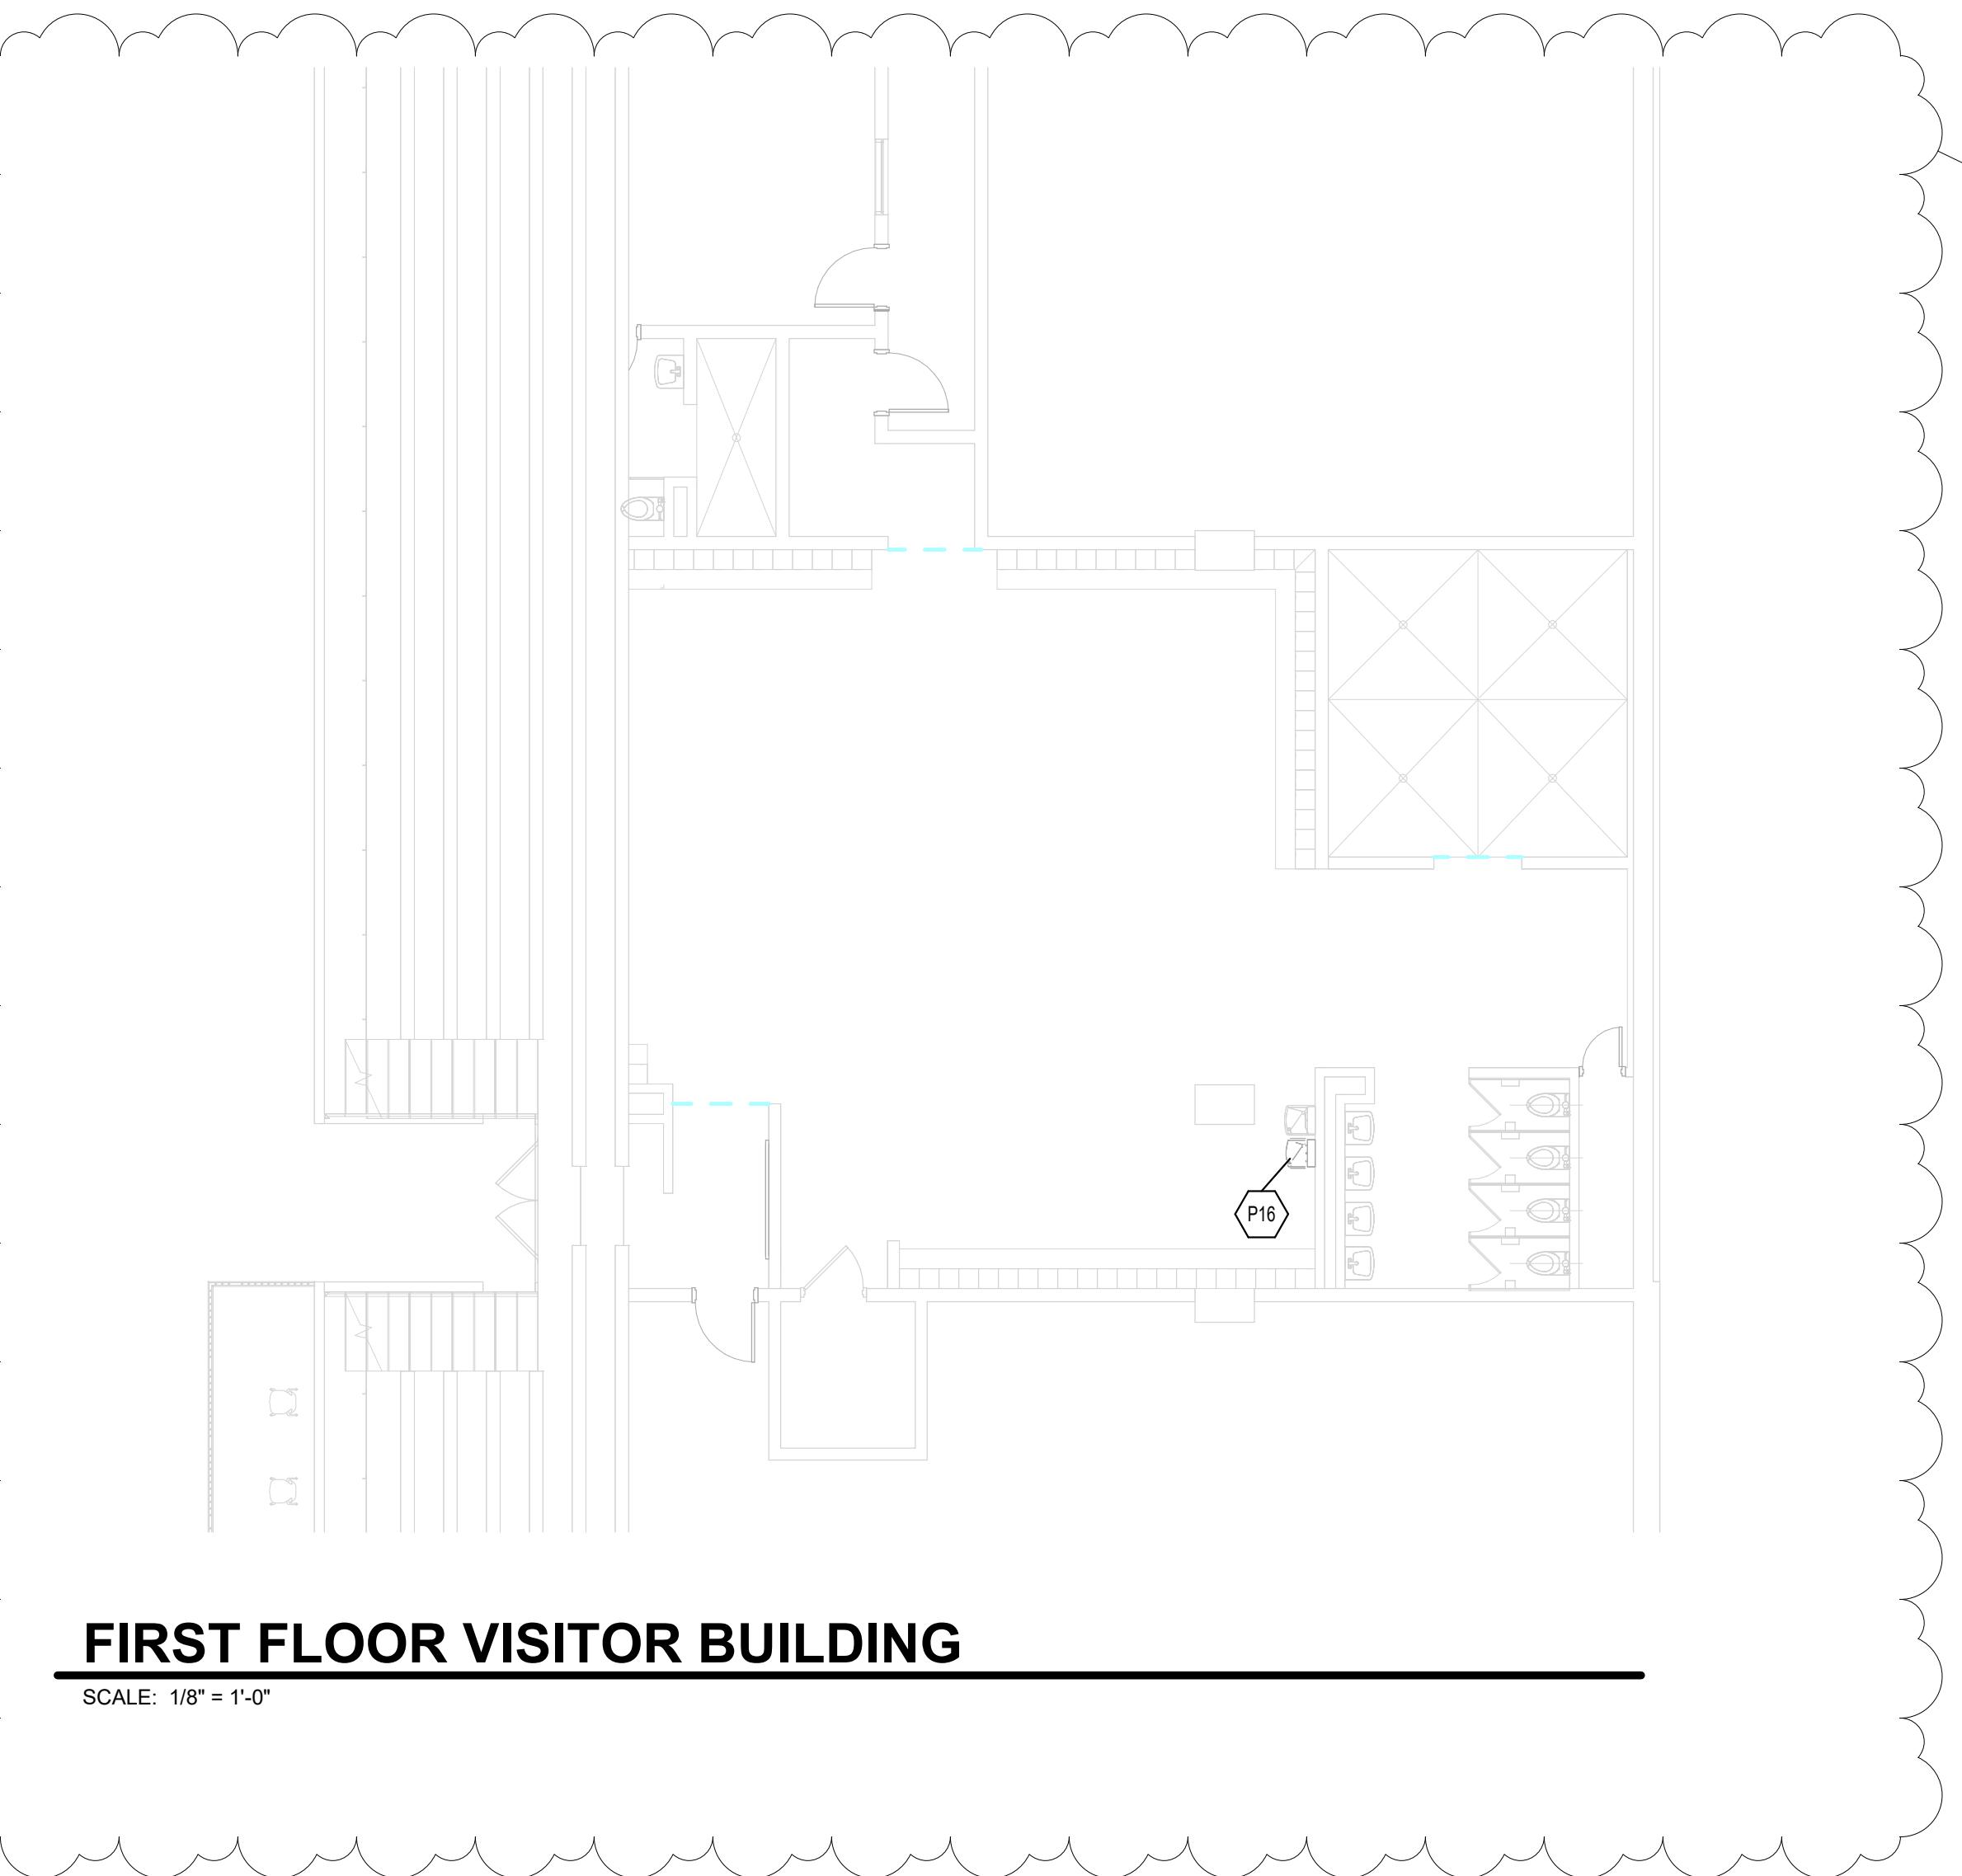


FIRST FLOOR VISITOR BUILDING

SCALE: 1/8" = 1'-0"

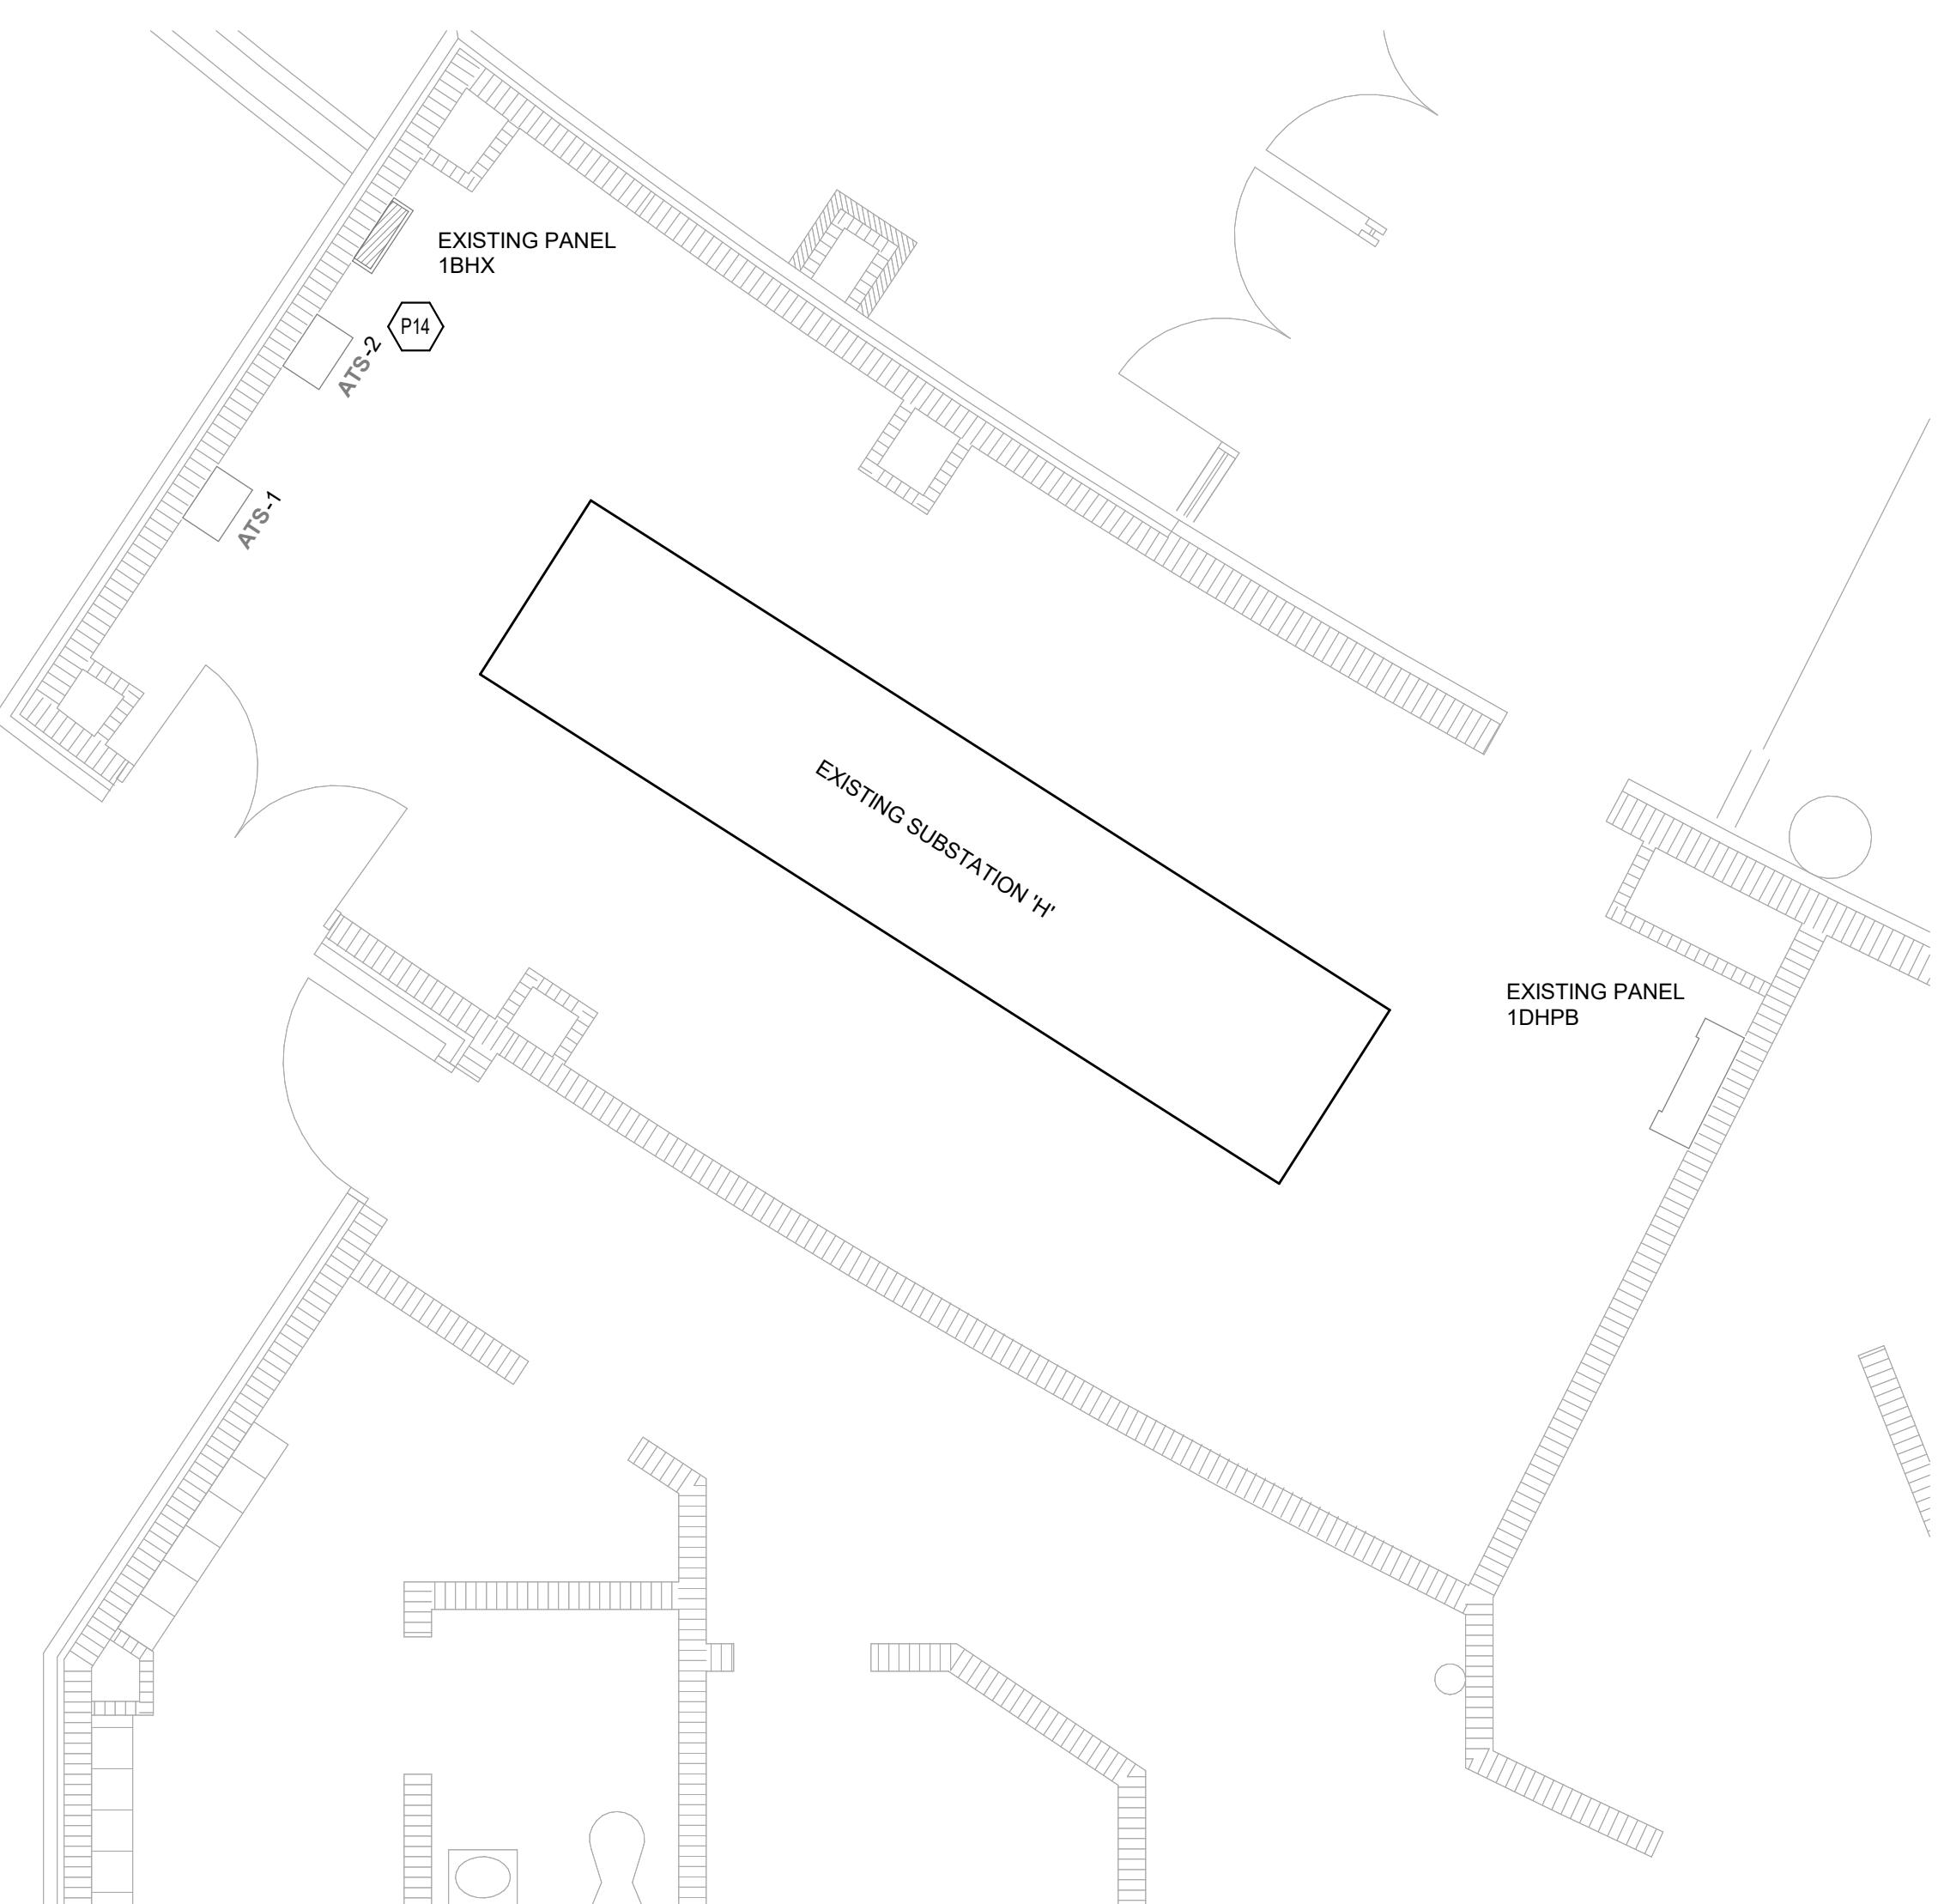

1 FIRST FLOOR POWER PLAN - FIRE PUMP

SCALE: 1/4" = 1'-0"

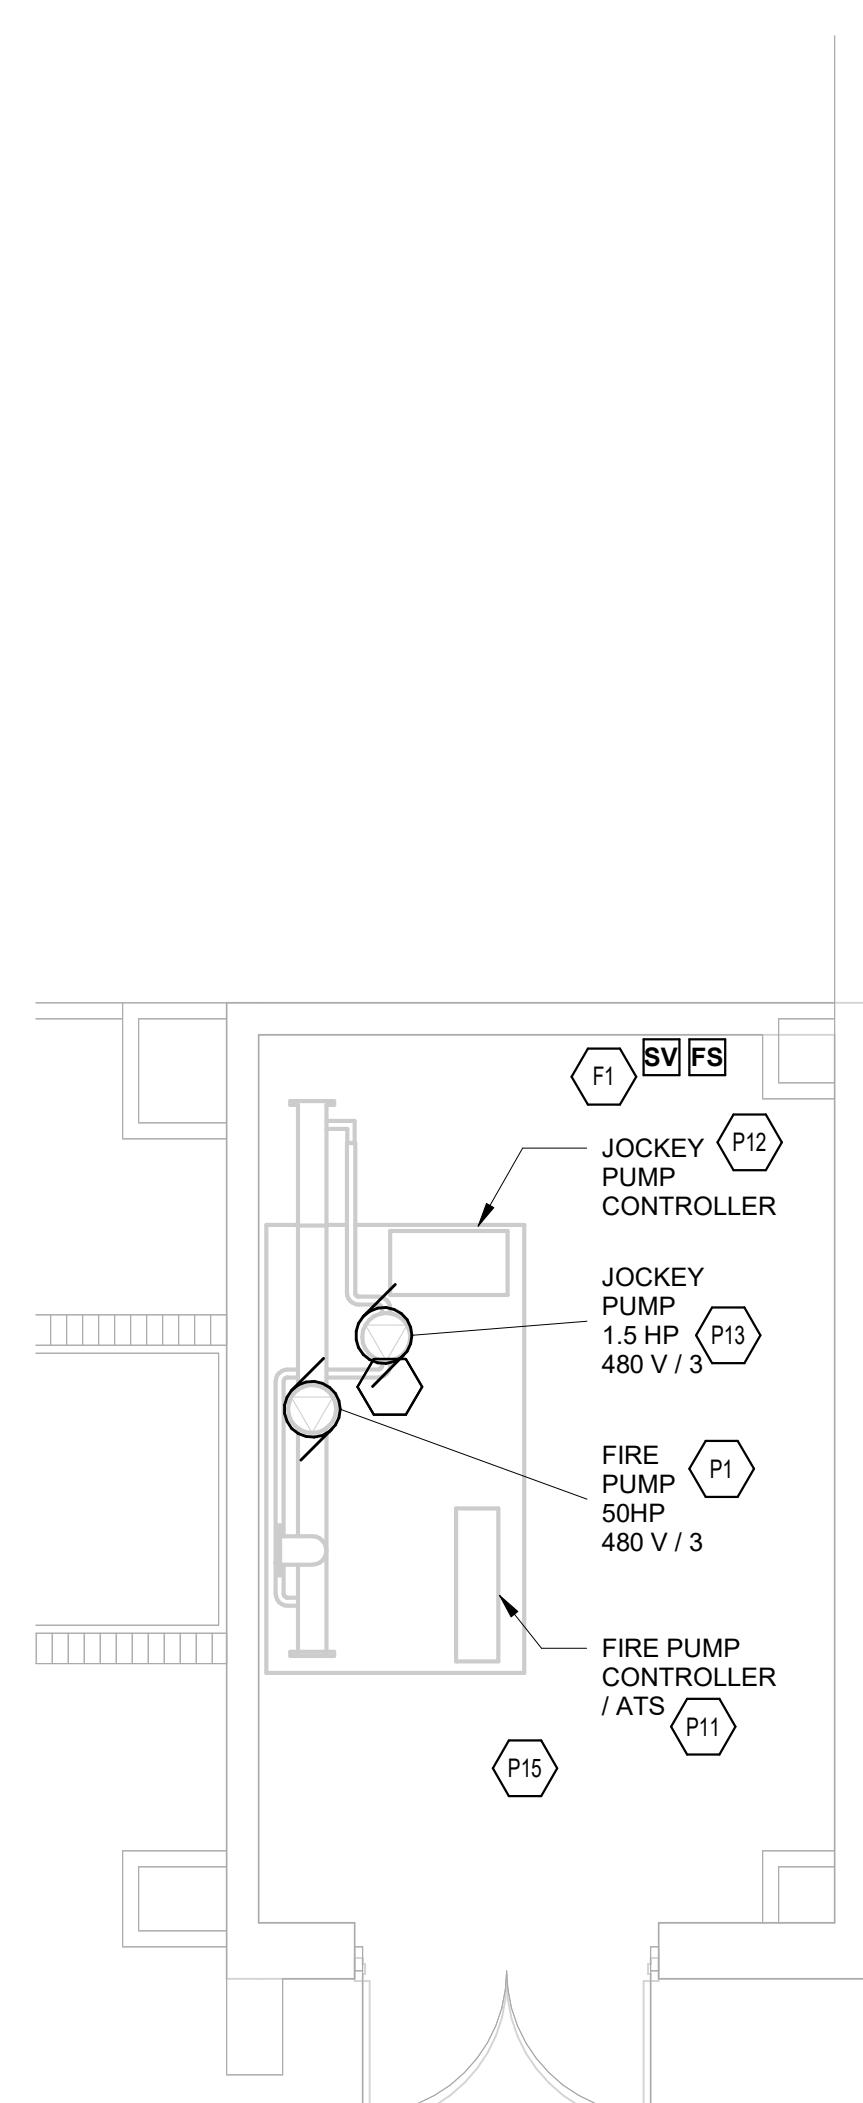

VERIFICATION NOTE
CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CLEARANCES AND ALL EXISTING FIELD CONDITIONS BEFORE STARTING CONSTRUCTION. COMMENCEMENT OF WORK CONSTITUTES ACCEPTANCE OF CONDITIONS. SHOULD DIFFERENT CONDITIONS BE ENCOUNTERED, CONTACT THE ARCHITECT BEFORE PROCEEDING WITH WORK.