

ADDENDUM  
NO. 02

**January 28, 2026**

**Kalamazoo Public Schools Chenery Auditorium Lighting Replacement**  
**714 South Westnedge Avenue**  
**Kalamazoo, MI 4900**

**TO: ALL BIDDERS OF RECORD**

This Addendum forms a part of and modifies the Bidding Requirements, Contract Forms, Contract Conditions, the Specifications and the Drawings dated January 8, 2026, by TowerPinkster. Acknowledge receipt of the Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of Pages ADD 2-2 through ADD 2-2 and TowerPinkster Addendum No. 02, dated January 27, 2026, consisting of 9 pages.

**A. SPECIFICATION SECTION 00 20 00 – INFORMATION AVAILABLE TO BIDDERS**

1. Refer to the attached Pre Award Schedule.

**B. SPECIFICATION SECTION 01 12 00 - MULTIPLE CONTRACT SUMMARY**

**A. BID CATEGORY NO. 01 – GENERAL TRADES**

Add the following Clarification:

1. **Bid Category No. 01 General Trades** shall handle all patching and painting on a Time and Material basis. **Bid Category No. 01 General Trades** shall include a \$10,000 allowance, separate from their specified Contingency Allowance, for all patching and painting.

2. **Bid Category No. 01 General Trades** shall include installing, maintaining, and removal of floor protection for every room indicated to have work done on the drawings. **Bid Category No. 01 General Trades** shall provide, maintain, and remove plastic protection for the auditorium seating.

C. **Refer to the attached Request For Information summary, Pre-Bid RFI No. 01 through 03 are included.**

## KPS - Chener Auditorium Lighting Replacement

### Pre-Award Conference Schedule

1/27/2026

\*Apparent Low Bidder

Wednesday (2/4)	8:00am	9:00am	10:00am	11:00am	12:00pm	1:00pm	2:00pm	3:00pm	4:00pm
		BC 1 - General Trades* 9:00am - 9:45am						BC - 2 Electrical* 3:00pm - 3:45pm	BC - 2 Electrical 4:00pm - 4:45pm

Thursday (2/5)	8:00am	9:00am	10:00am	11:00am	12:00pm	1:00pm	2:00pm	3:00pm	4:00pm
		BC 3 - Theatrical Lighting * 9:00am - 9:45am	BC 3 - Theatrical Lighting 10:00am - 10:45am						

## KPS CEC - Pre-Bid RFI Log

Date - 01/23/2026

**TowerPinkster**  
Architecture · Engineering · Interiors



RFI #	Company Submitting RFI	Date Received	RFI Description	RFI Response
1	Fantasee Integration	1/23/2026	<p>Section 26 0961 - Theatrical Lighting Control System</p> <p>•In 1.9 - Approved Vendors, please update Fantasee Lighting to our new name and location: Fantasee Integration in Detroit, MI. The telephone number is the same.</p>	<b>HAVD Response:</b> Fantasee Integration, Detroit, MI is approved to bid section 26 0961- Theatrical Lighting Control System
2	Fantasee Integration	1/23/2026	<p>Section 26 0961 - Theatrical Lighting Control System</p> <p>•The Lighting Fixtures table specifies that all new fixtures and accessories be black. However, the current fixtures in the space are white. As some of the existing fixtures will receive LED retrofits, would the client like the new fixtures and accessories to also be white?</p>	<b>HAVD Response:</b> Provide white for white and black for black for all LED Retrofit luminaires.
3	Fantasee Integration	1/23/2026	<p>All TL series drawings</p> <p>•Drawings show great detail on locations where new theatrical lighting fixtures are to be placed, but there are no provided focus points. Will Theatrical Lighting bidders be responsible for labor for focusing fixtures, or will Owner's staff focus fixtures after installation? If focus is Theatrical Lighting bidder's responsibility, please provide focus points.</p>	<b>HAVD Response:</b> All Theatrical Sheets: Refer to notation on top left of the sheets for Delegation of Responsibilities. "THE TL VENDOR IS RESPONSIBLE FOR HANGING ALL NEW FIXTURES, AND FIXTURES TO BE RE-USED BY THE VENUE, PER THE OWNER'S FIXTURE LAYOUT". The Owner's technical team will provide general focus points for the fixture package.

## ADDENDUM NO. 2

DATE OF ISSUANCE:	January 27, 2026, 2026
PROJECT:	CEC – Chenery Auditorium Lighting Replacement 714 South Westnedge Avenue Kalamazoo, MI 49024
OWNER:	Kalamazoo Public Schools
ARCHITECT'S PROJECT NO.:	23-644.00
ORIGINAL BID ISSUE DATE:	January 8, 2026

---

### SCOPE OF WORK

This Addendum includes changes to, or clarifications of, the original Bidding Documents and any previously issued addenda, and shall be included in the Bid. All of these Addendum items form a part of the Contract Documents. The Bidder shall acknowledge receipt of this Addendum in the appropriate space provided on the Bid Form. Failure to do so may result in disqualification of the Bid.

### DOCUMENTS INCLUDED IN THIS ADDENDUM

This Addendum includes **Two [2]** pages of text and the following documents:

- Specification Sections: **None**
- Drawings: **E 201.A, E 201.B, E 202.A, E 202.B, E 412**
- Exhibit: **Exhibit No. 1**

### CHANGES TO DRAWINGS

#### **ADD-2 Item No. D-1 - Updated Space Names**

Refer to Sheet[s]: E-201.A

Updated space names.

#### **ADD-2 Item No. D-2 - Updated Space Names**

Refer to Sheet[s]: E-201B

Updated space names.

1.28.2026

Addendum No. 2 // Chenary Auditorium Lighting Replacement // 23-644.00

2

**ADD-2 Item No. D-3 - Updated Space Names**

Refer to Sheet[s]: E-202.A

Updated space names.

**ADD-2 Item No. D-4 - Updated Space Names**

Refer to Sheet[s]: E-202.B

Updated space names.

**ADD-2 Item No. D-5 - Lighting Control Schedule**

Refer to Sheet[s]: E-412

Provided lighting control schedule.

**ADD-2 Item No. D-6 - Theatrical Lighting RFI's and Additional Information**

Refer to Exhibit No. 1

RFI answers and additional information are provided on Exhibit No. 1

**END OF ADDENDUM.**

January 26, 2026

**HAV Design**

426 Century Lane, Suite 200  
Holland, MI 49423

TowerPinkster  
Addendum No. 2  
Exhibit No. 1  
January 27, 2026  
Page 1 of 2

**Project: CEC-Cheney Auditorium Lighting Replacement**

**Kalamazoo Public Schools, Kalamazoo, MI**

**Specification Section: 26 09 61**

**Addenda #2**

---

---

**Theatrical Lighting Alternate #1:**

Provide a price to test for functionality and reuse all line voltage wiring in the theatrical lighting system, in lieu of removal and replacement of all wiring “back to source”. This includes all line voltage (120V) wiring between the power control racks (DR-A, DR-B, TRP-A) and theatrical lighting plug strips, outlet boxes, plug boxes, grid iron junction boxes, and floor pockets.

---

**Base Bid Add to specification section 26 0961- Theatrical Lighting Control System – Appendix A**

**Apron Downlights:** Add 10 – type SP-5 (CSSPOTVMVS/15-30LT) luminaires to base bid for use as Apron Downlights. Provide proper mounting brackets to support luminaires above 10 existing ceiling ports. Provide power and DMX interface cables for integration of luminaires.

---

**Base Bid Change to specification section 26 0961- Theatrical Lighting Control System – Appendix A**

Acoustic Shell LED Replacements: Delete 21 Wenger CLTO-150-35-30-RJ45-90-NL. Add 21 Wenger Novara, DMX Controlled, 3000K LED luminaires. Specified cable package to remain. Wenger to provide site specific photometry at time of submittal.

---

**Pre-BID RFI – Fantasee Lighting**

**Question 1:**

*Section 26 0961 - Theatrical Lighting Control System*

*In 1.9 - Approved Vendors, please update Fantasee Lighting to our new name and location: Fantasee Integration in Detroit, MI. The telephone number is the same.*

**HAVD Response:**

**Fantasee Integration, Detroit, MI is approved to bid section 26 0961- Theatrical Lighting Control System**

**Question 2:**

*Section 26 0961 - Theatrical Lighting Control System*

*The Lighting Fixtures table specifies that all new fixtures and accessories be black. However, the current fixtures in the space are white. As some of the existing fixtures will receive LED retrofits, would the client like the new fixtures and accessories to also be white?*

**HAVD Response:**

**Provide white for white and black for black for all LED Retrofit luminaires.**

TowerPinkster

Addendum No. 2

Exhibit No. 1

January 27, 2026

Page 2 of 2

**Question 3:**

*All TL series drawings*

*Drawings show great detail on locations where new theatrical lighting fixtures are to be placed, but there are no provided focus points. Will Theatrical Lighting bidders be responsible for labor for focusing fixtures, or will Owner's staff focus fixtures after installation? If focus is Theatrical Lighting bidder's responsibility, please provide focus points.*

**HAVD Response:**

**All Theatrical Sheets**

**Refer to notation on top left of the sheets for Delegation of Responsibilities.**

**"THE TL VENDOR IS RESPONSIBLE FOR HANGING ALL NEW FIXTURES, AND FIXTURES TO BE RE-USED BY THE VENUE, PER THE OWNER'S FIXTURE LAYOUT". The Owner's technical team will provide general focus points for the fixture package.**

---

**Request for "Approval to Bid"**

**HAVD Response:**


**Vincent Lighting Systems Cleveland, OH is approved to bid section 26 0961 – Theatrical Lighting Control System.**


*Todd Kenter*

Todd Kenter

Senior Consultant

HAV Design

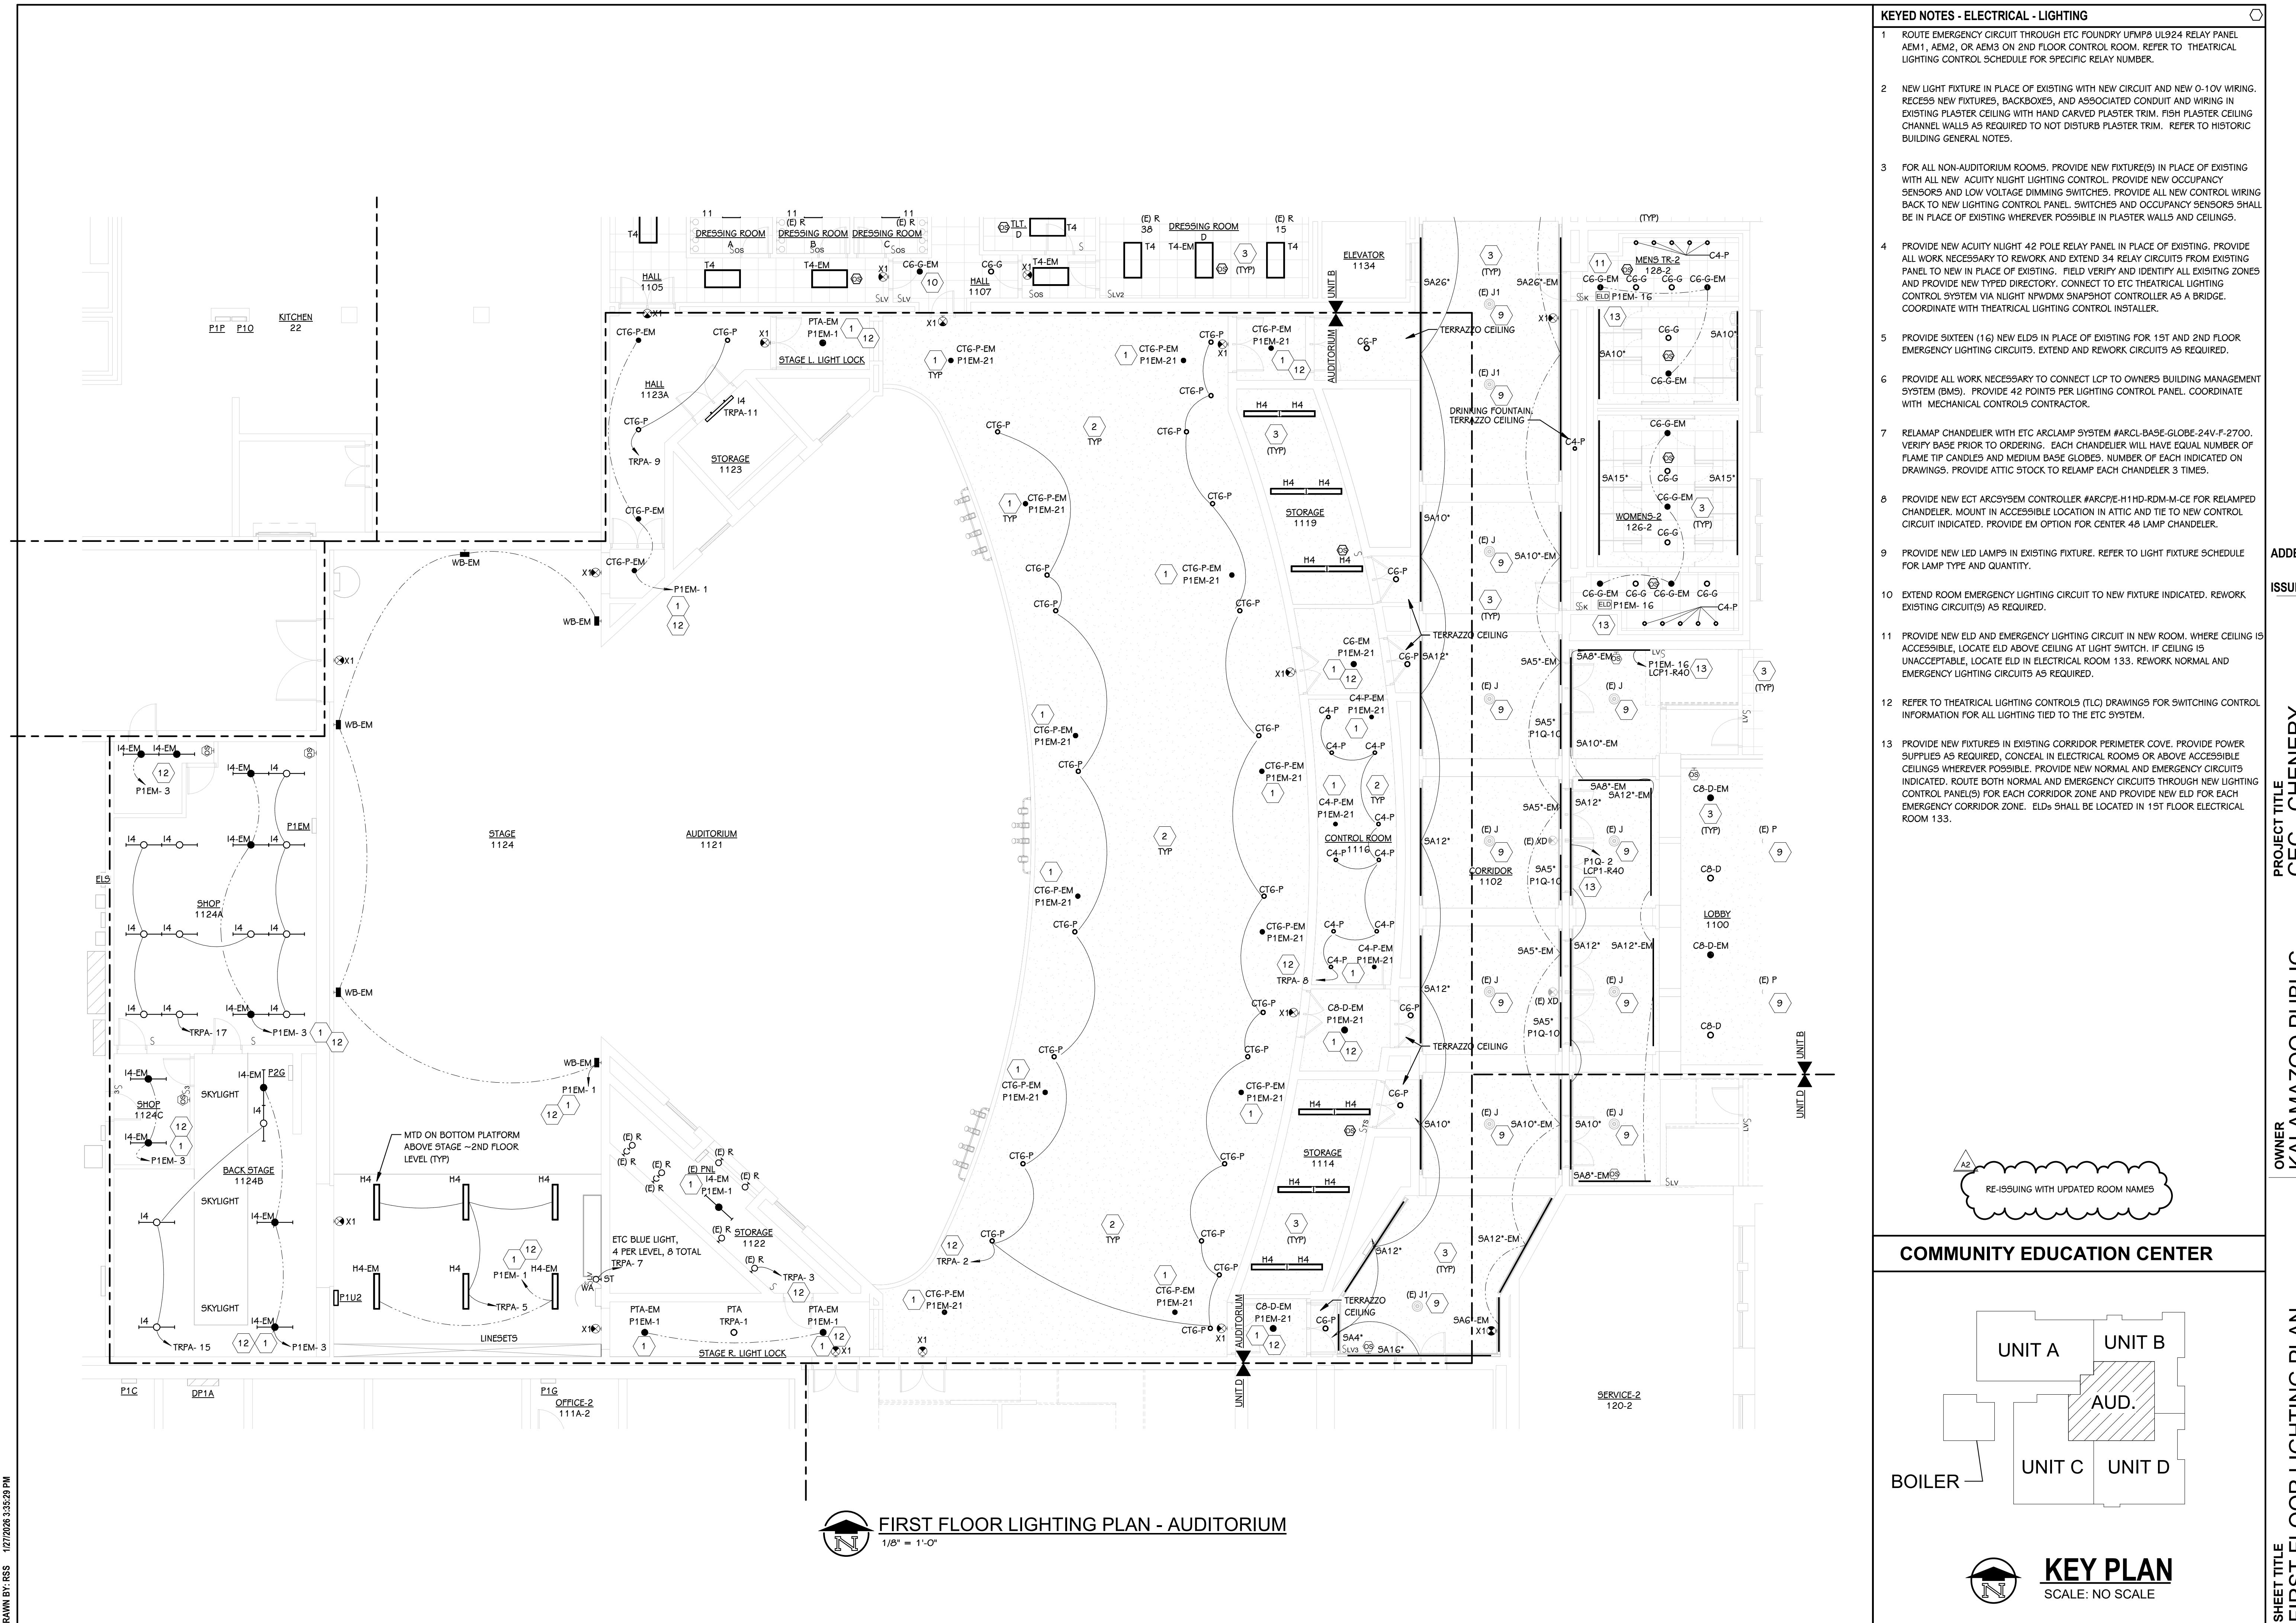

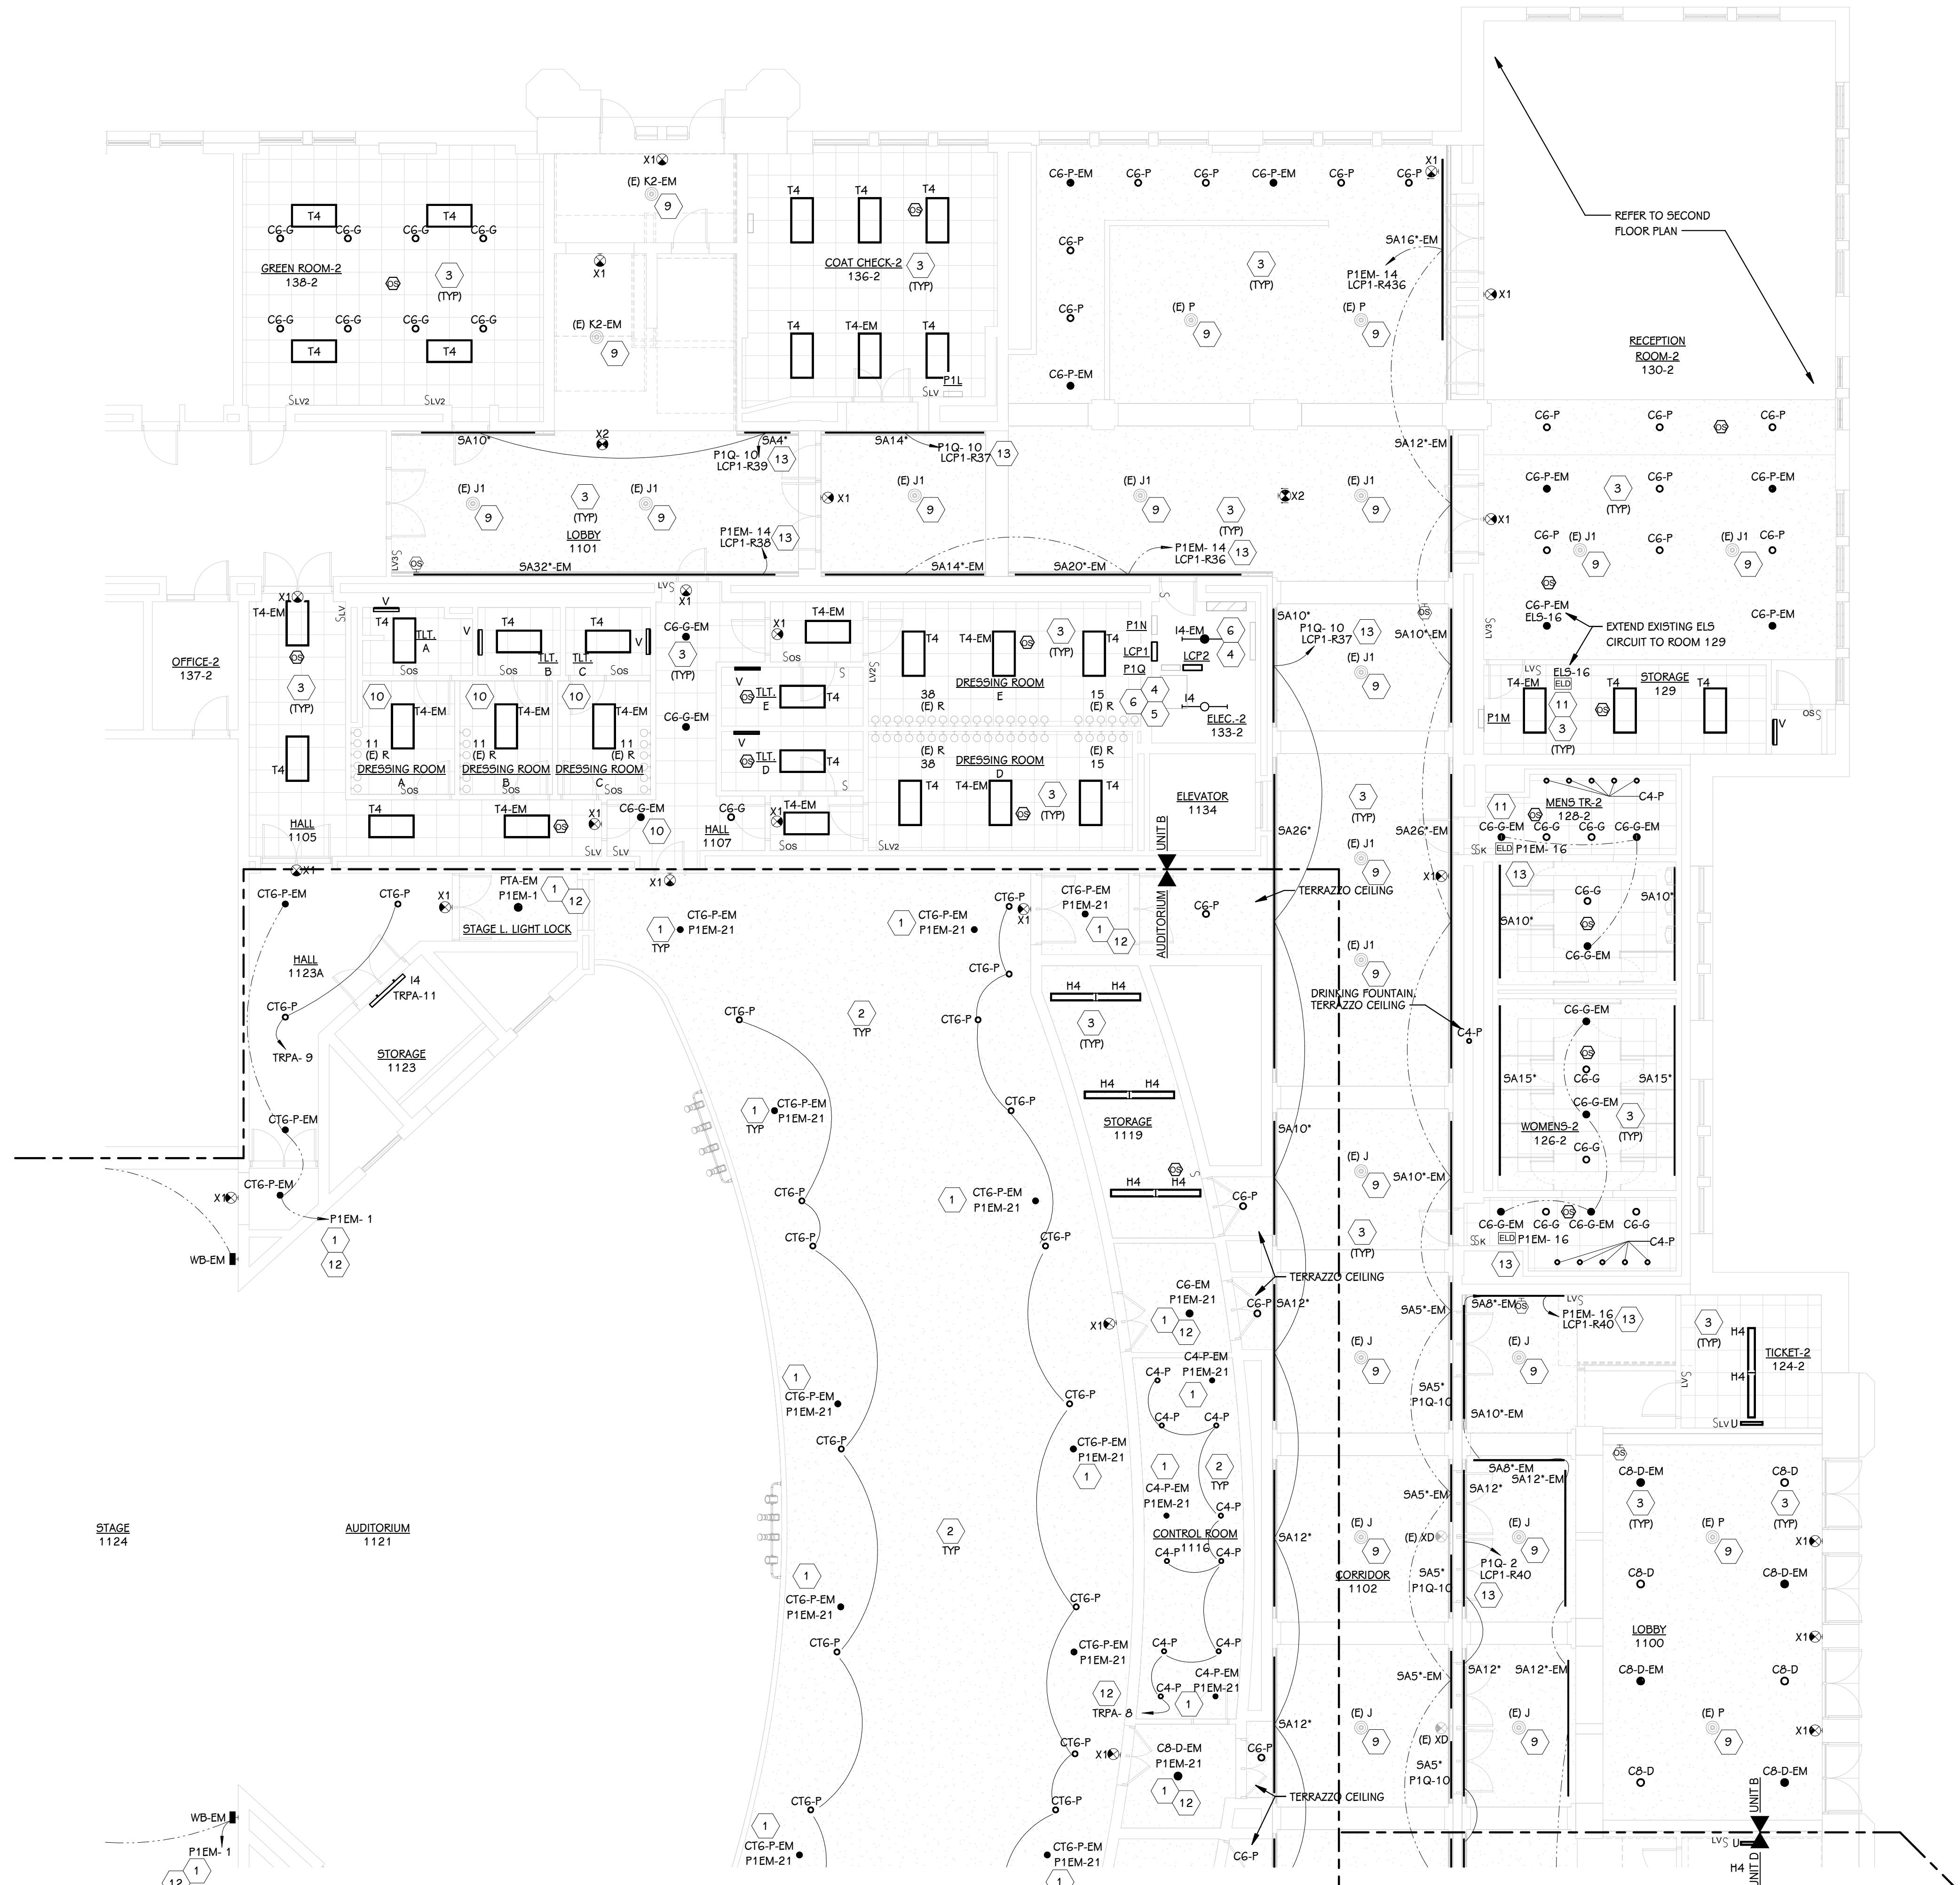


KEYED NOTES - ELECTRICAL - LIGHTING	
1	ROUTE EMERGENCY CIRCUIT THROUGH ETC FOUNDRY UFMFB UL924 RELAY PANEL AEM1, AEM2, OR AEM3 ON 2ND FLOOR CONTROL ROOM. REFER TO THEATRICAL LIGHTING CONTROL SCHEDULE FOR SPECIFIC RELAY NUMBER.
2	NEW LIGHT FIXTURE IN PLACE OF EXISTING WITH NEW CIRCUIT AND NEW 0-10V WIRING. RECESS NEW FIXTURES, BACKBOXES, AND ASSOCIATED CONDUIT AND WIRING IN EXISTING PLASTER CEILING WITH HAND CARVED PLASTER TRIM. FISH PLASTER CEILING CHANNEL WALLS AS REQUIRED TO NOT DISTURB PLASTER TRIM. REFER TO HISTORIC BUILDING GENERAL NOTES.
3	FOR ALL NON-AUDITORIUM ROOMS, PROVIDE NEW FIXTURE(S) IN PLACE OF EXISTING WITH ALL NEW ACUTY NIGHT LIGHTING CONTROL. PROVIDE NEW OCCUPANCY SENSORS AND LOW VOLTAGE DIMMING SWITCHES. PROVIDE ALL NEW CONTROL WIRING BACK TO NEW LIGHTING CONTROL PANEL. SWITCHES AND OCCUPANCY SENSORS SHALL BE IN PLACE OF EXISTING WHEREVER POSSIBLE IN PLASTER WALLS AND CEILINGS.
4	PROVIDE NEW ACUTY NIGHT 42 POLE RELAY PANEL IN PLACE OF EXISTING. PROVIDE ALL WORK NECESSARY TO REWORK AND EXTEND 34 RELAY CIRCUITS FROM EXISTING PANEL TO NEW IN PLACE OF EXISTING. FIELD VERIFY AND IDENTIFY ALL EXISTING ZONES AND PROVIDE NEW TYPED DIRECTORY. CONNECT TO ETC THEATRICAL LIGHTING CONTROL SYSTEM VIA NIGHT NWPDIX SNAPSHOT CONTROLLER AS A BRIDGE. COORDINATE WITH THEATRICAL LIGHTING CONTROL INSTALLER.
5	PROVIDE SIXTEEN (16) NEW ELD'S IN PLACE OF EXISTING FOR 1ST AND 2ND FLOOR EMERGENCY LIGHTING CIRCUITS. EXTEND AND REWORK CIRCUITS AS REQUIRED.
6	PROVIDE ALL WORK NECESSARY TO CONNECT LCP TO OWNERS BUILDING MANAGEMENT SYSTEM (BMS). PROVIDE 42 POINTS PER LIGHTING CONTROL PANEL. COORDINATE WITH MECHANICAL CONTROLS CONTRACTOR.
7	RELAMP CHANDELIER WITH ETC ARCLAMP SYSTEM #ARCL-BASE-GLOBE-24V-F-2700. VERIFY BASE PRIOR TO ORDERING. EACH CHANDELIER WILL HAVE EQUAL NUMBER OF FLAME TIP CANDLES AND MEDIUM BASE GLOBES. NUMBER OF EACH INDICATED ON DRAWINGS. PROVIDE ATTIC STOCK TO RELAMP EACH CHANDELIER 3 TIMES.
8	PROVIDE NEW ECT ARCSYSTEM CONTROLLER #ARCPI-E-H1HD-RDM-M-CE FOR RELAMPED CHANDELIER. MOUNT IN ACCESSIBLE LOCATION IN ATTIC AND TIE TO NEW CONTROL CIRCUIT INDICATED. PROVIDE EM OPTION FOR CENTER 48 LAMP CHANDELIER.
9	PROVIDE NEW LED LAMPS IN EXISTING FIXTURE. REFER TO LIGHT FIXTURE SCHEDULE FOR LAMP TYPE AND QUANTITY.
10	EXTEND ROOM EMERGENCY LIGHTING CIRCUIT TO NEW FIXTURE INDICATED. REWORK EXISTING CIRCUIT(S) AS REQUIRED.
11	PROVIDE NEW ELD AND EMERGENCY LIGHTING CIRCUIT IN NEW ROOM, WHERE CEILING IS ACCESSIBLE, LOCATE ELD ABOVE CEILING AT LIGHT SWITCH. IF CEILING IS UNACCEPTABLE, LOCATE ELD IN ELECTRICAL ROOM 133. REWORK NORMAL AND EMERGENCY LIGHTING CIRCUITS AS REQUIRED.
12	REFER TO THEATRICAL LIGHTING CONTROLS (TLC) DRAWINGS FOR SWITCHING CONTROL INFORMATION FOR ALL LIGHTING TIED TO THE ETC SYSTEM.
13	PROVIDE NEW FIXTURES IN EXISTING CORRIDOR PERIMETER COVE. PROVIDE POWER SUPPLIES AS REQUIRED. CONCEAL IN ELECTRICAL ROOMS OR ABOVE ACCESSIBLE CEILINGS WHEREVER POSSIBLE. PROVIDE NEW NORMAL AND EMERGENCY CIRCUITS INDICATED. ROUTE BOTH NORMAL AND EMERGENCY CIRCUITS THROUGH NEW LIGHTING CONTROL PANEL(S) FOR EACH CORRIDOR ZONE AND PROVIDE NEW ELD FOR EACH EMERGENCY CORRIDOR ZONE. ELD'S SHALL BE LOCATED IN 1ST FLOOR ELECTRICAL ROOM 133.

ADDENDUM #2	01/27/2026
ISSUED FOR	DATE
PROJECT TITLE CEC - CHENERY AUDITORIUM LIGHTING REPLACEMENT	

OWNER  
KALAMAZOO PUBLIC  
SCHOOLS

KALAMAZOO, MICHIGAN

## COMMUNITY EDUCATION CENTER

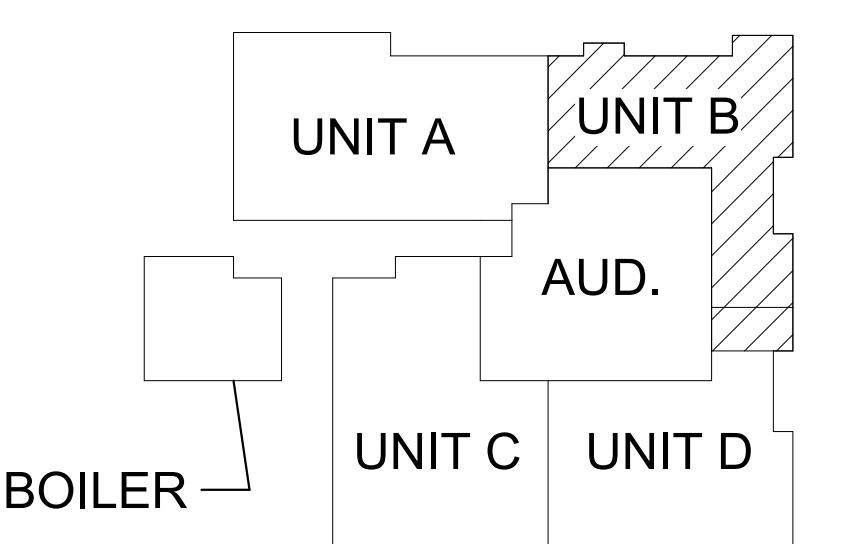

KEY PLAN  
SCALE: NO SCALE

KEYED NOTES - ELECTRICAL - LIGHTING	
1	ROUTE EMERGENCY CIRCUIT THROUGH ETC FOUNDRY UMPF8 UL924 RELAY PANEL AEM1, AEM2, OR AEM3 ON 2ND FLOOR CONTROL ROOM. REFER TO THEATRICAL LIGHTING CONTROL SCHEDULE FOR SPECIFIC RELAY NUMBER.
2	NEW LIGHT FIXTURE IN PLACE OF EXISTING WITH NEW CIRCUIT AND NEW 0-10V WIRING. RECESS NEW FIXTURES, BACKBOXES, AND ASSOCIATED CONDUIT AND WIRING IN EXISTING PLASTER CEILING WITH HAND CARVED PLASTER TRIM. FISH PLASTER CEILING CHANNEL WALLS AS REQUIRED TO NOT DISTURB PLASTER TRIM. REFER TO HISTORIC BUILDING GENERAL NOTES.
3	FOR ALL NON-AUDITORIUM ROOMS, PROVIDE NEW FIXTURE(S) IN PLACE OF EXISTING WITH ALL NEW ACUTY NIGHT LIGHTING CONTROL. PROVIDE NEW OCCUPANCY SENSORS AND LOW VOLTAGE DIMMING SWITCHES. PROVIDE ALL NEW CONTROL WIRING BACK TO NEW LIGHTING CONTROL PANEL. SWITCHES AND OCCUPANCY SENSORS SHALL BE IN PLACE OF EXISTING WHEREVER POSSIBLE IN PLASTER WALLS AND CEILINGS.
4	PROVIDE NEW ACUTY NIGHT 42 POLE RELAY PANEL IN PLACE OF EXISTING. PROVIDE ALL WORK NECESSARY TO REWORK AND EXTEND 34 RELAY CIRCUITS FROM EXISTING PANEL TO NEW IN PLACE OF EXISTING. FIELD VERIFY AND IDENTIFY ALL EXISTING ZONES AND PROVIDE NEW TYPED DIRECTORY. CONNECT TO ETC THEATRICAL LIGHTING CONTROL SYSTEM VIA NIGHT NPWDMX SNAPSHOT CONTROLLER AS A BRIDGE. COORDINATE WITH THEATRICAL LIGHTING CONTROL INSTALLER.
5	PROVIDE SIXTEEN (16) NEW ELDs IN PLACE OF EXISTING FOR 1ST AND 2ND FLOOR EMERGENCY LIGHTING CIRCUITS. EXTEND AND REWORK CIRCUITS AS REQUIRED.
6	PROVIDE ALL WORK NECESSARY TO CONNECT LCP TO OWNERS BUILDING MANAGEMENT SYSTEM (BMS). PROVIDE 42 POINTS PER LIGHTING CONTROL PANEL. COORDINATE WITH MECHANICAL CONTROLS CONTRACTOR.
7	RELAMAP CHANDELIER WITH ETC ARCLAMP SYSTEM #ARCL-BASE-GLOBE-24V-F-2700. VERIFY BASE PRIOR TO ORDERING. EACH CHANDELIER WILL HAVE EQUAL NUMBER OF FLAME TIP CANDLES AND MEDIUM BASE GLOBES. NUMBER OF EACH INDICATED ON DRAWINGS. PROVIDE ATTIC STOCK TO RELAMP EACH CHANDELIER 3 TIMES.
8	PROVIDE NEW ECT ARCSYSTEM CONTROLLER #ARCP/E-H1HD-RDM-M-CE FOR RELAMPED CHANDELIER. MOUNT IN ACCESSIBLE LOCATION IN ATTIC AND TIE TO NEW CONTROL CIRCUIT INDICATED. PROVIDE EM OPTION FOR CENTER 48 LAMP CHANDELIER.
9	PROVIDE NEW LED LAMPS IN EXISTING FIXTURE. REFER TO LIGHT FIXTURE SCHEDULE FOR LAMP TYPE AND QUANTITY.
10	EXTEND ROOM EMERGENCY LIGHTING CIRCUIT TO NEW FIXTURE INDICATED. REWORK EXISTING CIRCUIT(S) AS REQUIRED.
11	PROVIDE NEW ELD AND EMERGENCY LIGHTING CIRCUIT IN NEW ROOM, WHERE CEILING IS ACCESSIBLE, LOCATE ELD ABOVE CEILING AT LIGHT SWITCH. IF CEILING IS UNACCEPTABLE, LOCATE ELD IN ELECTRICAL ROOM 133. REWORK NORMAL AND EMERGENCY LIGHTING CIRCUITS AS REQUIRED.
12	REFER TO THEATRICAL LIGHTING CONTROLS (TLC) DRAWINGS FOR SWITCHING CONTROL INFORMATION FOR ALL LIGHTING TIED TO THE ETC SYSTEM.
13	PROVIDE NEW FIXTURES IN EXISTING CORRIDOR PERIMETER COVE. PROVIDE POWER SUPPLIES AS REQUIRED. CONCEAL IN ELECTRICAL ROOMS OR ABOVE ACCESSIBLE CEILINGS WHEREVER POSSIBLE. PROVIDE NEW NORMAL AND EMERGENCY CIRCUITS INDICATED. ROUTE BOTH NORMAL AND EMERGENCY CIRCUITS THROUGH NEW LIGHTING CONTROL PANEL(S) FOR EACH CORRIDOR ZONE AND PROVIDE NEW ELD FOR EACH EMERGENCY CORRIDOR ZONE. ELDs SHALL BE LOCATED IN 1ST FLOOR ELECTRICAL ROOM 133.

ADDENDUM #2


01/27/2020

ISSUED FOR

DATE


PROJECT TITLE  
CEC - CHENERY  
AUDITORIUM LIGHTING  
REPLACEMENT

## COMMUNITY EDUCATION CENTER

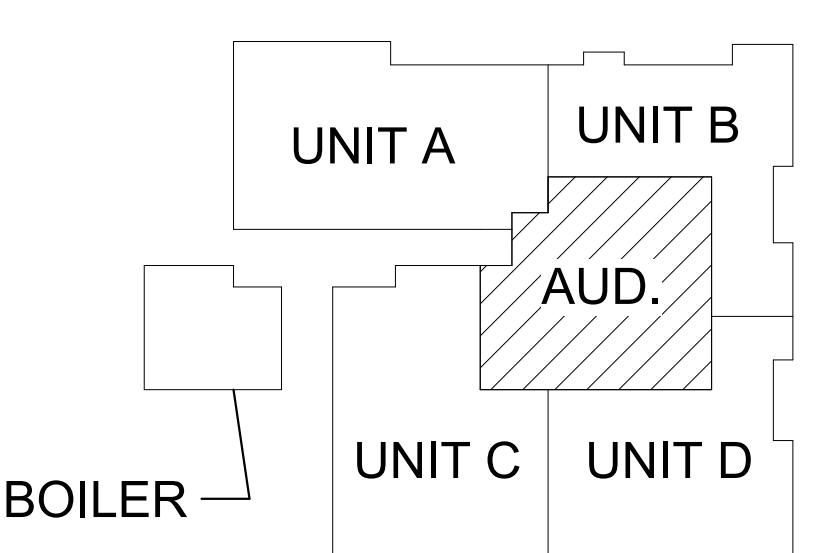

**KEY PLAN**  
SCALE: NO SCALE

SECOND FLOOR LIGHTING PLAN - AUDITORIUM  
1/8" = 1'-0"

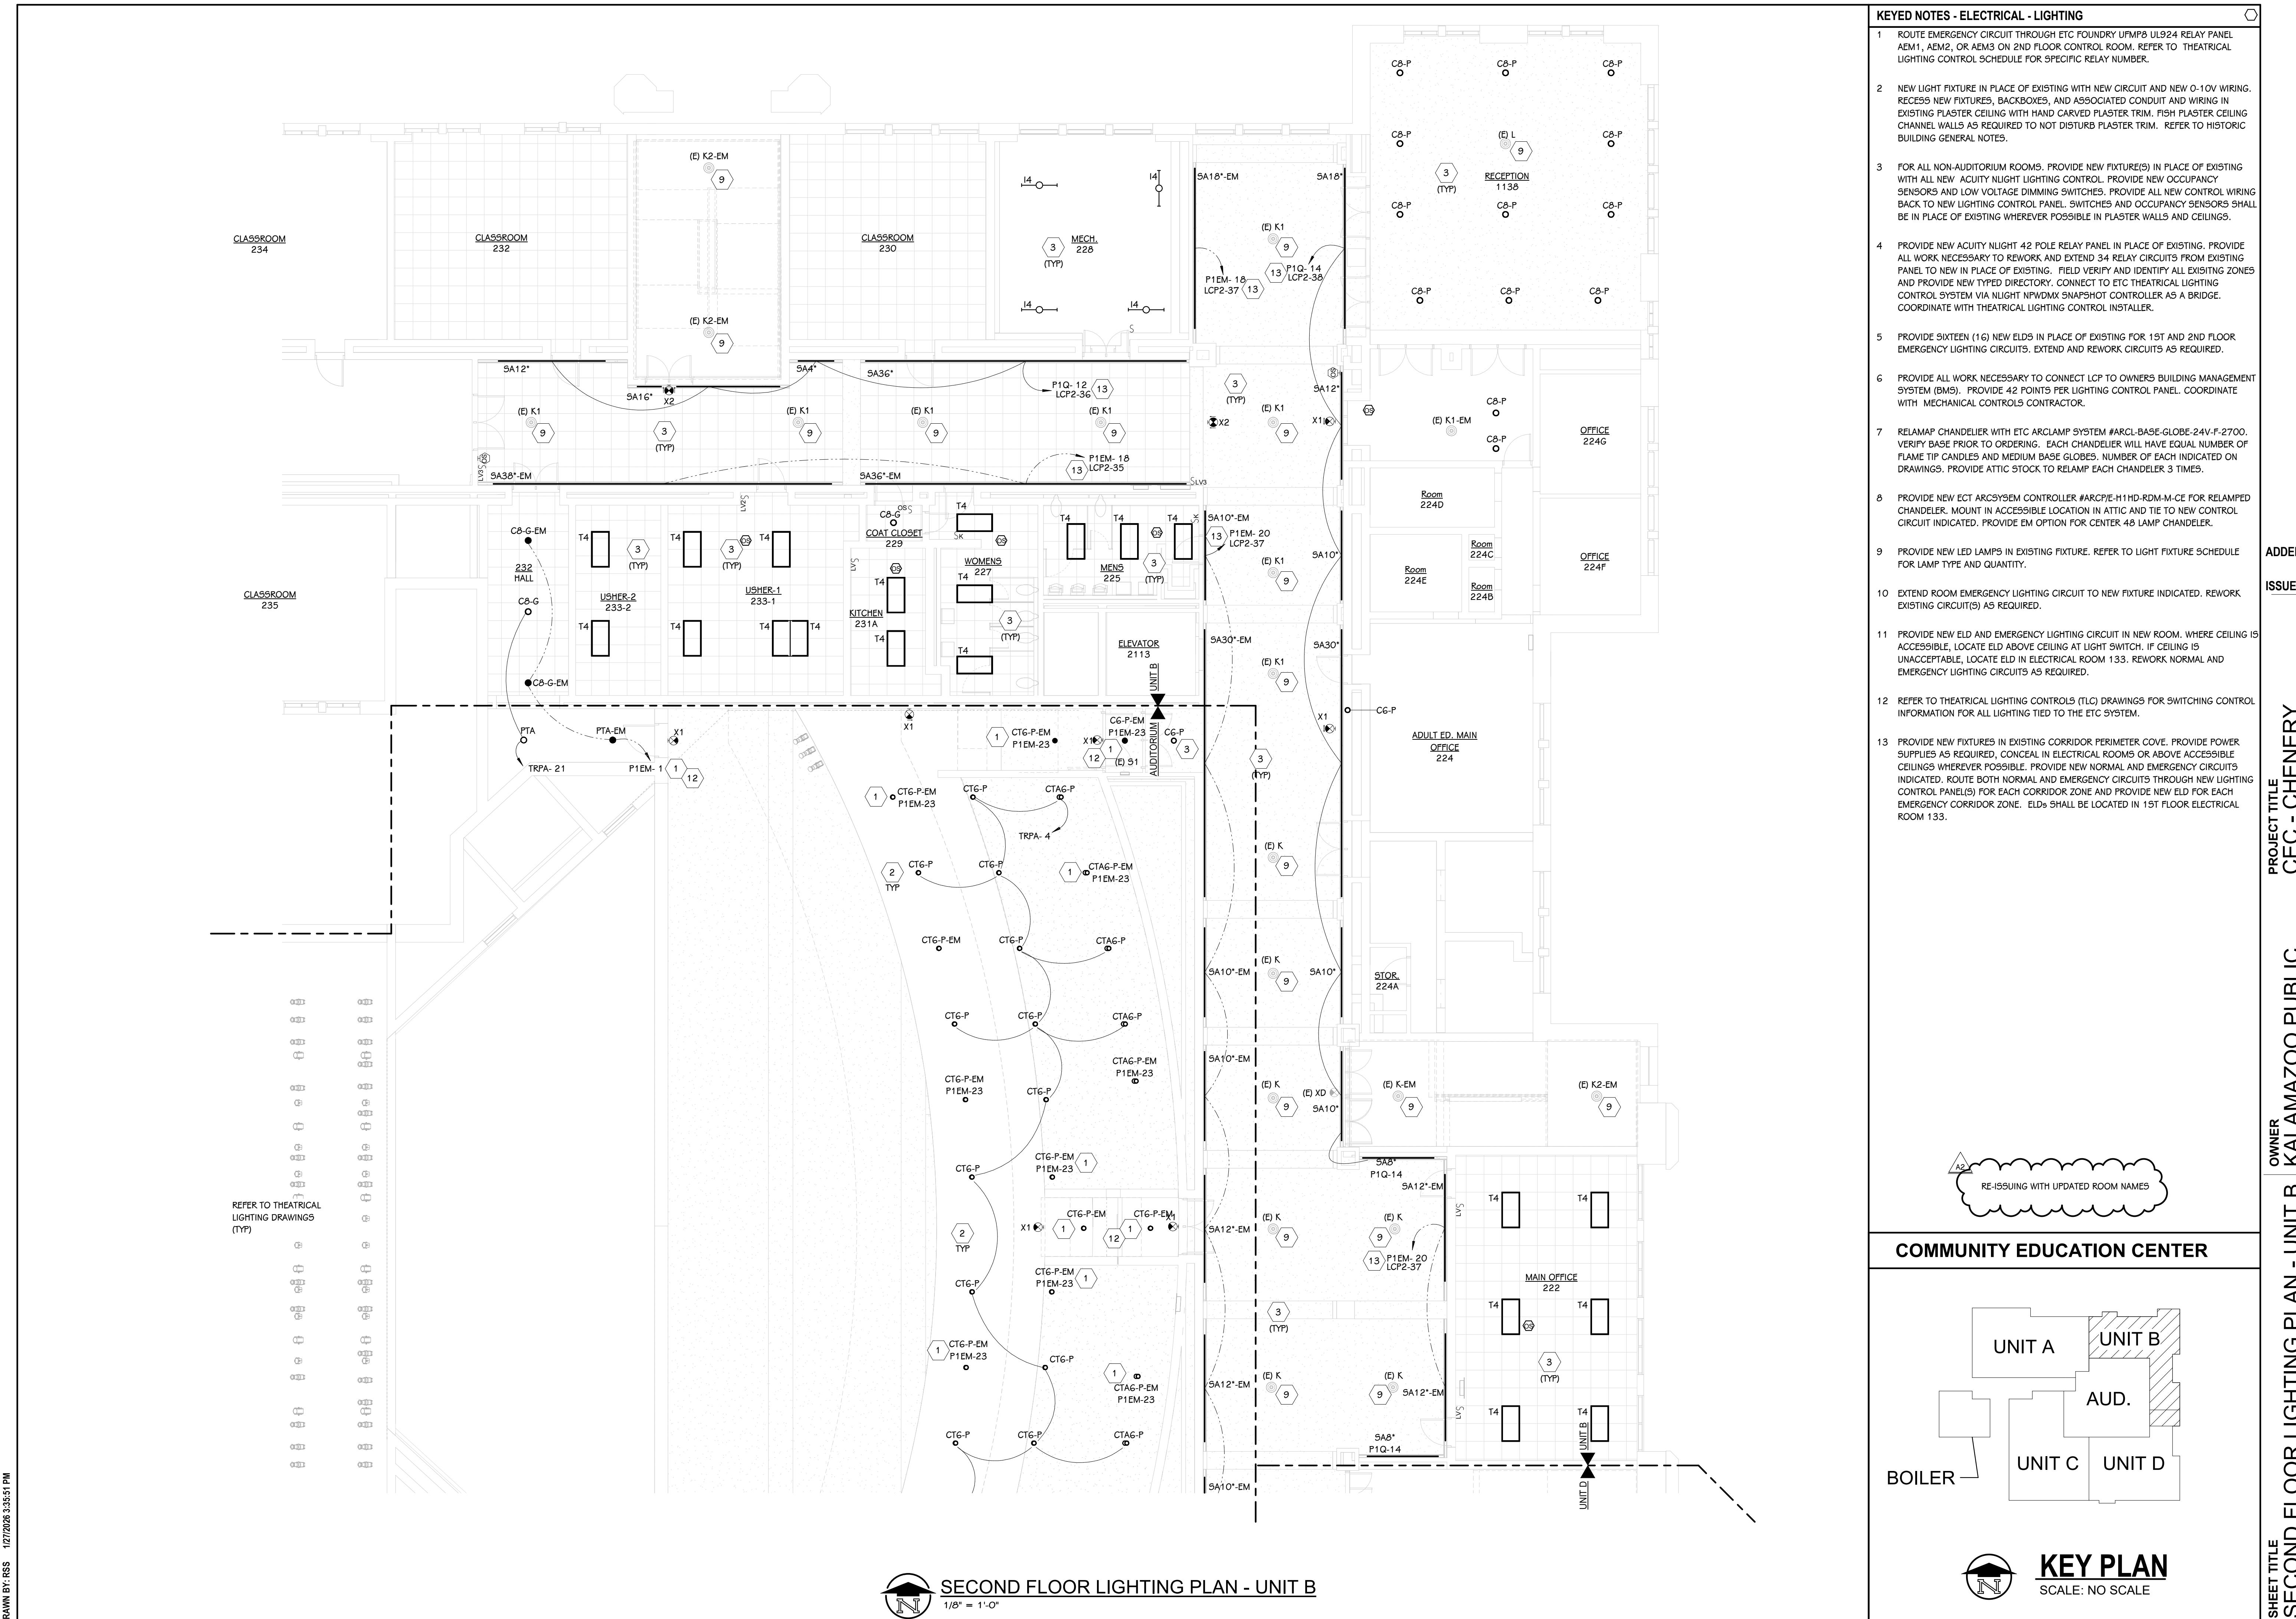

**LIGHTING CONTROL SCHEDULE**

ROOM #	ROOM NAME	AREA	ALLOWANCES (2019 ASHRAE)		ACTUAL LIGHTING POWER	IES 10 TARGET FC	OCCUPANCY SENSOR		MANUAL CONTROL	
			LPD	WATTS			LPD	WATTS	AUTO ON	AUTO OFF
1121	AUDITORIUM	9791	0.61 W/ft <sup>2</sup>	5973 VA	0.28 W/ft <sup>2</sup>	2730 VA	-	-	100% AFTER 20 MINS	YES
136-2	COAT CHECK-2	487	0.38 W/ft <sup>2</sup>	185 VA	0.46 W/ft <sup>2</sup>	222 VA	10	-	-	-
138-2	GREEN ROOM-2	623	0.41 W/ft <sup>2</sup>	256 VA	0.71 W/ft <sup>2</sup>	444 VA	5	-	-	-
E	TLT.	66	0.63 W/ft <sup>2</sup>	41 VA	0.81 W/ft <sup>2</sup>	53 VA	15	100%	100% AFTER 20 MINS	YES
D	TLT.	66	0.63 W/ft <sup>2</sup>	42 VA	0.80 W/ft <sup>2</sup>	53 VA	15	100%	100% AFTER 20 MINS	YES
C	TLT.	45	0.63 W/ft <sup>2</sup>	29 VA	1.17 W/ft <sup>2</sup>	53 VA	15	100%	100% AFTER 20 MINS	YES
B	TLT.	44	0.63 W/ft <sup>2</sup>	28 VA	1.20 W/ft <sup>2</sup>	53 VA	15	100%	100% AFTER 20 MINS	YES
C	DRESSING ROOM	83	0.41 W/ft <sup>2</sup>	34 VA	0.45 W/ft <sup>2</sup>	37 VA	15	50%	100% AFTER 20 MINS	YES
B	DRESSING ROOM	83	0.41 W/ft <sup>2</sup>	34 VA	0.45 W/ft <sup>2</sup>	37 VA	15	50%	100% AFTER 20 MINS	YES
1101	LOBBY	861	0.84 W/ft <sup>2</sup>	723 VA	0.38 W/ft <sup>2</sup>	331 VA	10	100%	100% AFTER 20 MINS	YES
D	DRESSING ROOM	247	0.41 W/ft <sup>2</sup>	101 VA	0.45 W/ft <sup>2</sup>	111 VA	15	50%	100% AFTER 20 MINS	YES
1107B	HALL	40	0.41 W/ft <sup>2</sup>	16 VA	0.96 W/ft <sup>2</sup>	39 VA	10	100%	50% AFTER 20 MINS	YES
1105	HALL	313	0.41 W/ft <sup>2</sup>	128 VA	0.48 W/ft <sup>2</sup>	150 VA	10	100%	50% AFTER 20 MINS	YES
1107	HALL	202	0.41 W/ft <sup>2</sup>	83 VA	0.74 W/ft <sup>2</sup>	150 VA	10	100%	50% AFTER 20 MINS	YES
133-2	ELEC-2	121	0.43 W/ft <sup>2</sup>	52 VA	0.68 W/ft <sup>2</sup>	82 VA	20	-	-	YES
A	DRESSING ROOM	89	0.41 W/ft <sup>2</sup>	36 VA	0.42 W/ft <sup>2</sup>	37 VA	15	50%	100% AFTER 20 MINS	YES
128-2	MENS TR-2	294	0.63 W/ft <sup>2</sup>	185 VA	1.71 W/ft <sup>2</sup>	502 VA	15	100%	100% AFTER 20 MINS	YES
126-2	WOMENS-2	361	0.63 W/ft <sup>2</sup>	240 VA	1.68 W/ft <sup>2</sup>	641 VA	15	100%	100% AFTER 20 MINS	YES
1123A	HALL	271	0.41 W/ft <sup>2</sup>	111 VA	0.56 W/ft <sup>2</sup>	152 VA	10	100%	50% AFTER 20 MINS	YES
129	STORAGE	198	0.38 W/ft <sup>2</sup>	75 VA	0.56 W/ft <sup>2</sup>	111 VA	10	-	100% AFTER 20 MINS	YES
130-2	RECEPTION ROOM-2	1787	0.97 W/ft <sup>2</sup>	1733 VA	0.23 W/ft <sup>2</sup>	411 VA	30	50%	100% AFTER 20 MINS	YES
122-2	TICKET-2	150	0.66 W/ft <sup>2</sup>	99 VA	0.67 W/ft <sup>2</sup>	100 VA	30	50%	100% AFTER 20 MINS	YES
1107A	HALL	44	0.41 W/ft <sup>2</sup>	18 VA	0.89 W/ft <sup>2</sup>	39 VA	10	100%	50% AFTER 20 MINS	YES
E	DRESSING ROOM	266	0.41 W/ft <sup>2</sup>	109 VA	0.42 W/ft <sup>2</sup>	111 VA	15	50%	100% AFTER 20 MINS	YES
1113	_SOUND LOCK	52	0.41 W/ft <sup>2</sup>	21 VA	0.91 W/ft <sup>2</sup>	47 VA	10	100%	50% AFTER 20 MINS	YES
1119	STORAGE	221	0.38 W/ft <sup>2</sup>	84 VA	1.22 W/ft <sup>2</sup>	270 VA	10	-	100% AFTER 20 MINS	YES
1116	CONTROL ROOM	283	0.94 W/ft <sup>2</sup>	266 VA	1.27 W/ft <sup>2</sup>	360 VA	40	50%	100% AFTER 20 MINS	YES
1114	STORAGE	217	0.38 W/ft <sup>2</sup>	83 VA	1.24 W/ft <sup>2</sup>	270 VA	10	-	100% AFTER 20 MINS	YES
1123	STORAGE	85	0.38 W/ft <sup>2</sup>	32 VA	0.46 W/ft <sup>2</sup>	41 VA	10	-	100% AFTER 20 MINS	YES
A	TLT.	55	0.63 W/ft <sup>2</sup>	35 VA	0.96 W/ft <sup>2</sup>	53 VA	15	100%	100% AFTER 20 MINS	YES
124-2	TICKET-2	147	0.66 W/ft <sup>2</sup>	97 VA	0.68 W/ft <sup>2</sup>	100 VA	30	50%	100% AFTER 20 MINS	YES
1102	CORRIDOR	4188	0.41 W/ft <sup>2</sup>	1717 VA	0.38 W/ft <sup>2</sup>	1604 VA	10	100%	50% AFTER 20 MINS	YES
1100	LOBBY	1518	0.84 W/ft <sup>2</sup>	1275 VA	0.65 W/ft <sup>2</sup>	980 VA	10	100%	100% AFTER 20 MINS	YES
1122	STORAGE	157	0.38 W/ft <sup>2</sup>	59 VA	0.67 W/ft <sup>2</sup>	105 VA	10	-	100% AFTER 20 MINS	YES
1124B	BACK STAGE	658	0.41 W/ft <sup>2</sup>	270 VA	0.37 W/ft <sup>2</sup>	246 VA	15	50%	100% AFTER 20 MINS	YES
1124C	SHOP	112	1.26 W/ft <sup>2</sup>	142 VA	0.73 W/ft <sup>2</sup>	82 VA	30	50%	100% AFTER 20 MINS	YES
1124A	SHOP	694	1.26 W/ft <sup>2</sup>	875 VA	0.83 W/ft <sup>2</sup>	574 VA	30	50%	100% AFTER 20 MINS	YES
ELEC 1 FIRST FLOOR		24939		15268 VA		11361 VA				
Grand total		28551		17304 VA		12594 VA				

REFER TO THEATER DRAWINGS FOR AUDITORIUM LIGHTING CONTROLS

ADDENDUM #2 01/27/2026

ISSUED FOR DATE

PROJECT TITLE  
CEC - CHENERY  
AUDITORIUM LIGHTING  
REPLACEMENT

OWNER  
KALAMAZOO PUBLIC  
SCHOOLS

KALAMAZOO, MICHIGAN

SHEET TITLE  
LIGHTING SCHEDULES AND DETAILS  
DATE  
JANUARY 8, 2026

SHEET NUMBER  
E 412  
23644.00