HEET #3

NOTES:

1. Connect new piping to existing and provide new valve as shown.
2. The Mechanical Contractor will be responsible for removing and re-installing of all ceiling construction in regard to this work.
3. NEW PIPING SHALL BE INSULATED AND MARKED. SEE SPECIFICATIONS.

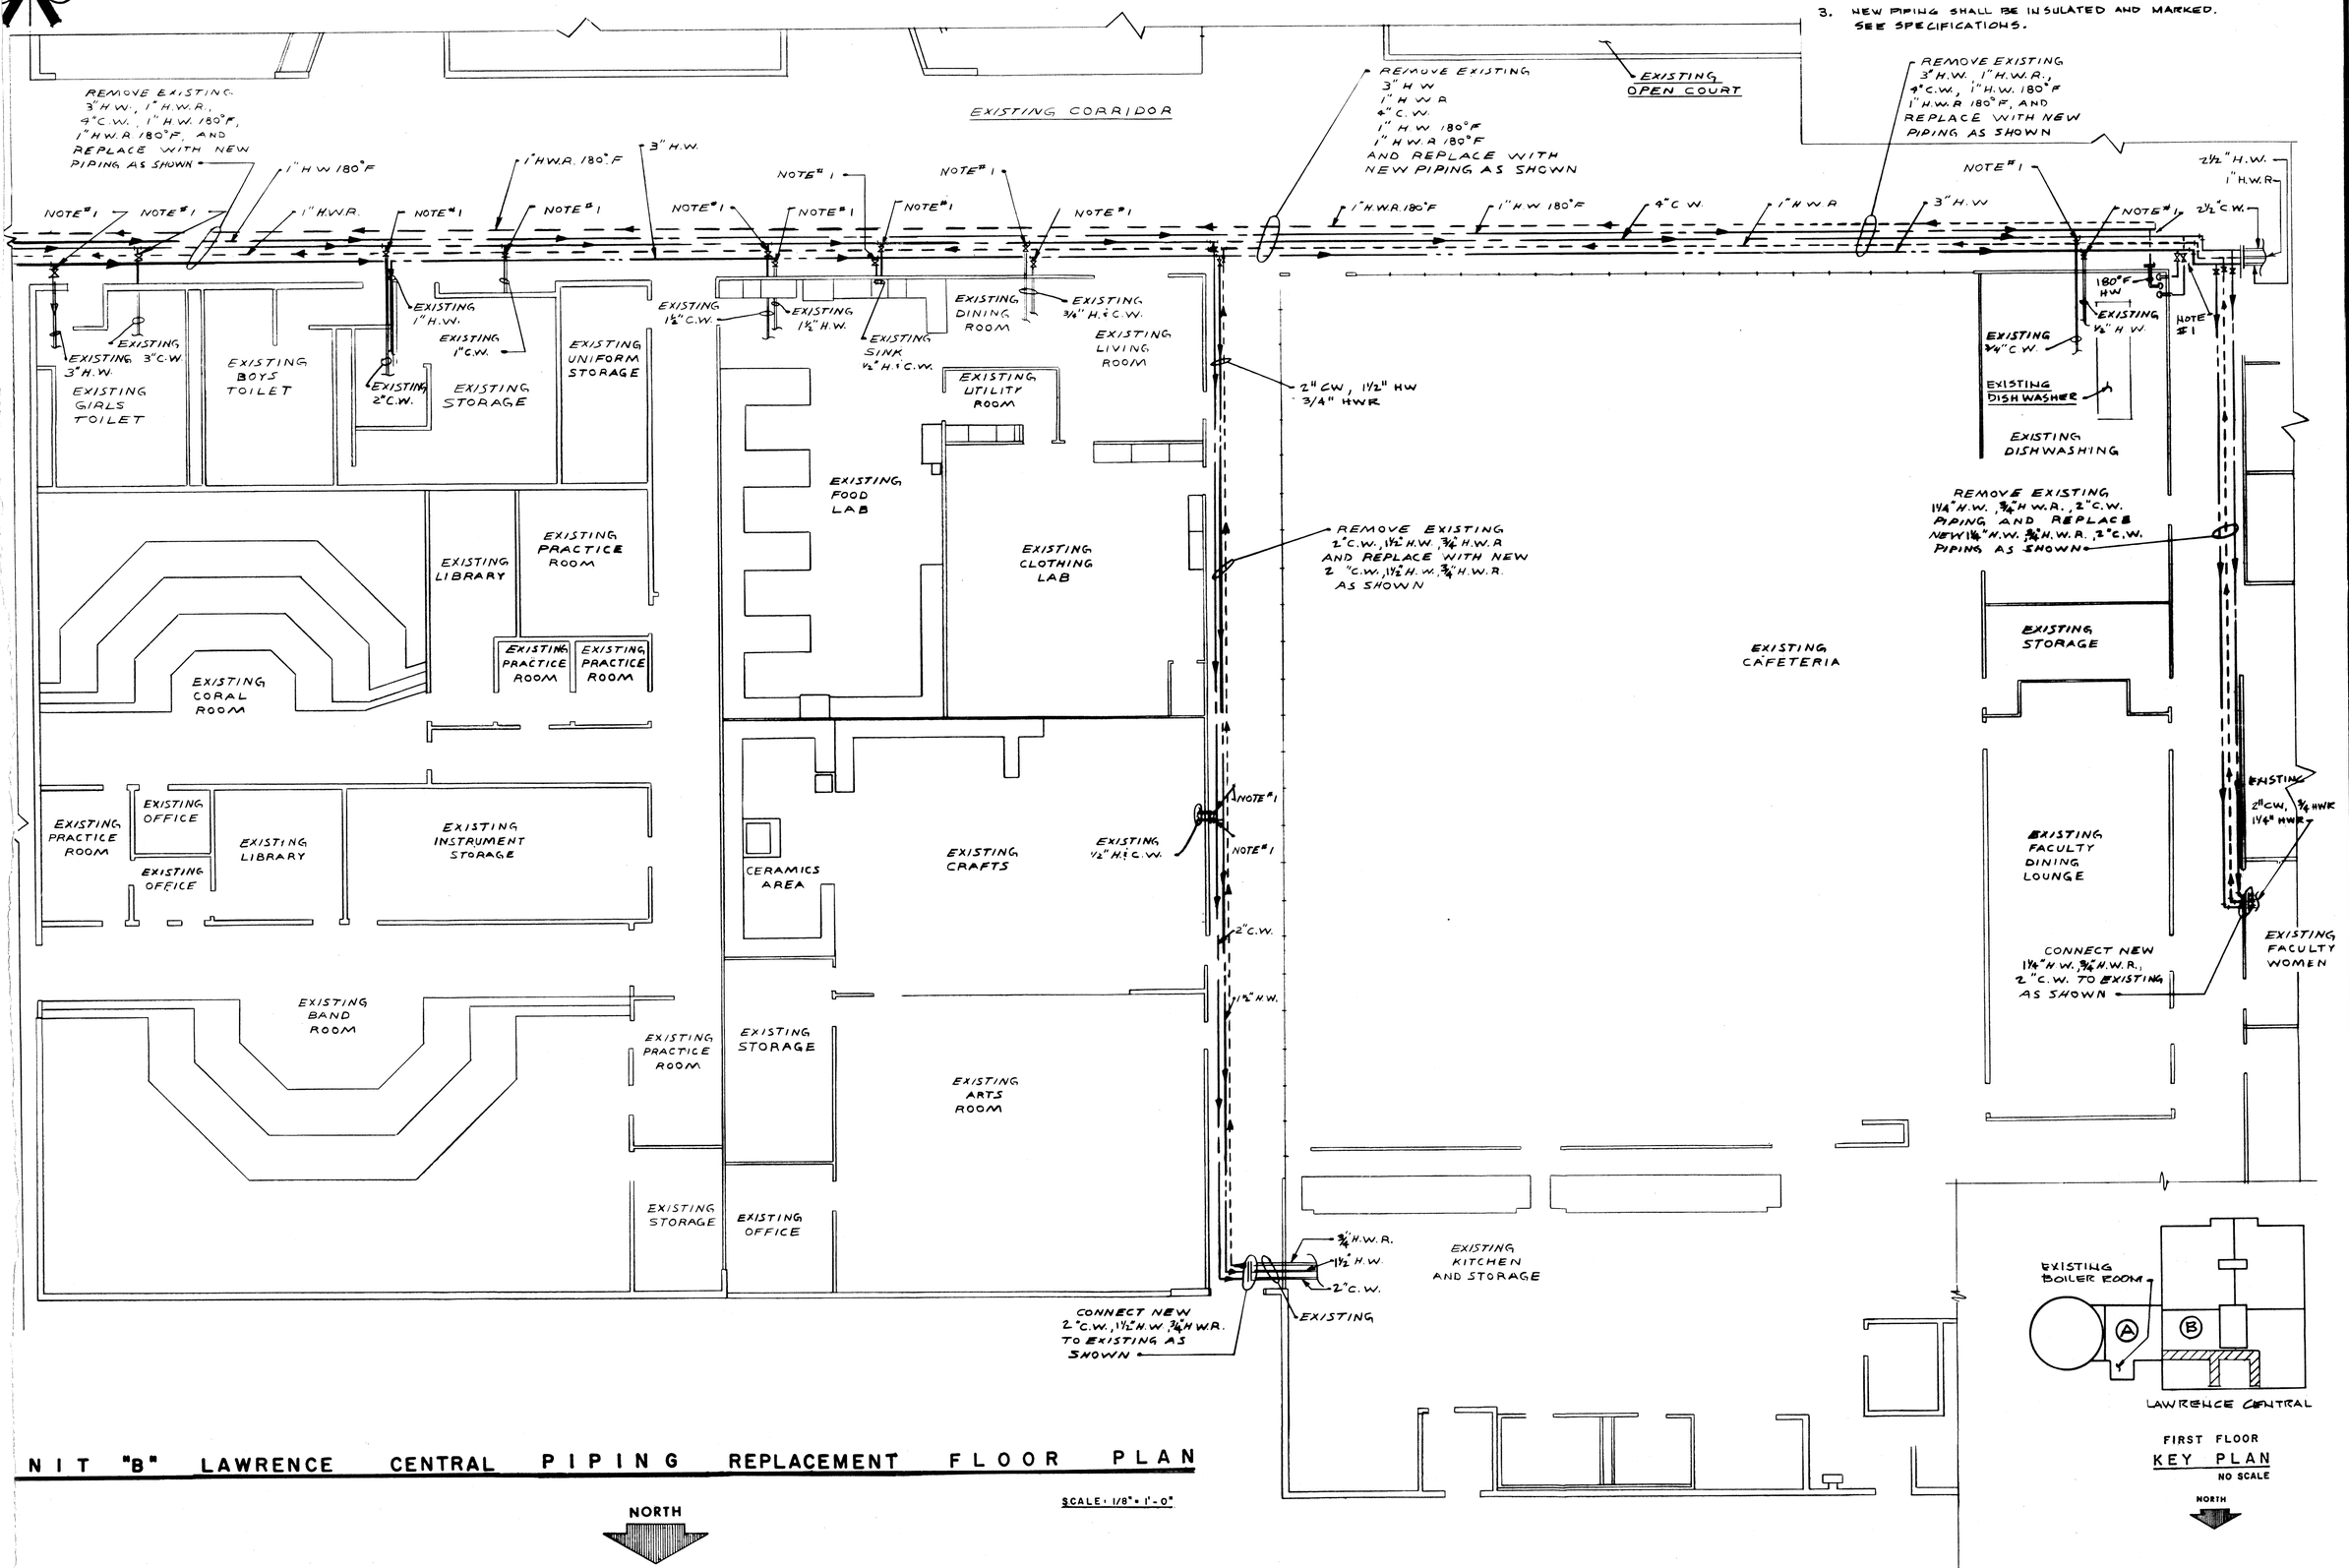

NIT "B" LAWRENCE CENTRAL PIPING REPLACEMENT FLOOR PLAN

SCALE: 1/8" = 1'-0"

NORTH

James W. Roberts

JAMES W. ROBERTS REGISTERED #8583 STATE OF INDIANA PROFESSIONAL ENGINEER

EVERETT · I · BROWN COMPANY ARCHITECTS ENGINEERS
5500 WEST BRADBURY AVENUE • INDIANAPOLIS, INDIANA • 46241 • PARK FLETCHER •

LAWRENCE CENTRAL HIGH SCHOOL

PROJECT 678
DATE MAY 1, 1978
REVISED

NO. 4
OF 4