




PLAN NOTES

1. All piping shown is existing and to be insulated as shown in the specifications unless otherwise noted.
2. The drawing shows only piping requiring work under this contract. The Contractor shall verify location of additional piping etc., in the areas of work which possibly might effect the performance of his works and notify the Engineer prior to proceeding with the work.
3. Any of existing ferrous or non-ferrous piping, hangers, etc., removed from the areas of work by the Contractor shall be turned over to the Owner.
4. All existing debris and debris created by this contract in the work areas shall be immediately removed from the job site.
5. Provide pipe label information and flow direction arrows on all existing or new piping in the tunnels. Painting is not required.
6. Refasten all existing loose insulation on steam mains in piping tunnels.

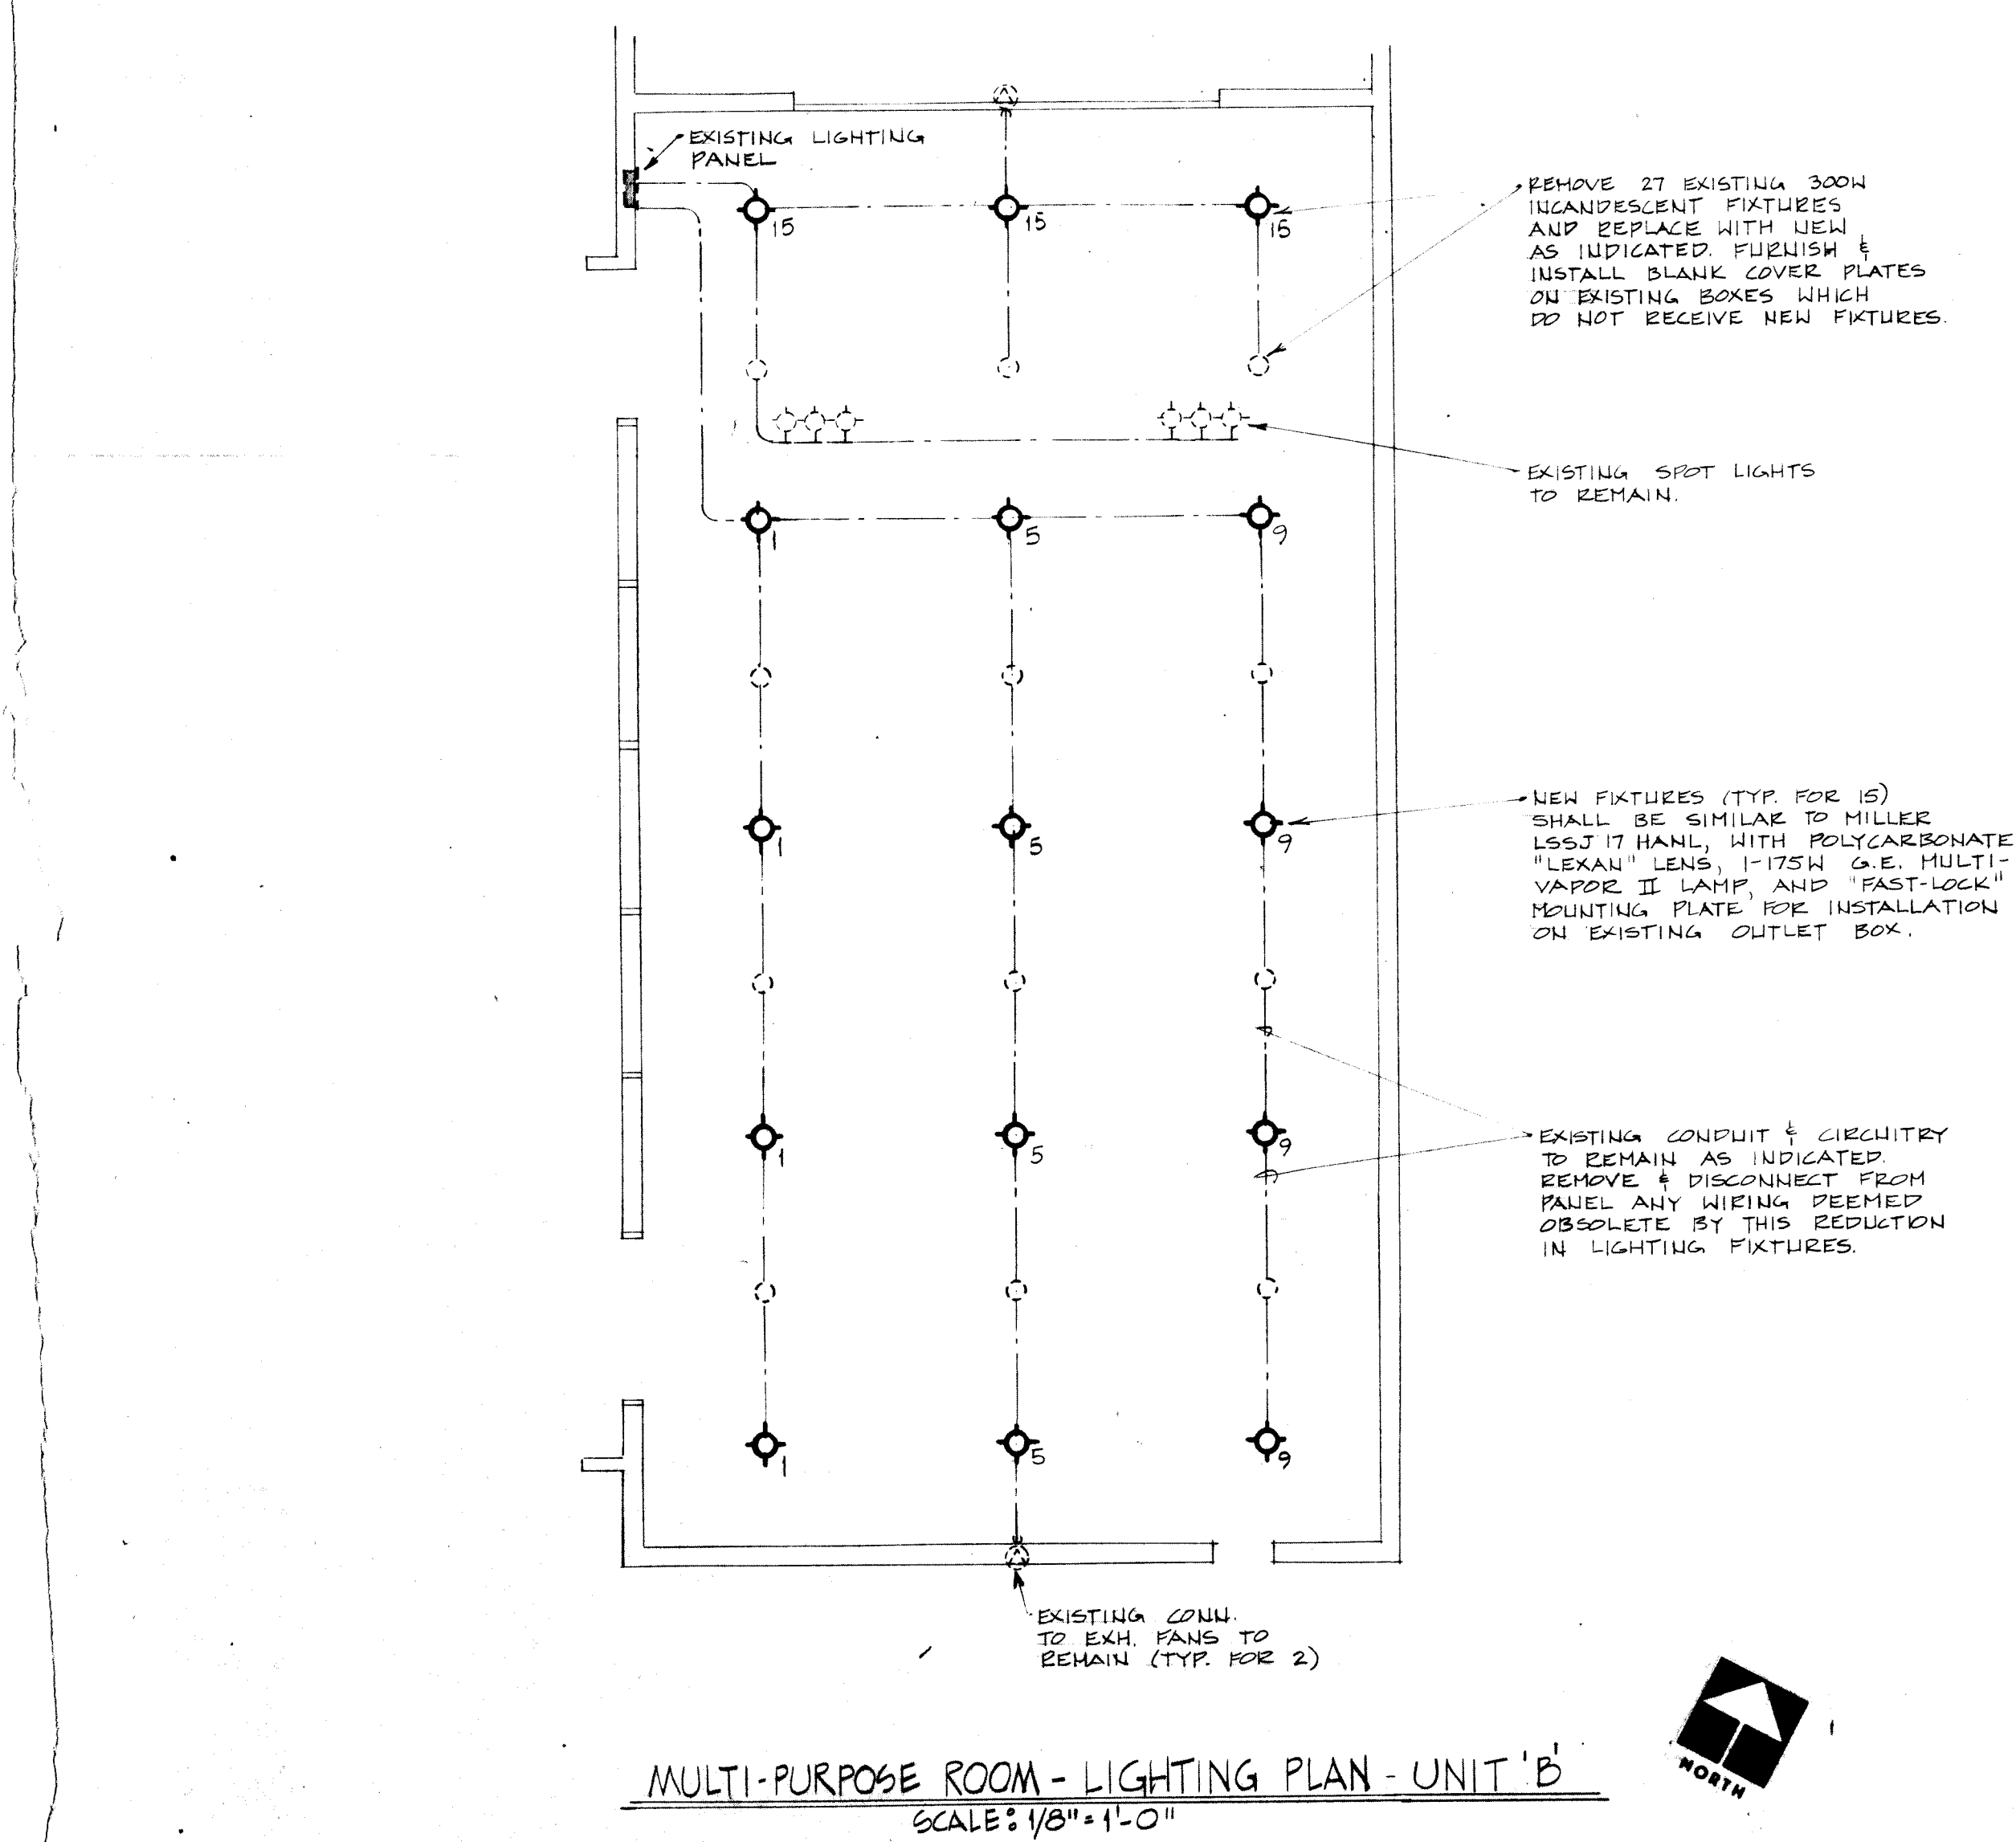