


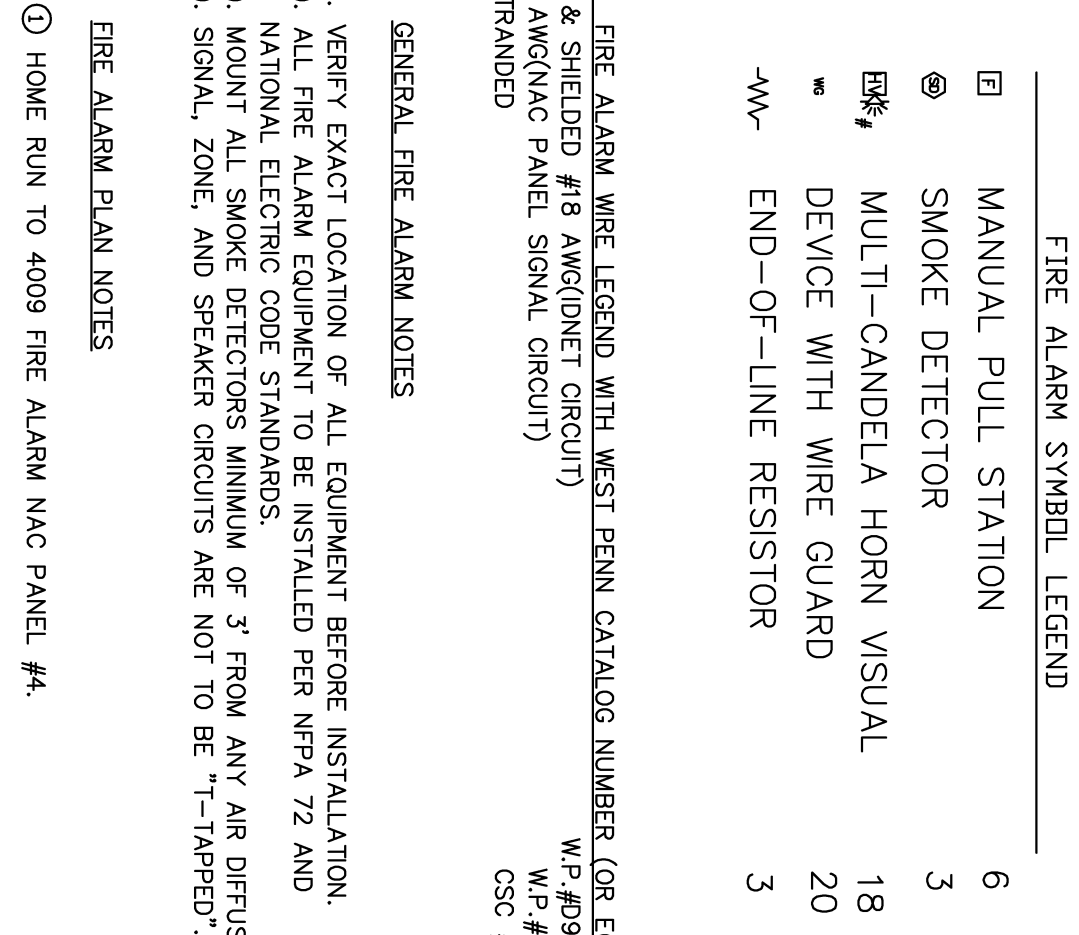

W.P.#D975 OR W.P.#D60975(PLENUM)
W.P.#998 OR W.P.#60995(PLENUM)
CSC #584214

GENERAL FIRE ALARM NOTES

- 1). VERIFY EXACT LOCATION OF ALL EQUIPMENT BEFORE INSTALLATION.
- 2). ALL FIRE ALARM EQUIPMENT TO BE INSTALLED PER NFPA 72 AND NATIONAL ELECTRIC CODE STANDARDS.
- 3). MOUNT ALL SMOKE DETECTORS MINIMUM OF 3" FROM ANY AIR DIFFUSER.
- 4). SIGNAL, ZONE, AND SPEAKER CIRCUITS ARE NOT TO BE "T-TAPPED".

FIRE ALARM PLAN NOTES

① HOME RUN TO 4009 FIRE ALARM NAC PANEL #4